


zenon driver manual



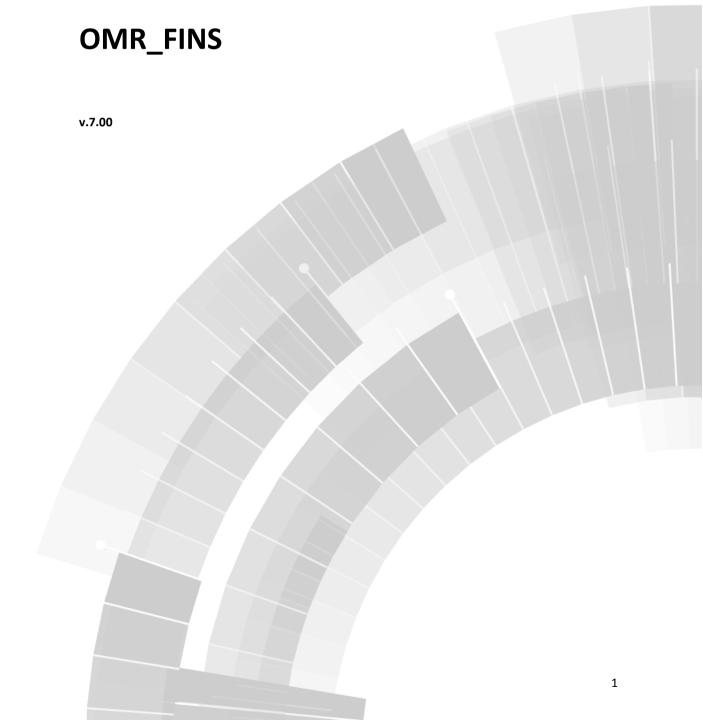

© 2012 Ing. Punzenberger COPA-DATA GmbH

All rights reserved.

Distribution and/or reproduction of this document or parts thereof in any form are permitted solely with the written permission of the company COPA-DATA. The technical data contained herein has been provided solely for informational purposes and is not legally binding. Subject to change, technical or otherwise.



Contents

1	Welcome to COPA-DATA help	
	·	
2.	OMR_FINS	4
3.	OMR_FINS - Data sheet	4
4.	Driver history	6
5.	Requirements	6
	5.1 PC	7
6.	Configuration	7
	6.1 General	8
	6.2 Conn. TCP/IP	11
7.	Addressing	14
8.	Driver objects and datatypes	15
9.	Mapping of the data types	15
	Delivery and office formations	4.0
TO.	. Driver-specific functions	16
11.	. Driver commands	19
	-	
12.	. Test	20
13.	. Error analysis	. 21
	13.1 Analysis tool	21
	13.2 Error numbers	23
	13.3 Check list	23



1. Welcome to COPA-DATA help

GENERAL HELP

If you miss any information in this help chapter or have any suggestions for additions, please feel free to contact us via e-mail: documentation@copadata.com (mailto:documentation@copadata.com).

PROJECT SUPPORT

If you have concrete questions relating to your project, please feel free to contact the support team via e-mail: support@copadata.com (mailto:support@copadata.com)

LICENSES AND MODULES

If you realize that you need additional licenses or modules, please feel free to contact the sales team via e-mail: sales@copadata.com (mailto:sales@copadata.com)

2. OMR_FINS

3. OMR_FINS - Data sheet



General:	
Driver file name	OMR_FINS.exe
Driver description	Omron FINS
PLC types	OMRON SYSMAC
PLC manufacturer	Omron;

Driver supports:	
Protocol	Omron FINS;
Addressing: address based	х
Addressing: name based	-
Spontaneous communication	-
Polling communication	х
Online browsing	-
Offline browsing	-
Real-time capable	-
Blockwrite	х
Modem capable	-
Serial logging	х
RDA numerical	-
RDA String	-



Prerequisites:	
Hardware PC	RS 232 serial interface, cable type: SYSMAC WAY; Standard network card
Software PC	-
Hardware PLC	-
Software PLC	-
Requires v-dll	-

Platforms:	
Operating systems	Windows CE 5.0, CE 6.0; Windows XP, Vista, 7, Server 2003, Server 2008/R2;
CE platforms	x86; ARM; Pocket-PC;

4. Driver history

Date	Driver version	Change
07.07.0	8 1300	Created driver documentation

5. Requirements

This chapter describes the requirements for using the driver.



5.1 PC

HARDWARE

Serial interface RS232 or standard network card (TCP/IP)

SOFTWARE

Copy the driver file OMR_FINS.exe into the current program directory (unless it is already there) and enter it into the file TREIBER_EN.XML with the tool driverinfo.exe.



Info

Windows CE is not supported at the moment.

6. Configuration

In this chapter you will learn how to use the driver in a project and which settings you can change.




💡 Info

Find out more about further settings for zenon variables in the chapter Variables (main.chm::/15247.htm) of the online manual.



6.1 General

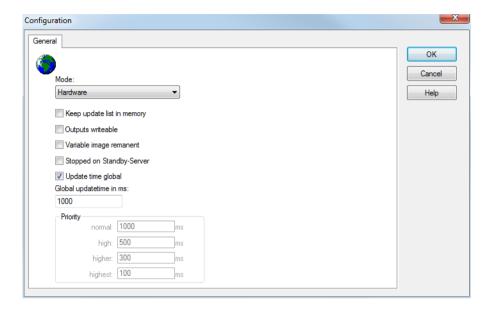



Parameters	Description	
Mode	Allows to switch between hardware mode and simulation mode	
	▶ Hardware:	
	A connection to the control is established.	
	▶ Simulation static	
	No communication between to the control is established, the values are simulated by the driver. In this modus the values remain constant or the variables keep the values which were set by zenon Logic. Each variable has its own memory area, e.g. two variables of the type marker with offset 79 can have different values in the Runtime and do not influence each other. Exception: The simulator driver.	
	▶ Simulation - counting	
	No communication between to the control is established, the values are simulated by the driver. In this modus the driver increments the values within a value range automatically.	
	▶ Simulation - programmed	
	N communication is established to the PLC. The values are calculated by a freely programmable simulation project. The simulation project is created with the help of the zenon Logic Workbench and runs in a zenon Logic Runtime which is integrated in the driver. For details see chapter Driver simulation (main.chm::/25206.htm).	
Keep update list in the memory	Variables which were requested once are still requested from the control even if they are currently not needed. This has the advantage that e.g. multiple screen switches after the screen was opened for the first time are executed faster because the variables need not be requested again. The disadvantage is a higher load for the communication to the control.	
Output can be	Active: Outputs can be written.	
written	Inactive: Writing of outputs is prevented.	
	Note: Not available for every driver.	



Variable image remanent	This option saves and restores the current value, time stamp and the states of a data point.
	Fundamental requirement: The variable must have a valid value and time stamp.
	The variable image is saved in mode hardware if:
	one of the states S_MERKER_1(0) up to S_MERKER8(7), REVISION(9), AUS(20) or ERSATZWERT(27) is active
	The variable image is always saved if:
	▶ the variable is of the object type Driver variable
	the driver runs in simulation mode. (not programmed simulation)
	The following states are not restored at the start of the Runtime:
	▶ SELECT(8)
	▶ WR-ACK(40)
	▶ WR-SUC(41)
	The mode Simulation - programmed at the driver start is not a criterion in order to restore the remanent variable image.
Stop at the Standby Server	Setting for redundancy at drivers which allow only on communication connection. For this the driver is stopped at the Standby Server and only started at the upgrade.
	Attention: If this option is active, the gapless archiving is no longer guaranteed.
	Active: Sets the driver at the not-process-leading Server automatically in a stop-like state. In contrast to stopping via driver command, the variable does not receive status switched off (statusverarbeitung.chm::/24150.htm) but an empty value. This prevents that at the upgrade to the Server irrelevant values are created in the AML, CEL and Historian.
Global Update time	Active: The set Global update time in ms is used for all variables in the project. The priority set at the variables is not used. Inactive: The set priorities are used for the individual variables.
Priority	Here you set the polling times for the individual priorities. All variables with the according priority are polled in the set time. The allocation is taken



place for each variable separately in the settings of the variable properties. The communication of the individual variables are graduated in respect of
importance or necessary topicality using the priorities. Thus the
communication load is distributed better.

UPDATE TIME FOR CYCLICAL DRIVER

The following applies for cyclical drivers:

For Set value, Advising of variables and Requests, a read cycle is immediately triggered for all drivers regardless of the set update time. This ensures that the value is immediately available for visualization after writing. Update times can therefore be shorter than pre-set for cyclical drivers.

6.2 Conn. TCP/IP

CONFIGURATION FILE / ALLOCATION FILE

The filename of the allocation file for the TCP connection is Conf_[Treiberbezeichnung].tcp. It contains the following sections for each configurable HW-address (xx is the HW-address):


[FETCHHWxx]

CONN_NAME - Name of connection

REMOTE_IP - IP-Address of PLC



REMOTE_PORT - Port of PLC

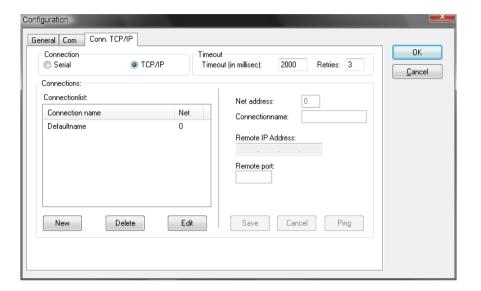



Parameters	Description
Connection	Selection of connection type.
Serial	Active: Serial connection is used.
TCP/IP	Active: TCP/IP connection is used.
Timeout	Waiting time for establishing a connection in milliseconds.
Retries	Number of retries if establishing a connection is not successful.
Connections	Settings of the connections.
List of connections	List of defined connections to PLCs.
Net address	Corresponds to the Net address property in variable configuration.
Connection name	Freely definable name.
Remote IP address	Address of the PLC.
Remote Port	Port address of PLC. You can find details in the manual of your PLC.
New	Establishes a new connection.
Delete	Deletes highlighted connection from the list.
Edit	Opens highlighted connection for editing.
Save	Accepts all changes for edited connection and closes editing option.
Cancel	Discards all changes for edited connection and closes editing option.
Ping	Sends a ping to the IP address that is configured for this connection. Allows the connection to the device to b tested. If the ping is concluded negatively, check the IP address and check to see if the device is online.
OK	Acept changes in the dialog and close dialog.
	Only available if no connection is in the "edit" state.
Cancel	Discards all changes and closes dialog.
Help	Opens online help.





Maximum number of connections: 256 (0-255).

7. Addressing

VARIABLE ADDRESSING VIA

Address

The variables are allocated to the memory area of the PLC by their offset.



Info

The addressing of the PLC is carried out as WORD. For uneven string length always one additional character is read or written.



8. Driver objects and datatypes

DRIVER OBJECT TYPES AND SUPPORTED IEC DATA TYPES FOR PROCESS VARIABLES IN THE CONTROL SYSTEM

Driver object types	Channel type	Supported datatypes (DataType)	Read	Write	Comment
IR Area	64	BOOL, INT, UINT	Y	Y	
HR Area	65	BOOL, INT, DINT, REAL, UINT, UDINT, STRING	Y	Y	
AR Area	66	BOOL, INT, UINT	Υ	Y	
TIM/CNT	68	BOOL	Υ	Y	
DM Area	70	BOOL, INT, DINT, REAL, UINT, UDINT, STRING	Y	Y	
CIO Area	71	BOOL, INT, DINT, REAL UINT, UDINT, STRING	Y	Y	
WORK Area	72	BOOL, INT, DINT, REAL, UINT, UDINT, STRING	Y	Y	

9. Mapping of the data types

All variables in zenon are derived from IEC data types. The following table compares the IEC datatypes with the datatypes of the PLC.



EXAMPLES FOR ALL POSSIBLE IEC DATA TYPES

PLC	zenon
116	INT
132	DINT
U16	UINT
U32	UDINT
REAL	REAL
Boolean	BOOL

Data type: The property Data type is the internal numerical name of the data type. It is also used for the extended DBF import/export of the variables.

10. Driver-specific functions

This driver supports the following functions:

INI ENTRIES

ZENON6.INI

Blockwrite

With an entry in the zenon.ini, block write can be activated. To activate it the entry BLOCKWRITE=1 has to be set in the section [OMR_FINS].

PROJECT.INI

Serial logging

To activate this option a project.ini entry has to be added in the section [RS232LOG] and the entry LOGCOMx=0 or 1 has to be set below. X has to be replaced by the number of the desired interface.



0 switches logging off, 1 switches logging on. If logging is switched on, a file LOG_COMxxx.TXT is generated in the directory of the driver. X is replaced by the number of the defined interface.

Examples for the activation of logging for COM 1:

[RS232LOG]

LOGCOM1=1



Info

We recommend activating logging only for a short time, when problems occur. Active logging needs considerable computer performance. Additionally the log file needs a lot of memory within short time.

ERROR FILE

The driver supports the common error files, with zenon 6.20 or higher a central logging is possible.

EXTENDED ERROR FILE

The driver does not support extended logging.

SERIAL LOGGING

In order to activate this option a section RS232LOG has to be added to the project.ini. Here

the entry LOGCOMx=0 or 1 has to be set. X has to be replaced by the number of the desired interface. With o

0 switches logging off, 1 switches logging on. If logging is switched on, a file LOG_COMxxx.TXT is generated in the directory of the driver. X is replaced by the number of the defined interface.

Examples for the activation of logging for COM 1:

[RS232LOG]

LOGCOM1=1

We recommend activating logging only for a short time, when problems occur. Active logging needs considerable computer performance. Additionally the log file needs a lot of memory within short time.



BLOCKWRITE

With an entry in the zenon.ini, block write can be activated. To activate it the entry BLOCKWRITE=1 has to be set in the section [OMR_FINS].

REDUNDANCY
Yes
RDA
-
REAL TIME STAMPING
No
P P O W S IN C
BROWSING
Is not supported by the driver.
ERROR TIMEOUT
No settings possible.
ACCESS METHODS
POLLING
Cyclical query of the variable, driver.
Cyclical quely of the variable, arriver.
SPONTANEOUS

SPONTANEOUS

-




11. Driver commands

This chapter describes standard functions that are valid for most zenon drivers. Not all functions described here are available for every driver. For example, a driver that does not, according to the data sheet, support a modem connection also does not have any modem functions.

Driver commands are used to influence drivers using zenon; start and stop for example. The engineering is implemented with the help of function <code>Driver</code> commands. To do this:

- create a new function
- ▶ select Variables -> Driver commands
- ▶ The dialog for configuration is opened

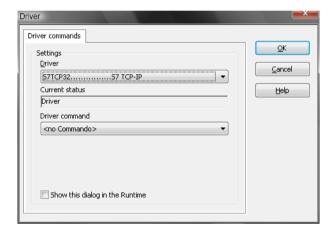

Parameters	Description
Drivers	Drop-down list with all drivers which are loaded in the project.
Current state	Fixed entry which has no function in the current version.
Driver commands	Drop-down list for the selection of the command.
> Start driver (online mode)	Driver is reinitialized and started.
<pre>Stop driver (offline mode)</pre>	Driver is stopped. No new data is accepted. Note: If the driver is in offline mode, all variables that were created for this driver receive the status switched off (OFF; Bit 20).
▶ Driver in simulation	Driver is set into simulation mode. The values of all variables of the driver are simulated by the



	mode	driver. No values from the connected hardware (e.g. PLC, bus system,) are displayed.
•	Driver in hardware mode	Driver is set into hardware mode. For the variables of the driver the values from the connected hardware (e.g. PLC, bus system,) are displayed.
•	Driver-specific command	Enter driver-specific commands. Opens input field in order to enter a command.
•	Activate driver write set value	Write set value to a driver is allowed.
•	Deactivate driver write set value	Write set value to a driver is prohibited.
•	Establish connection with modem	Establish connection (for modem drivers) Opens the input fields for the hardware address and for the telephone number.
•	Disconnect from modem	Terminate connection (for modem drivers)
	ow this dialog in the	The dialog is shown in Runtime so that changes can be made.

DRIVER COMMANDS IN THE NETWORK

If the computer, on which the driver command function is executed, is part of the zenon network, additional actions are carried out. A special network command is sent from the computer to the project server, which then executes the desired action on its driver. In addition, the Server sends the same driver command to the project standby. The standby also carries out the action on its driver.

This makes sure that Server and Standby are synchronized. This only works if the Server and the Standby both have a working and independent connection to the hardware.

12. Test

TESTED WITH THE FOLLOWING HARDWARE AND SOFTWARE

omron SYSMAC CJ1M /CPU11 (Programmable Controller)



TESTING ENVIRONMENT

Tested with serial interface (serial cable, no null modem cable, cable type: SYSMAC WAY), Parameter: 9600, 7, 2, even, no and TCP/IP connection with default port 9600. The IP-Address of the PLC can be set via Web-interface eg: . http://[IP-Address of the PLC\\/0 or via the DM memory area with serial connection (Offset: m = D30000 + (100 x unit number) + 98; in these 4 Bytes, the IP-Adresse is entered, which will be used by the PLC).

For details, please check the Omron Documentation 'W441E101_Ethernet+CPUs_Operation_Manual.pdf'.

LIMITATIONS

In our test, wrting on HR and AR was impossible. With the driver object type IR neither write nor read was possible.

13. Error analysis

Should there be communication problems, this chapter will assist you in finding out the error.

13.1 Analysis tool

All zenon modules such as Editor, Runtime, drivers, etc. write messages to a joint log file. To display them correctly and clearly, use the Diagnosis Viewer (main.chm::/12464.htm) program that was also installed with zenon. You can find it under *Start/All programs/zenon/Tools 7.00 -> Diagviewer*.

zenon driver log all errors in the log files. The default folder for the log files is subfolder Log in directory ProgramData, example: C:\ProgramData\zenon \zenon700\LOG for zenon version 7.00 SPO. Log files are text files with a special structure.

Attention: With the default settings, a driver only logs error information. With the <code>piagnosis</code> <code>viewer</code> you can enhance the diagnosis level for most of the drivers to "Debug" and "Deep Debug". With this the driver also logs all other important tasks and events.

In the Diagnosis Viewer you can also:



- follow currently created entries live
- customize the logging settings
- ▶ change the folder in which the log files are saved

Hints:

- 1. In Windows CE even errors are not logged per default due to performance reasons.
- 2. The Diagnosis Viewer displays all entries in UTC (coordinated world time) and not in local time.
- 3. The Diagnosis Viewer does not display all columns of a log file per default. To display more columns activate property Add all columns with entry in the context menu of the column header.
- 4. If you only use Error logging, the problem description is in column Error text. For other diagnosis level the description is in column General text.
- 5. For communication problems many drivers also log error numbers which the PLC assigns to them. They are displayed in Error text and/or Error code and/or Driver error parameter (1 and 2). Hints on the meaning of error codes can be found in the driver documentation and the protocol/PLC description.
- 6. At the end of your test set back the diagnosis level from Debug Or Deep Debug. At Debug and Deep Debug there are a great deal of data for logging which are saved to the hard drive and which can influence your system performance. They are still logged even after you close the Diagnosis Viewer.



Info

You can find further information on the Diagnosis Viewer in the Diagnose Viewer (main.chm::/12464.htm) chapter.



13.2 **Error numbers**

In case of communication problems an entry in the error log file of the driver is generated; here the error cause is stated with a number.



💡 Info

Refer to the FINS documentation section 5-1-3 "End Codes" for an explanation of the error numbers. Here all error numbers are documented.

13.3 **Check list**

- ▶ If the PLC is connected correctly (serial connection cable no null modem cable with serial connection) and the connection has been configured correct 9600,7,2,even,no)?
- ▶ Is the IP address of the PLC configured correctly (with connection via TCP/IP)? Can the PLC be contacted via the Web interface or with e.g. ping in the driver configuration/Conn. TCP/IP?
- Did you analyze the error file (up to zenon version 6.01) or the central log file (version zenon6.20 and higher)?