



COPADATA
do it your way

zenon manual

Standard recipes

v.7.11





©2014 Ing. Punzenberger COPA-DATA GmbH

All rights reserved.

Distribution and/or reproduction of this document or parts thereof in any form are permitted solely with the written permission of the company COPA-DATA. The technical data contained herein has been provided solely for informational purposes and is not legally binding. Subject to change, technical or otherwise.

Contents

1. Welcome to COPA-DATA help	4
2. Standard recipes.....	4
3. Engineering in the Editor.....	5
3.1 Context menu Project manager	5
3.2 Context menu detail view	6
3.3 Create Standard Recipe screen type	9
3.4 Create a new recipe	12
3.5 Adding variables to a recipe.....	12
3.6 Editing set values	14
3.6.1 Check write set value	14
3.7 Write recipes.....	16
4. Function screen switch standard recipe	16
4.1 Tab Recipe selection	17
4.2 Tab column settings	18
5. Operating during Runtime	19
5.1 Recipe - Functions	21
5.1.1 Single recipe	21
5.1.2 Standard recipe	25
5.2 Status information for recipes and Recipegroup Manager	29

1. Welcome to COPA-DATA help

GENERAL HELP

If you cannot find any information you require in this help chapter or can think of anything that you would like added, please send an email to documentation@copadata.com (<mailto:documentation@copadata.com>).

PROJECT SUPPORT

You can receive support for any real project you may have from our Support Team, who you can contact via email at support@copadata.com (<mailto:support@copadata.com>).

LICENSES AND MODULES

If you find that you need other modules or licenses, our staff will be happy to help you. Email sales@copadata.com (<mailto:sales@copadata.com>).

2. Standard recipes

Recipes collect set values and commands in a list which can be executed in the Runtime with the help of a function.

Recipes can be engineered either in the Editor or in the Runtime (with the help of screen **Recipe standard**).

A collection of several recipes is created and administrated with the help of the Recipegroup Manager.



License information

Part of the standard license of the Editor and Runtime.

PROJECT MANAGER CONTEXT MENU

Menu item	Action
Editor profile	Opens the drop-down list with predefined editor profiles.
Help	Opens online help.

3. Engineering in the Editor

3.1 Context menu Project manager

Menu item	Action
Recipe new	Creates a new recipe in the list and opens the name for editing.
Export XML all..	Exports all entries as an XML file.
Import XML	Imports from an XML file.
Import ASCII	Imports from an ASCII file.
Editor profile	Opens the drop-down list in which you can allocate an Editor profile.
Help	Opens online help.

3.2 Context menu detail view

TOOL BAR



Menu item	Action
Recipe new	Creates a new recipe in the list and opens the name for editing.
Create standard function	Opens the dialog for selecting a recipe and an action and creates a suitable function. The action is documented in the output window.
Add variable	Opens the dialog for selecting variables.
Jump back to starting element	If you entered the list via function linked elements , the symbol leads back to the start element. Only available in the context menu when all linked elements are opened.
Copy	Copies the selected entries to the clipboard.
Paste	Pastes the content from the clipboard. If an entry with the same name already exists, the content is pasted as "Copy of".
Delete	Deletes selected entries.
Move up	Moves the entry up one place in the recipe list.
Move down	Moves the entry down one place in the recipe list.
Edit set value	Activates cell Set value in order to insert a value.
Export selected XML	Exports selected entries as an XML file.
Import XML	Imports from an XML file.
Export selected ASCII	Exports selected entries as an ASCII file.
Import ASCII	Imports from an ASCII file.
Rename	Makes it possible to rename the selected recipe. It is also possible by left-clicking the field with the mouse or by pressing F2 .
Properties	Opens the property window.
Help	Opens online help.

CONTEXT MENU TREE IN DETAIL VIEW

Menu item	Action
Add variable	Opens the dialog for selecting variables.
Recipe new	Creates a new recipe in the list and opens the name for editing.

Create standard function	Opens the dialog for selecting a recipe and for the definition of the desired action
Copy	Copies the selected entries to the clipboard.
Paste	Pastes the content from the clipboard. If an entry with the same name already exists, the content is pasted as "Copy of".
Delete	Deletes selected entries.
Export selected XML	Exports selected entries as an XML file.
Import XML	Imports from an XML file.
Export selected ASCII	Exports selected entries as an ASCII file.
Import ASCII	Imports from an ASCII file.
Rename	Makes it possible to rename the selected recipe. It is also possible by left-clicking the field with the mouse or by pressing F2 .
Properties	Opens the property window.
Help	Opens online help.


CONTEXT MENU DETAILS

Menu item	Action
Add variable	Opens the dialog for selecting variables.
Delete variable	Deletes selected variable after a confirmation message.
Move up	Moves selected variable up on place.
Move down	Moves selected variable down on place.
Edit set value	Opens the cell with the set value in order to change it.
Remove filter	Removes all current filter settings.
Help	Opens online help.

3.3 Create Standard Recipe screen type

The handling of the recipes in the Runtime is realized with a screen of the screen type *Standard recipe*. This screen must be created in the editor first.

After the screen is opened an empty screen is displayed. You can add the default control elements via menu *Control elements ->Add template*. Changes that have been done successfully can be logged in the Chronological Event List.

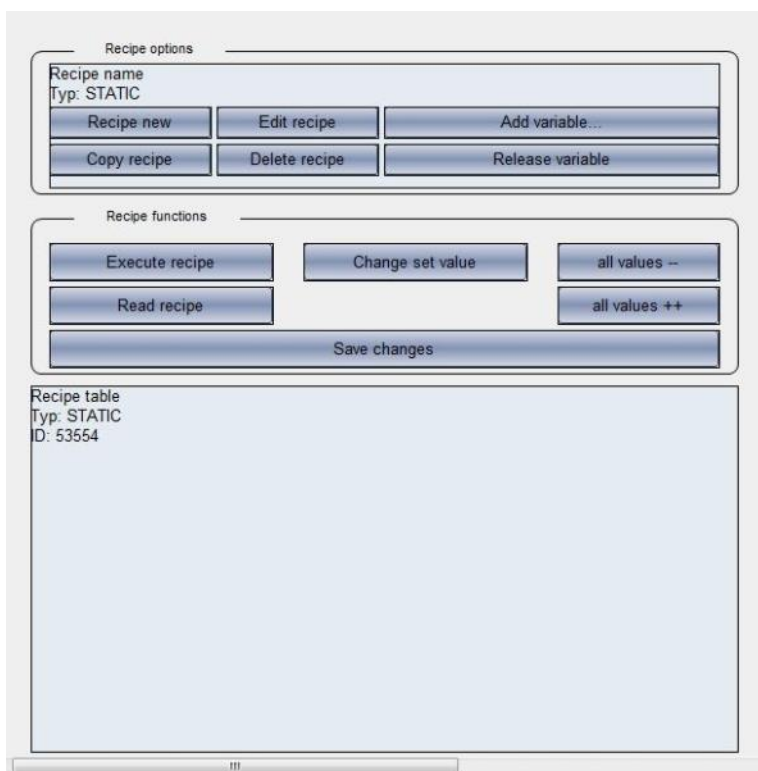

The screenshot shows the 'Standard recipe' screen interface. It features a light blue background with a white border. The interface is organized into three main sections:

- Recipe options:** This section is at the top and contains a text input field for 'Recipe name' and a label 'Typ: STATIC'. Below these are six buttons arranged in two rows: 'Recipe new', 'Edit recipe', 'Add variable...', 'Copy recipe', 'Delete recipe', and 'Release variable'.
- Recipe functions:** This section is in the middle and contains five buttons: 'Execute recipe', 'Change set value', 'all values --', 'Read recipe', and 'all values ++'. A 'Save changes' button is located at the bottom of this section.
- Recipe table:** This section is at the bottom and contains a large text area with the text 'Recipe table', 'Typ: STATIC', and 'ID: 53554'.

Parameters	Description
Insert template	<p>Opens the dialog for selecting a template for the screen type.</p> <p>Templates are shipped together with zenon and can also be created by the user.</p> <p>Templates add pre-defined control elements to pre-defined locations in the screen. Elements that are not necessary can also be removed individually once they have been created. Additional elements are selected from the drop-down list and placed in the screen. Elements can be moved in the screen and placed individually.</p>
Buttons	
Recipe new	Create a new recipe
Save recipe	Save current recipe under the same name
Read recipe	The values of the variables of the selected recipe are read from the process and entered into the table. Changes have to be saved!
Duplicate recipe	Copy current recipe.
Delete recipe	Delete current recipe
Edit recipe	Edit the current recipe.
Export Recipe	Save current recipe as *.txt
Import Recipe	Load current recipe from *.txt
Write recipe	The values of the variables of the selected recipe are written to the process as displayed in the table.
Next >	Move to the next recipe
Recipe >>	Move to the last recipe
Recipe <<	Move to the previous recipe
Recipe <	Move to the first recipe
All values ++	All values of the selected recipe are increased by 1
All value - -	All values of the selected recipe are decreased by 1
Add variable ...	Add a variable to the selected recipe It is also possible to use variables of other loaded projects.
Remove variable	Remove the selected variable from the recipe

Edit set value	<p>Change the value of the selected variable in the recipe A decimal value can be entered with a colon as well as with a point, the decimal point will automatically be changed to a point.</p> <p>Attention: If this element does not exist in the screen, the recipes in the list element are displayed read-only.</p>
General	
Recipe name	Name or selection of the current recipe
Recipe value list	Display of the current recipe in a table
Send progress	<p>Progress bar, indicating the writing of the recipe.</p> <p>The control element displays the progress bar from bottom to top or from left to right depending on the location and form of the element.</p> <p>The control element is hidden in the Runtime and is only displayed during the writing of the recipe.</p> <p>Note: The control element is only displayed if property <code>Write synchronously</code> is active.</p>

SYNCHRONOUS WRITING:

If property `Write synchronously` is active, the control element writing progress is displayed if a recipe is written to the control until the writing confirmation arrived at the recipe module. It does not matter whether the writing confirmation is positive or negative. If you want to react to a negative writing confirmation, you can do this with the help of a reaction matrix.



Information

Buttons can be protected with password and authorization level. For details see Operation in Runtime (on page 19) chapter.

3.4 Create a new recipe

In order to create a new recipe, select **New Recipe** from the context menu of the folder **Recipes / Standard recipes** in the Project manager. The newly created recipe is displayed in the detail view of the Project Manager. Further definitions are also realized in the Detail view.



3.5 Adding variables to a recipe

After creating a new recipe (on page 12) variables can be added to the recipe.



Attention

String variable cannot be written to the PLC with a standard recipe. For string variables use the Recipegroup Manager.

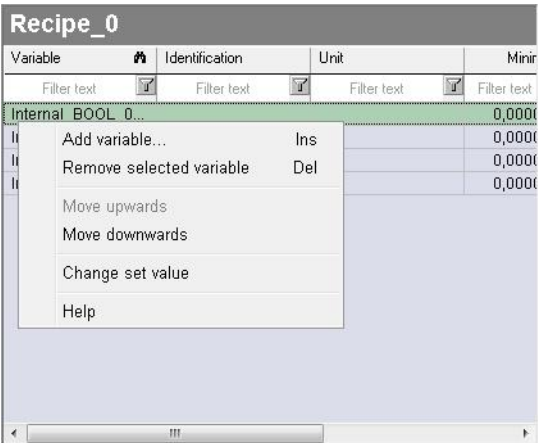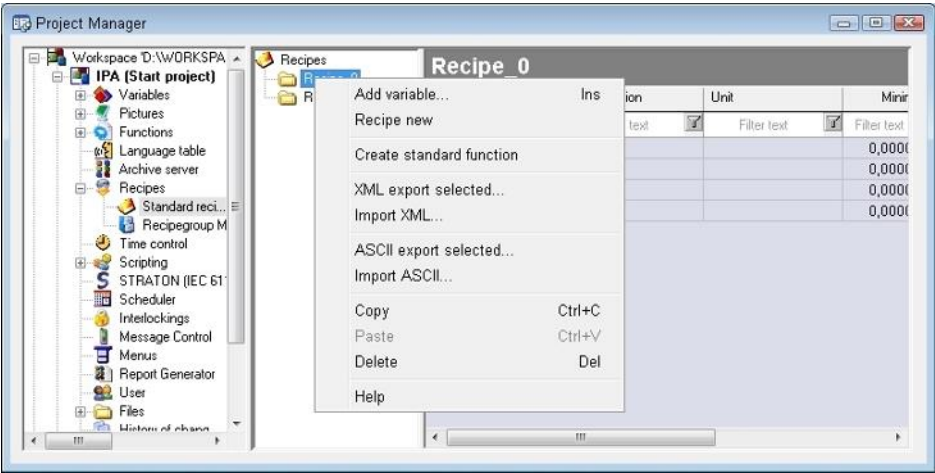

Variables are selected in the dialog 'Filter: Variable selection'. The variables are applied either by double clicking them or by clicking button **Add**. Multi-select is possible. Variables from loaded sub-projects can be used. All variables added to a recipe must not be read-only. If the definitions of variables are changed (scaling), also the defined values of the recipes are changed accordingly.



Information

A decimal value can be entered with a colon as well as with a point, the decimal point will automatically be changed to a point.

SORTING VARIABLES

You can sort variables any way you like:

Select the variable that you want to change the sequence of and choose one of the following actions:


- ▶ use arrow buttons in the lower right corner to move items
- ▶ choose "Up" or "Down" in the context menu

CONTEXT MENU VARIABLE VIEW

Parameters	Description
Add variable	Opens the dialog to select variables.
Delete variable	Deletes selected variables from the list after confirming a warning message.
Move up	Moves selected variable up on place.
Move down	Moves selected variable down on place.
Edit set value	Activates cell Set value and highlights the current set value.
Remove all filters	Removes all set filter.
Help	Opens online help.

3.6 Editing set values

In order to edit the set values of the variables you can either select **Edit set value** from the context menu or you can change it directly in the column set value. For the checking of the setpoint value the technical minimum and maximum values for each variable are displayed with it. Multi-select is available for deleting variables, but not for editing variables.

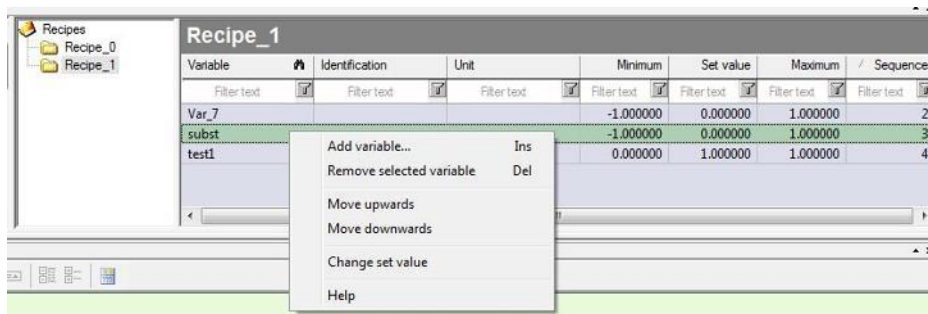

The variable '_LASTRECIPE' includes the name of the last executed standard recipe.

This allows to realize a recipe administration, as this variable at any time offers information, which recipe is active at the moment.

The variable '_LASTNEWRECIPE' includes the name of the last created standard recipe.

The variables "_LASTRECIPE" and "_LASTNEWRECIPE" can be based on any driver and must be writeable.



Attention

Exceptions:

The Variable "_LASTRECIPE" cannot be realized with the Standard System Driver.

The Variable "_LASTRECIPE" cannot be realized with the Standard System Driver.

3.6.1 Check write set value

When writing values, the value receives a status bit that has been written. If the writing process is successful, the corresponding status bit is set:

► WR-ACK

The driver received a value for writing.

► WR-SUC

Value 1: Writing successful.

Value 0: Writing not successful. The value could not be written.



Information

In case of reload or Server-Standby switch, the currently active responses or writing affirmations are discarded.

This status combination are active until the next value change is triggered. Then both states are set to 0 until the writing action is finished. For evaluation the following bit combination must be requested in the reaction matrix:

WR-ACK, WR-SUC

Result:

- WR-ACK 1, WR-SUC 1: Writing action successful.
- WR-ACK 1, WR-SUC 0: Writing action not successful.



Attention

The mechanism only shows, that the writing action was successful (or not successful) to the PLC. This does not mean, that the value has indeed been changed in the PLC, since the PLC can reset/overwrite the value immediately. (For example for writing the outputs or the transient bits which are only set for a short time.)

MODULES

This mechanism can be used in the following modules:

- **function Write set value:** Activate option `Wait for writing confirmation` in the configuration dialog of the function.
- **Standard recipes** (on page 14): Activate property `Write synchronously` .
- **Recipegroup Manager:** Activate property `Write synchronously`.

- ▶ Command

ENTRY IN CEL

- ▶ Function Write set value

For the entry in the CEL you must activate property `Function Set SV` in node `Chronological Event List` in the project settings. After this the positive or negative response the execution of the function is written to the CEL.

- ▶ Standard recipes and Recipegroup Manager

For the entry in the CEL a system driver variable is used which is set to 1 when a recipe is written successfully. A global variable is evaluated on the Server, a local variable on every Client in order to determine when the recipe executed last was written completely. With this variables a CEL entry can be created via limit or reaction matrix. The query is carried out via a multi analog or a multi binary reaction matrix.

3.7 Write recipes

The execution of the recipe can happen:

- ▶ in the Runtime via a button in screen `Recipe standard` (on page 25),
- ▶ via calling up a function engineered in the Editor for the recipe execution via:
 - Script (e.g. AUTOSTART-Script)
 - Variable status
 - Dynamic screen element e.g. Button


4. Function screen switch standard recipe

Function screen switch to a standard recipe makes it possible to call up a screen of type standard recipe in the Runtime.

To engineer the function:

1. create a new function
2. select screen switch
3. select the deleted screen of type `Standard recipe` (on page 25)
4. the filter dialog opens for
 - Recipe selection (on page 17)
 - Column settings (on page 18)
5. define `recipe` and `column settings`
6. Close the dialog by clicking on `OK`


4.1 Tab Recipe selection

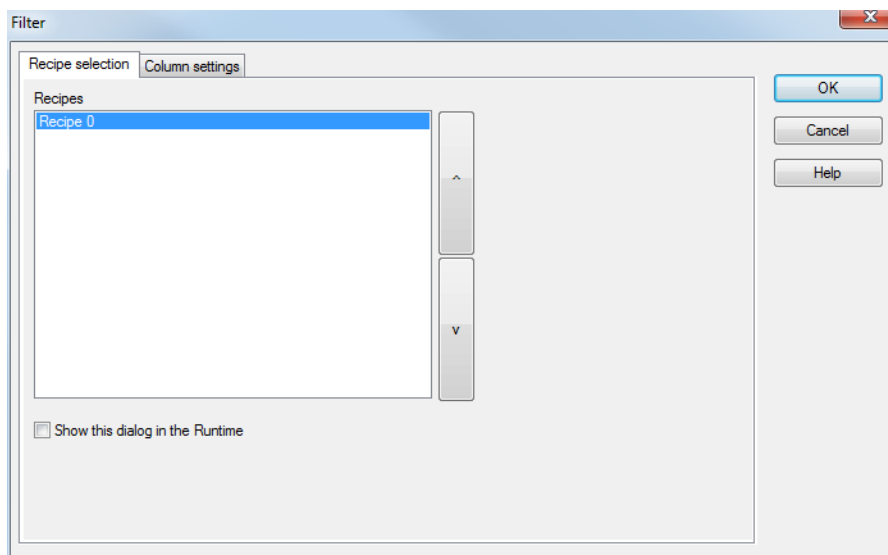

Parameters	Description
Recipes	Selection of the recipe which should be displayed when the screen is called up.
Show this dialog in the Runtime	<p>active: In the Runtime this dialog is displayed at the screen switch. The selected recipe can be changed.</p> <p>inactive: The screen is opened with the recipe defined in the Editor. No possibility for change in the Runtime.</p>

4.2 Tab column settings

Here you define which columns are displayed in what form in the list field.

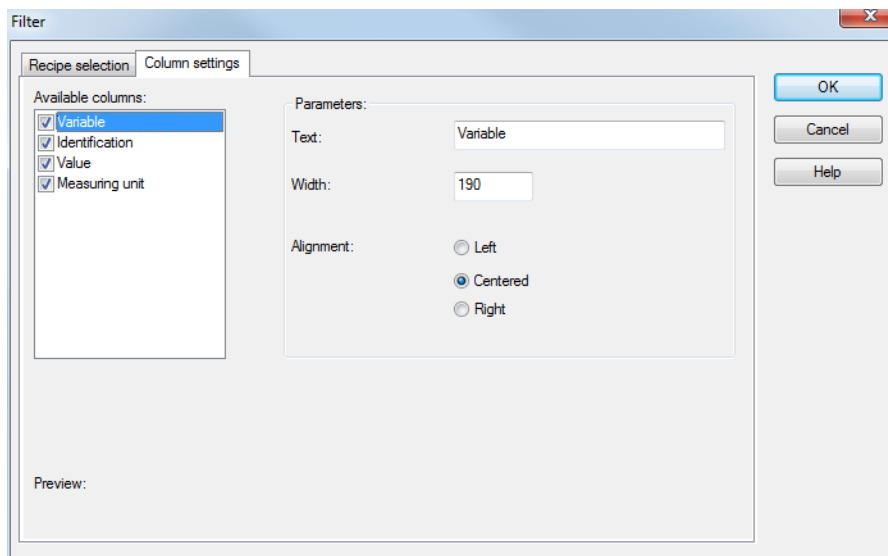


Parameters	Description
Available columns	Definition of the columns displayed in the Runtime.
Parameters	Definition of the properties for highlighted columns.
Labeling:	Label of the columns in the Runtime.
Width:	Width of the column in pixels.
Alignment:	Text alignment of the column.

5. Operating during Runtime

In online operation the following functions are available for script use:

Parameters	Description
Single recipe direct (on page 21)	Direct despatch of the activated recipe
Single recipe with offline dialog (on page 21)	Changing of the parameters of the activated recipe
Single recipe with online dialog (on page 21)	Selection of a recipe and changing of its parameters

By using the function Recipe single with offline dialog (on page 21) the recipe mask is opened.

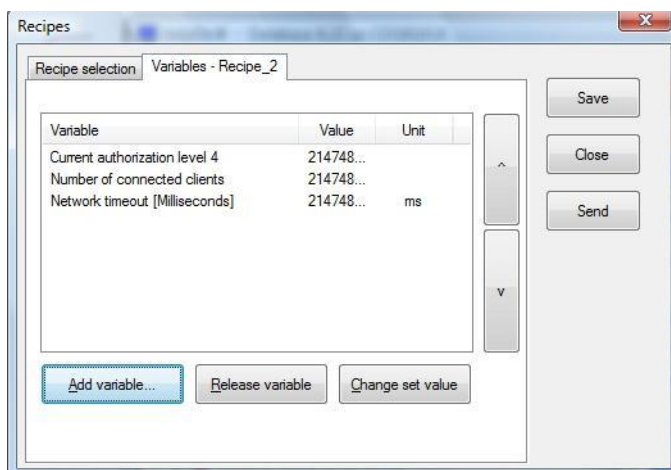

The control buttons are:

Parameters	Description
Save	Save changes in the recipe
Close	Close recipe settings.
Send	Send recipe to the hardware with the current parameters.
Add variable	Add new variable with the variables list.
Release variable	Temporary deletion of the selected variable from the recipe (permanently deleted if recipe is saved).
Edit set value	<p>Change set value of selected variable.</p> <p>A decimal value can be entered with a colon as well as with a point, the decimal point will automatically be changed to a point.</p> <p>Attention: If this element does not exist in the screen, the recipes in the list element are displayed read-only.</p>

By using the function Recipe single with online dialog (on page 21), the recipe and the parameters of the recipe can be selected and changed. The recipe selection is opened. The operation is similar to the parametrization in the Editor with the exception that recipes cannot be deleted.



Information

In case of reload or Server-Standby Switch, the present responses or writing affirmations are distorted.

You will find more information on changed Runtime files in the chapter Project and Workspace / RT changeable files.

AUTHORIZATION IN RUNTIME

Actions in the Runtime can be protected with password and authorization level:

- ▶ When recipes are deleted, saved, changed or duplicated, the logged in user has to fulfil the authorization requirements that have been set in the authorization level section of the recipe. If the user does not fulfill the authorization requirements, the function is not executed.
- ▶ At password-protected button **change set value** the value in the list can only be changed if the user has the respective authorization level. If this is not the case the dialog for login is opened for active temporary login as soon as a column for changing a value is clicked.

- ▶ If button **Save changes** is protected with a password and the user does not have the necessary authorization level, the dialog for temporary login is opened after a recipe change when the dialog is closed in order to make saving of the changes possible.

5.1 Recipe - Functions

In order to allow operation in the Runtime, the according recipe functions have to be created.

When the standard function is created from the context menu in the detail view, zenon automatically creates a function `Standard recipe` for the selected recipe.

5.1.1 Single recipe


The individual recipe functions are available in three versions:

- ▶ Single recipe direct
- ▶ Single recipe with offline dialog
- ▶ Single recipe with online dialog

SINGLE RECIPE DIRECT

This function is used to execute a defined recipe in the Runtime. In a recipe only process variables of one driver can be selected.

Give the recipe as a transfer parameter. This function is configured via an input dialog.

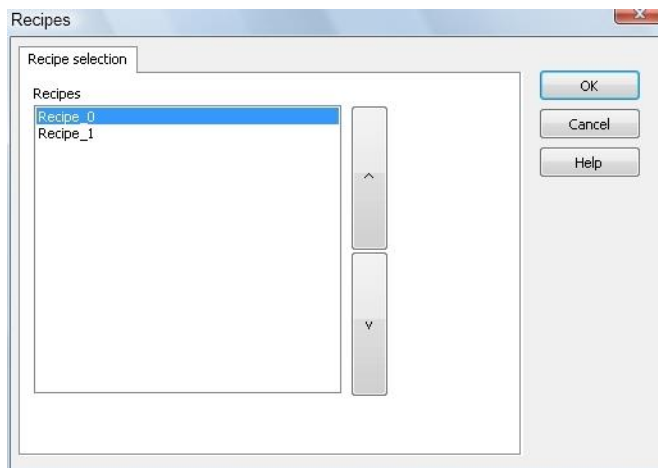


SINGLE RECIPE WITH OFFLINE DIALOG

This function is used to change a defined recipe, before it is executed in the Runtime (set value change).

Give the recipe as a transfer parameter. This function is configured via an input dialog.

The new recipe is available in the recipe list.

Only the set value setting of the recipe is activated during online operation.

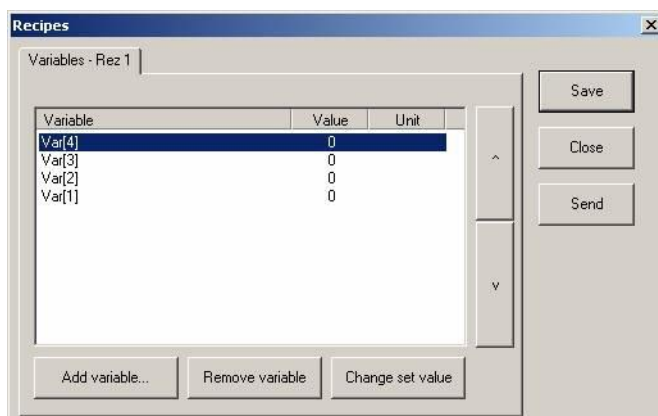

Possible operations in Editor and Runtime are:


Parameters	Description
Add variable	add a new variable to the recipe
Release variable	remove a variable from the recipe
Edit set value	change the values of the recipe

SINGLE RECIPE WITH ONLINE DIALOG

This function is used to select and change a recipe before it is issued during online operation (change of set value).

Give the recipe as the transfer parameter. This function is configured via an input dialog.


In the Runtime the recipe selection is opened.

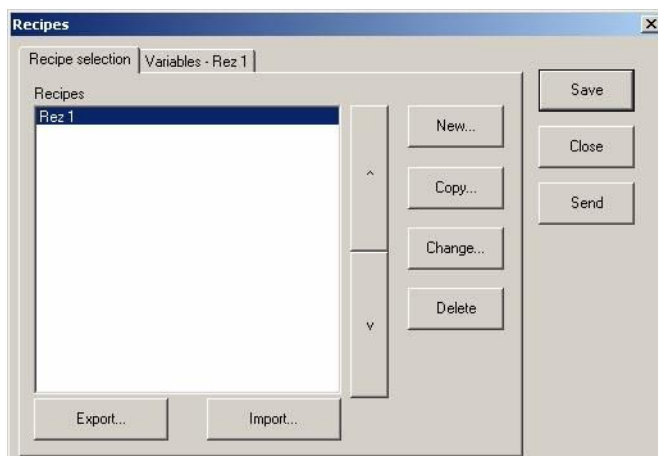

Configurable entries are

TAG	Description
New	create a new recipe
Copy	copy selected recipe and save it under a new name
Change	Change the name of the selected recipe
Delete	delete selected recipe

The new recipe is available in the recipe list.

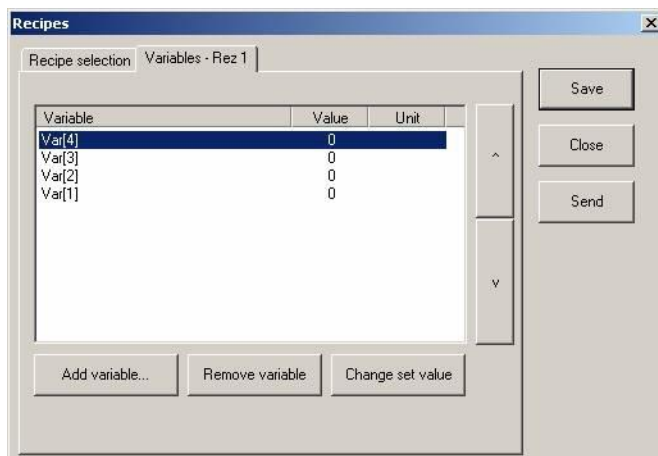

Configurable options are:

Add variable	add a new variable to the recipe
Release variable	remove a variable from the recipe
Edit set value	change the values of the recipe

In order to prevent changes to the recipe entries and at the same time permit selection of the individual recipes during online operation, make an entry in the `zenon6.ini` file.

[FUNKTIONEN]	
REZEPT__AENDERN=	0: change not permitted 1: 1: change permitted (default)


5.1.2 Standard recipe

With this function an existing recipe can be executed, read from the hardware or exported in the Runtime. Additionally new recipes can be imported or created with the current values from the hardware.

To create the function:


1. create a new function
2. in the **Recipes** node, select the **Display menu** function
3. the dialog for the recipe selection is opened
4. on tab **Recipe selection** select the recipe which should be called up
5. on tab **Action to be executed** you define the action which should be carried out in the Runtime

RECIPE SELECTION

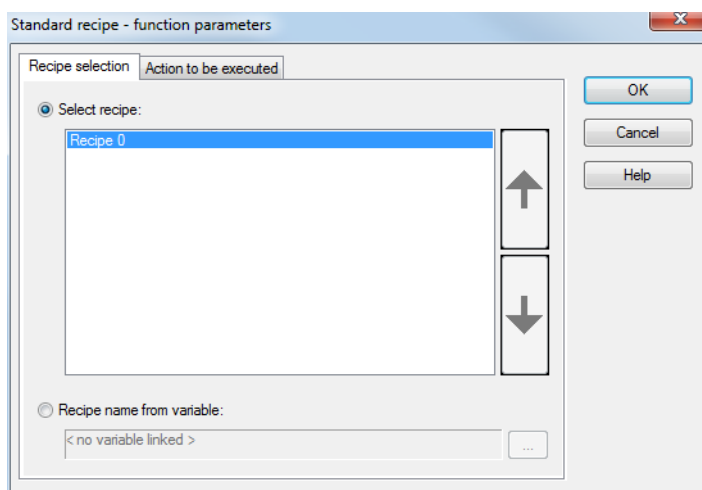


TAG	Description
Select recipe	Selection of the recipe that should be read or written
Recipe name from variable	<p>The name of the recipe that should be read or written is given by the selected variable.</p> <p>Attention: In the Runtime the string variable has to contain a valid recipe name e.g. Recipe_4 before execution. Otherwise the function will not be executed.</p>

ACTION TO BE EXECUTED

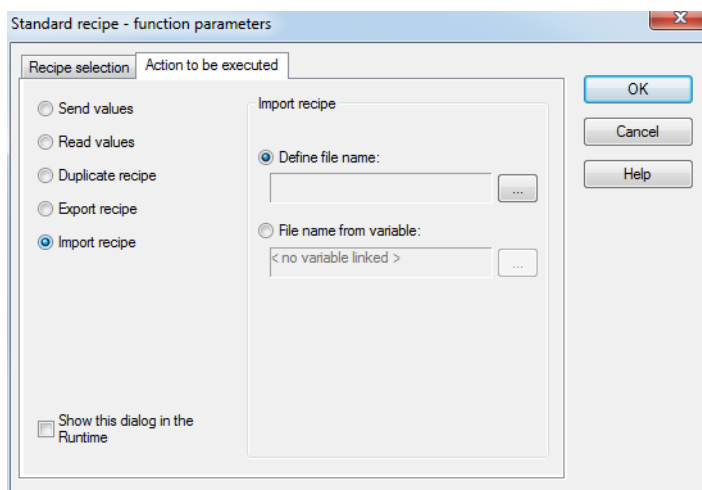


TAG	Description
Write values	The values of the variables of the selected recipe are written to the PLC.
Read values	The values of the variables of the selected recipe are read from the PLC and replace the current values in the recipe.
Duplicate Recipe	The source recipe creates a copy of itself with the name of the target recipe. The name of the duplicated recipe is not stored in the variable <code>_LASTNEWRECIPE</code> . For details about configuration see chapter Duplicate recipe .
Export Recipe	Exports recipe. For details about configuration see chapter Export recipe .
Import Recipe	Imports recipes from file or variable. For details about configuration see chapter Import recipe .
Show this dialog in the Runtime	Offer dialog in the Runtime in order to change settings.

DUPLICATE RECIPE

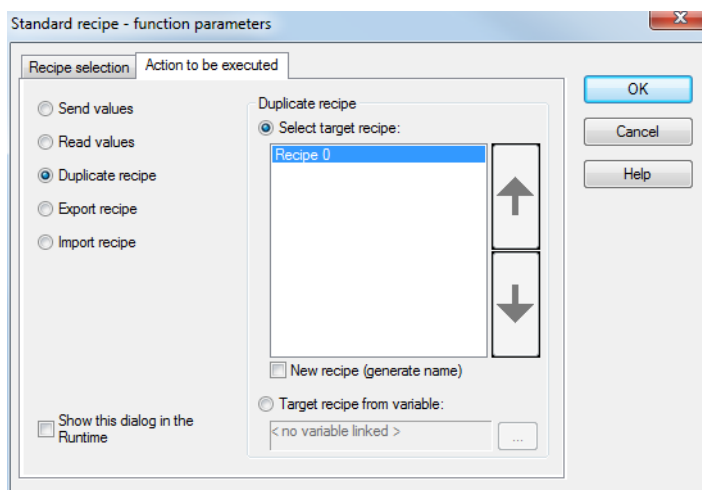


TAG	Description
Select target recipe	Selection of an existing recipe, which should be overwritten with the data of the source recipe. Attention: The data of the target recipe are overwritten.
New Recipe (Generate name)	A new recipe is created according to the standard syntax. With this gaps in the recipe order are filled up automatically. Example: Recipe_0 and Recipe_2 already exist. Duplicating the first time creates a recipe with the name Recipe_1. Duplicating a second time creates a recipe with the name Recipe_3.
Target recipe from variable	The name of the target recipe is defined by the contents of a string variable. Note: If the string variable of the target recipe does not contain text, a recipe name is given automatically.

EXPORT RECIPE

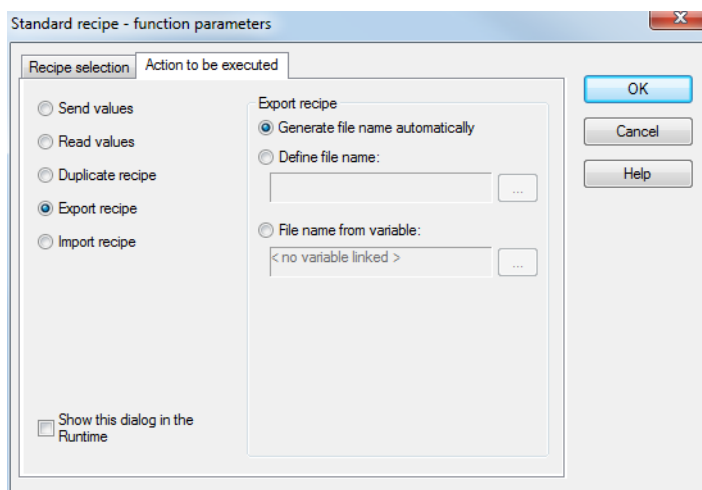

TAG	Description
Generate file name automatically	The filename is created automatically.
Define file name	Click on the ... button to open the dialog to select a folder and give it a name.
File name from variable	The name of the file is defined by the contents of a string variable.

IMPORT RECIPE

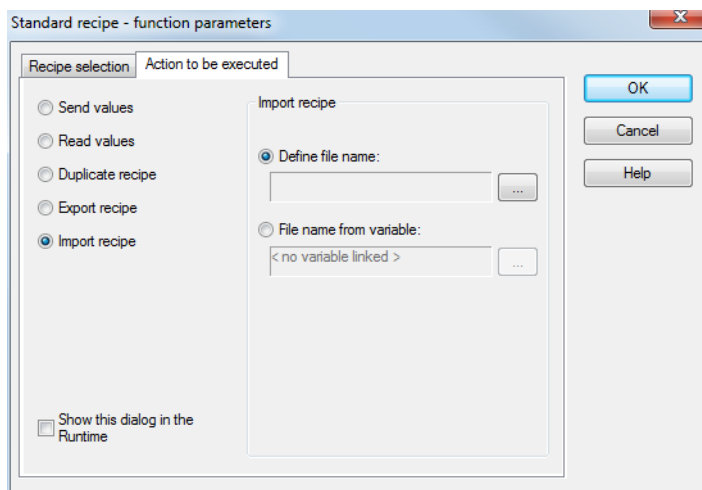

TAG	Description
Define file name	Click on the ... button to open the dialog to select a folder and a file.
File name from variable	Recipe is imported from linked variable

5.2 Status information for recipes and Recipegroup Manager

In the Runtime status information is provided at

- ▶ Read/write
- ▶ Export/Import

- and Save

If a recipe written, this variable contains the result of the writing operation.

VALUES

WRITE RECIPE

System driver variable **Standard recipe/RGM recipe completely written**

Value	Result
0	Send initialization value before the recipe
1	Write completed successfully
2	Write not executed because of a parameter error
3	Write not completed successfully
4	Wait for ready
5	Write terminated because RT is being ended
6	Timeout occurred

Note: If the network functionality is active in the project, the system driver variable **Standard recipe/RGM recipe completely written (local)** is relevant for the function executed on the local computer.



Information

Writing means writing to the driver. The driver then transfers the recipe to the control.

That means:

- Property `Write synchronously inactive`: Value 1 for **Standard recipe/RGM recipe written completely** does not mean that the values are available in the control. They are written on the driver.
- Property `Write synchronously aktiv`: The value change take place when all values on the control are topical.

Note: *The progress display at writing is only display if property `Write synchronously` is active.*

RECIPE IN PROGRESS

System driver variable `standard_recipe/RGM_recipe_function_in_progress`

Value	Result
-1	is being executed
0	Initialization value read successfully
1	User has no authorization
2	no authorization in the network
3	cancel by user
4	Error - could not read everything successfully, e.g. <ul style="list-style-type: none"> ▶ Communication with the hardware is interrupted before read was started ▶ a data block is not available on the PLC ▶ Error during transmission
5	Error during save of the recipe file

SCREEN TYPE SPECIFIC FUNCTIONS

During

- ▶ reading (system driver variable: `standard_recipe/RGM_recipe_reading_all_values_finished`)
- ▶ Exporting/Importing and
- ▶ Saving

of a recipe via screen specific function - the following values are available:

Value	Result
0	Initialization value waits for response from driver
1	read successfully
2	Error during Read, Export/Import or Save: <ul style="list-style-type: none">▶ Communication with the hardware is interrupted before read was started▶ a data block is not available on the PLC▶ Error during transmission