

# zenon manual

**Industrial Maintenance Manager (IMM)** 





©2015 Ing. Punzenberger COPA-DATA GmbH

All rights reserved.

Distribution and/or reproduction of this document or parts thereof in any form are permitted solely with the written permission of the company COPA-DATA. Technical data is only used for product description and are not guaranteed qualities in the legal sense. Subject to change, technical or otherwise.



## **Contents**

| 1.  | welc                                 | come to COPA-DATA help            |            |  |  |
|-----|--------------------------------------|-----------------------------------|------------|--|--|
| 2.  | Industrial Maintenance Manager (IMM) |                                   |            |  |  |
| ۷.  | iiiuus                               | Strial Maintenance Manager (IMIM) |            |  |  |
| 3.  | Functionalities                      |                                   |            |  |  |
| 4.  | Limit                                | tations                           | 5          |  |  |
| 5.  | Prepa                                | aratory works                     | 6          |  |  |
|     | 5.1                                  | Database                          | 6          |  |  |
|     | 5.2                                  | Engineering                       | 6          |  |  |
| 6.  | Creat                                | ting a screen of the type IMM     | <b>1</b> 1 |  |  |
|     | 6.1                                  | Display during Runtime            | 14         |  |  |
|     |                                      | 6.1.1 Left side: Tree             | 14         |  |  |
|     |                                      | 6.1.2 Right side: List            | 15         |  |  |
| 7.  | Main                                 | ntenance task                     | 23         |  |  |
|     | 7.1                                  | Period                            | 24         |  |  |
|     | 7.2                                  | Hours and operations counter      | 24         |  |  |
| 8.  | Data                                 | input                             | 25         |  |  |
| 9.  | Integ                                | gration in the process            | 25         |  |  |
| 10  | Onor                                 | rating during Runtime             | 21         |  |  |
| 10. | . Oper                               | ating during funtime              | Z3         |  |  |
| 11. | . Funct                              | tions                             | 26         |  |  |
|     | 11.1                                 | Screen switch                     | 26         |  |  |
|     |                                      | 11.1.1 Master data                | 26         |  |  |
|     |                                      | 11.1.2 Maintenance tasks          | 28         |  |  |
|     |                                      | 11.1.3 History                    | 29         |  |  |
|     | 11 2                                 | Determine onen maintenances       | 21         |  |  |



## 1. Welcome to COPA-DATA help

#### **GENERAL HELP**

If you cannot find any information you require in this help chapter or can think of anything that you would like added, please send an email to documentation@copadata.com (mailto:documentation@copadata.com).

#### **PROJECT SUPPORT**

You can receive support for any real project you may have from our Support Team, who you can contact via email at support@copadata.com (mailto:support@copadata.com).

#### **LICENSES AND MODULES**

If you find that you need other modules or licenses, our staff will be happy to help you. Email sales@copadata.com (mailto:sales@copadata.com).

## 2. Industrial Maintenance Manager (IMM)

The Industrial Maintenance Manager (IMM) administers machine and maintenance data. Service intervals can comfortably be planned and administered. You can see at a glance which device, equipment, machine, etc. has to be maintained today / this week / next month etc. Additionally service work done in the past is logged.



#### License information

Must be licensed for Editor and Runtime (single-user, Server, Standby and Client).



## 3. Functionalities

- ▶ Devices can be copied and pasted; a consecutive number is added to the device name.
- ► The list view can be adjusted in the screen filter. Column selection, column width, column name and their order can be modified.
- ▶ Every list view can be displayed and printed as an HTML file via Stylesheet.
- ▶ The equipment identifier can only be created via the context menu in the tree.
- ▶ Multi-hierarchic equipment identifiers
- ▶ Devices can be created via the context menu in the tree or in the list, provided that an equipment was selected in the tree. This equipment is then automatically inserted in the device as equipment identifier.
- ▶ By clicking on the column button, the elements are sorted alphabetically.
- ► Multi-project capable
- ▶ Server-Client
- ▶ Deleting devices is subject to a userlevel, which allows to ways of deleting. On the one hand, deleting in the sense that data is retained in the database and history entries are not lost. For this method, the flag ACTIVE in the database is set to 0. Alternatively, a complete and final deletion: all data from the database, including the maintenance tasks and the history, are deleted.
- ► The checkboxes in the tree view for the equipment identifiers are a filter. If they are set, only devices, history entries and maintenance tasks belonging to this equipment identifier are displayed.

## 4. Limitations

The module stores all data in a Microsoft SQL Server database (SQL Server 2000 and higher). The MS SQL Server is not included in zenon. However, you can use the SQL Server Express Edition which is installed with the zenon Editor.

Other SQL servers like Oracle are not supported.



## 5. Preparatory works

## 5.1 Database

Creating an own database.



Start a new instance of the command prompt (cmd.exe).

Start the service program osql.exe.

osql.exe-E-S computer name / instance name

Instructions for creating a database

1> CREATE DATABASE database name

#### 2> GO

```
Database name any name for the database. e.g.: Maintenance
```

Close the service program osql.exe with 'exit'.

```
C:\WINDOWS\system32\cmd.exe

C:\Program Files\Microsoft SQL Server\80\Tools\Binn>osql.exe -E -S SUPP_TEST_16__A

XP.XZENON

1) CREATE DATABASE Maintenance
2) GO
The CREATE DATABASE process is allocating 0.63 MB on disk 'Maintenance'.
The CREATE DATABASE process is allocating 0.49 MB on disk 'Maintenance'.
1) exit

C:\Program Files\Microsoft SQL Server\80\Tools\Binn>_
```

## 5.2 Engineering

Four tables are created in the database. The names of the tables are issued and fixed and correspond to the names that are used in the measuring point administration:



▶ Table for devices: Devices

▶ Table for maint. works: MaintenanceWorks

▶ Table for history: MaintenanceHistory


▶ Table for documents: Documents

### **DATABASE CONNECTION**

In the project properties, the ODBC string can be manually edited in the **Industrial Maintenance Manager** node by means of the **Database** property. Clicking on the ... button opens the dialog for configuration.




New... Click on this button to add a new file data source.

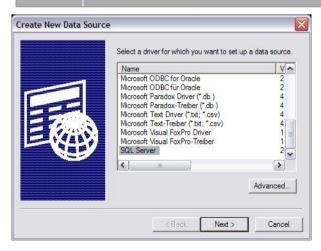




In the dialog field 'Create new data source' select the driver sqL server and click on Next in order to enter the name or the storage place of the new DSN file.

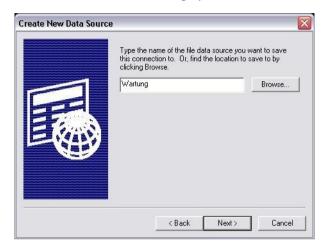

Again, click on Next'to display a summary of the new information.




Click on Finish to open the driver specific setup dialog.

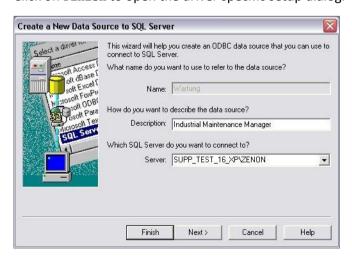




If you select a server name from the list, no further configuration settings are necessary.

Again click on Next.

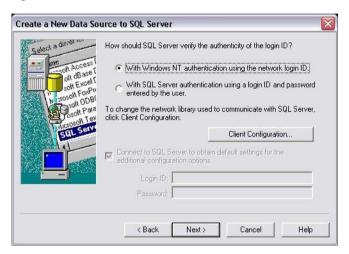


### Again click on Next.

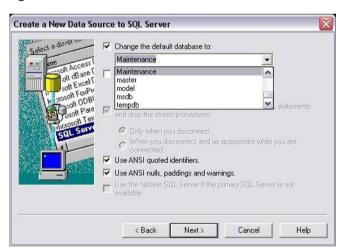



Now you can select the previously created database.

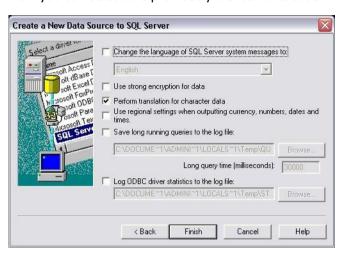


#### Click on Finish.





Now you can test the selected connection.







## 6. Creating a screen of the type IMM

To create a screen of type IMM:



- 1. create a new screen
- 2. as screen type select Industrial Maintenance Manger (IMM) from the drop-down list
- 3. Select Add template in the control element menu
- 4. The standard elements are inserted
- 5. Select additional elements as required and insert them into the desired place on the screen
- 6. Create a screen switch function (on page 26) in order to be able to call up the screen in Runtime






| Parameters                  | Description  |
|-----------------------------|--|
| Insert template             | Opens the dialog for selecting a template for the screen type.   |
|                             | Templates are shipped together with zenon and can also be created by the user.   |
|                             | Templates add pre-defined control elements to pre-defined locations in the screen. Elements that are not necessary can also be removed individually once they have been created. Additional elements are selected from the drop-down list and palced in the screen. Elements can be moved in the screen and placed individually. |
| List                        | List (on page 14) of processes which are displayed in the Runtime.   |
| List functions              | Control elements to control the list.  |
| Filter                      | Applies filter.  |
| New equipment identifier    | Creates a new equipment identifier.  |
| Delete equipment identifier | Deletes selected equipment identifier.   |
| Device                      | Control elements for devices.  |
| ▶ New                       | Adds a new device.   |
| ▶ Edit                      | Makes it possible to edit the selected device.   |
| <pre>Delete</pre>           | Deletes device.  |
| Mark as inactive            | Switches device to inactive.   |
| Replace                     | Carries out device exchange.   |
| Сору                        | Copies selected element to the clipboard.  |
| Paste                       | Pastes the selected element from the clipboard.  |
| Change counter              | Carries out counter exchange.  |
| Edit maintenance            | Makes it possible to edit a maintenance.   |
| Execute maintenance         | Switches to carry out maintenance.   |
| Execute repair              | Switches to carry out repair.  |
| Print list                  | Prints out list.   |
| Print details               | Prints out details.  |
| Refresh                     | Refreshes view.  |
| Filter profiles             | Buttons for filter settings in Runtime.  |
| Profile selection           | Select profile from list.  |
| Save                        | Saves current setting as a profile.  |
| Delete                      | Deletes selected profile.  |
| Import                      | Imports filter profiles from export file.  |
| Export                      | Exports filter profiles in the file.   |



## 6.1 Display during Runtime

If you call up (on page 26) a screen of type IMM (on page 11) during Runtime, it is displayed divided in two areas.

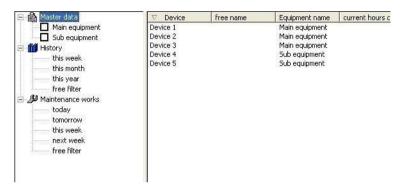

## 6.1.1 Left side: Tree



| Parameters        | Description   |
|-------------------|---|
| Master data       | The equipment identifications are used as nodes. These nodes have a checkbox to limit the selection. This selection defines the output in the list. In the master data, the maintenance tasks and the history only data belonging to the selected equipments are displayed. |
|                   | Note: Devices from the list can be moved to other equipment by means of Drag&Drop.  |
| History           | Here the history data is filtered on periods of time. With free filter a dialog for the selection of any period of time is opened.  |
| Maintenance tasks | Here the 'current' maintenance tasks are filtered on periods of time. With free filter a dialog for the selection of any period of time is opened.  |



## 6.1.2 Right side: List

Here the selection from the tree view is displayed as a list. The list can be sorted ascending or descending on any column. Additionally there is a context menu in this view, which offers different functions depending on the selection in the tree view.

### **SELECTION MASTER DATA**






| Command             | Description  |
|---------------------|--|
| Device new          | Under New device new master data can be created. The definition is done in a dialog with three tabs. On the first page the data for the device is entered. On the page 'Maintenance tasks' any number of maintenance tasks for this device can be created. For an overview the titles of the maintenance tasks are displayed in a list on this page. On the last page any number of documents can be assigned to the device. For an overview these are displayed in a list similar to the maintenance tasks. On doubleclicking a document the according document is opened, if the according program is installed. |
|                     | Note: Devices can be moved to other equipment in the master data by means of Drag&Drop.  |
| Edit device         | Similar to 'New device' with the only difference, that the fields are filled with the existing data. A device has to be selected.  |
| Device<br>exchange  | The variables for operations and hours counters are changed here! The calculation for scheduling maintenances is based on these variables. If a device exchange is performed, a history entry is made. Additionally, the maintenance interval is reset and the new variable values are used as the initial values for the calculation of maintenances.   |
|                     | The device data stays the same, only the linked variables are exchanged. These have to be entered in a dialog. If the variable does not exist, a warning is displayed, that in the moment no valid variables are linked with the device.   |
| Counter<br>exchange | If a counter is exchanged, the variable stays the same, but the counter reading (variable value) is changed. If a counter is exchanged, a history entry is made. You can choose whether the maintenance interval should be reset or not.   |
|                     | A new start value for the exchanged device can be entered.   |
| Delete device       | The selected device can be deleted. All associated data (maintenance tasks, history data and documents) are deleted. For security reasons the user is asked again, if the data should really be deleted.   |

### **ENTER MASTER DATA**



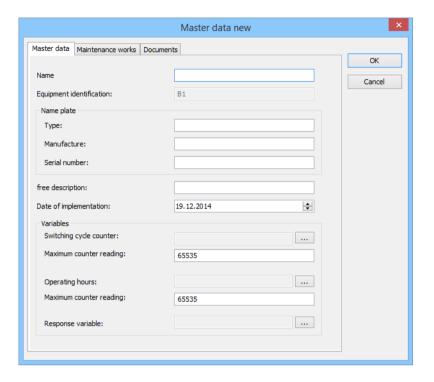




| Parameters                      | Description  |
|---------------------------------|--|
| Name                            | Name of the device.  |
| <b>Equipment identification</b> | Display of equipment identification.   |
| Name plate                      | Name plate data:   |
|                                 | <b>→</b> Type  |
|                                 | <b>Manufacture</b>   |
|                                 | ▶ Serial number  |
| Free description:               | Input field for free description.  |
| Date of implementation          | Entry of the date of putting into operation.   |
| Variables                       | Configuration of the variables.  |
| Switching cycle counter         | Selection of the variables for the switching cycle counter.  |
|                                 | Click on button in order to open the dialog for selecting a variable.  |
| Max. counter content            | Maximum permitted counter status.  |
| Operating hours                 | Assignment of the variables for the operating hours.   |
|                                 | Click on button in order to open the dialog for selecting a variable.  |
| Max. counter content            | Maximum permitted counter status.  |
| Response variable               | After maintenance work has been carried out, the value defined here is written to the linked variable. Click on button in order to open the dialog for selecting a variable. |

## **CONFIGURE MAINTENANCE WORK**




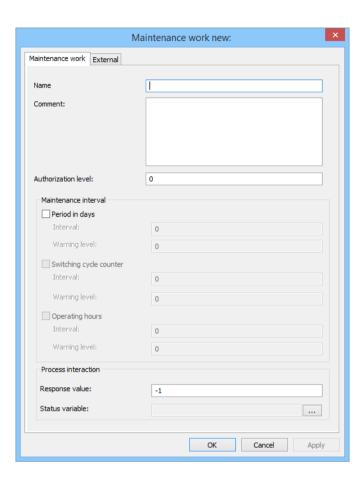



| Parameters                 | Description   |
|----------------------------|---|
| Name                       | Name for job.   |
| Comment                    | Comments about the job.   |
|                            | Note: You can create a line break via shortcut Ctrl+Return.   |
| Authorization level        | Entry of the authorization levels that are required for execution.  |
| Maintenance interval       | Configuration of the maintenance interval for:  |
|                            | ▶ Period in days  |
|                            | Switching cycle counter   |
|                            | Operating hours   |
| <b>Process interaction</b> | Properties for interaction.   |
| Return value               | Value that is written after maintenance work has been carried out on the device linked to the response variable.                |
| Status variable            | Variable that displays the status of the maintenance work.  |
|                            | ▶ 0: Maintenance not due  |
|                            | ▶ 1: Maintenance due  |
|                            | Click on button in order to open the dialog for selecting a variable.   |
|                            | The variable is written when updating the IMM screen as well as when executing the <b>Determine open maintenances</b> function. |

## **EDIT DATA**

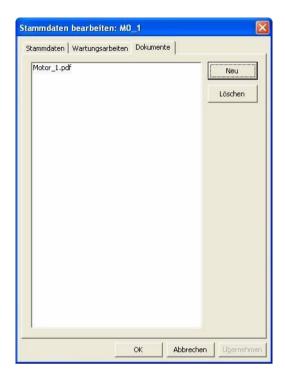

## The following access to files is supported:


| Local drives     | Local harddisk                          |
|------------------|---|
| UNC path         | e.g.\\Server name\release name          |
| Connected drives | Released harddisk of a network computer |

#### A

### Attention

Requirement: To be able to display the documents, you must install an apropriated viewer. e.g. Adobe Acrobat Reader for .pdf files.

### Device exchange






### Counter exchange




#### Selection maintenance tasks



By doubleclicking a maintenance task the data of this maintenance task are displayed. But the data cannot be changed.



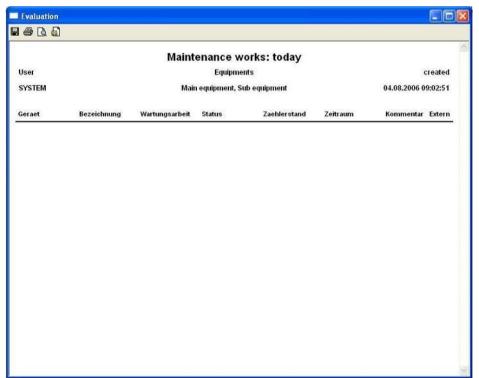



The displayed list is written to am XML file as it is and displayed in a HTML browser with a stylesheet. This HTML file then can be saved or directly printed.

| Print details       | The data for the selected maintenance task are output.  |
|---------------------|---|
| Edit maintenance    | Here the data of the selected maintenance task can be edited.   |
| Execute maintenance | If a maintenance is executed, the counters are updated and a history entry is generated. Additionally, the maintenance task is considered as done for this interval, and so it is removed from the queue. |
|                     | Under 'Documents' the linked documents are displayed in a list. With doubleclicking a file it is opened, if an according program is installed.  |



Selectio
n history
Here there is only one menu entry Print list. Same procedure as under maintenance task - Print list.

## 7. Maintenance task

The calculation of pending maintenance is the main task of IMM. Maintenance tasks can have three different maintenance intervals:

- a time span in days
- an hours counter or
- an operations counter.

The due date of the maintenances is calculated from these intervals.

If a maintenance comes into the warning zone, it shows up in the list for due maintenances, including a notice that it has reached the warning level . If it reaches the maintenance intervall, the maintenance is set to due, which also shows up in the list of maintenances.



#### THE FUNCTION 'DETERMINE MAINTENANCES'

With the function <code>Determine maintenances</code>, the list of all due maintenances in the selected time span is retrieved from the IMM. These due maintenances are then used to determine the equipment-specific status values as configured.

Numerical set values equalling the total number of due maintenances for equipment matching the selected filter criteria are sent to the according status variables.

If you create a new function Determine maintenances in the Editor, the following configuration dialog appears:

| Period Here you can select the period for which you want to determine due maintenances (see IMM) |  |
|--|--|
|  |  |

### 7.1 Period

In the maintenance task data a time interval in days can be entered. In addition, an period of advance notice can be set, which means: the maintenance task should be evaluated as a 'current' maintenance task this many days before the end of the time interval. (message 'Maintenance due in xx days'.)

If the period of time or the counter value of the maintenance interval is reached, the maintenance is entered with the text 'Maintenance interval exceeded'.

The date of the last maintenance is updated for each execution. On creating the maintenance task this date is set to the current date.

## 7.2 Hours and operations counter

For the calculation of a 'current' maintenance the difference between the 'old' counter value at the last maintenance and the current one is divided by the number of the passed days since the last maintenance and added to the 'old' one. If this is higher than allowed, the maintenance is evaluated as 'current' and is displayed in the list.



If a variable has a lower value than at the last maintenance, a message is displayed.

## 8. Data input

The variable values are only entered in the maintenance data, if the maintenance task is newly created. Otherwise the old values stay.

If a device is created and no variables are linked, the initial value stays in the maintenance task. Also in this constellation the variable values in the maintenance task are not overwritten, if the variable is entered later. A message is displayed, if the variable needed for the maintenance calculation still has the initial value. The variable value only can be changed by executing a repair, a device exchange or a maintenance task.

## 9. Integration in the process

- ▶ Message about the success of maintenance tasks An Integer variable can be assigned to the device. You also have to define the return value of this variable in the maintenance task. If maintenance tasks need not be distinguished, you can always enter the same value here. If no value is entered, no value is set for the variable.
- ▶ Response in the process: A variable indicating the status of the maintenance can be assigned to every maintenance task. (Status Ok : 0 and Status due : 1)

## 10. Operating during Runtime

The following functions are available:

- New device: Create a new device. An equipment identifier must be selected.
- ▶ Edit device: Edit a device. A device has to be selected.
- ▶ Device inactive: Switch a device to inactive, i.e. data is no longer displayed but remains in the database.
- **Execute** maintenance: A maintenance must be selected to perform this.
- ▶ Refresh: The data from the database and the variables are refreshed.
- ▶ Filters: Loads the screen filter dialog to modify columns.



- ▶ Print: Generates an HTML file with the desired list view. The current view is captured as it is. The history and the upcoming maintenances can be printed.
- ▶ Print details: View the details of a maintenance task in HTML. A maintenance task must be selected.

## 11. Functions

### 11.1 Screen switch

When creating an IMM type screen switching function, the dialog to configure the column settings is shown. These can be configured separately for:

- ► Master data (on page 26)
- ► Maintenance tasks (on page 28)
- ► History (on page 29)


### 11.1.1 Master data

Configuration of the history to be displayed:

- current operating hours counter
- current switching cycle counter
- ► Equipment identifier
- ▶ Description
- ▶ Brand
- Device
- ▶ Activation date
- Serial Number
- ▶ Status
- ► Type



### ► Time period since last maintenance

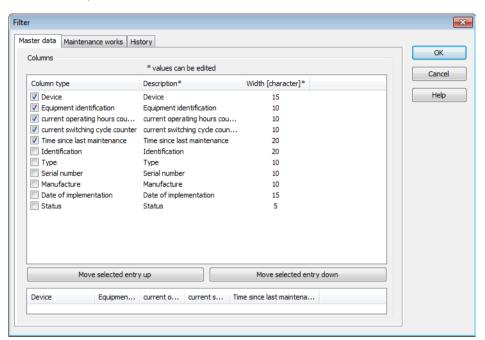


| Parameters  | Description  |
|---|--|
| Column type                                       | Definition via check box which columns should be displayed during Runtime. Label cannot be edited.   |
|   | Active: Column is displayed in the Runtime.  |
| Description                                       | Defines the header of the respective column. You can configure it as language switchable. The value can be edited.   |
| Width   | Defines the width of the column in pixels.   |
|   | You can also define the width of the column by clicking and dragging the column with the mouse in the list with the horizontal display of the column names. The value can be edited. |
| Move selected entry up                            | Moves the selected column up. You can also move the columns with drag&drop.  |
| Move selected entry down                          | Moves the selected column down. You can also move the columns with drag&drop.  |
| Field with horizontal display of the column names | Shows the columns which are active in the list. You can define the size of the columns by clicking and dragging the column borders with the mouse.                                   |



### 11.1.2 Maintenance tasks

Configuration of the maintenance work to be displayed:

- current operating hours counter
- current switching cycle counter
- ► Equipment identifier
- ▶ Description
- Due date
- Device
- ▶ Internal external
- ▶ Comment
- ▶ Status
- Maintenance task
- ▶ Time period since last maintenance

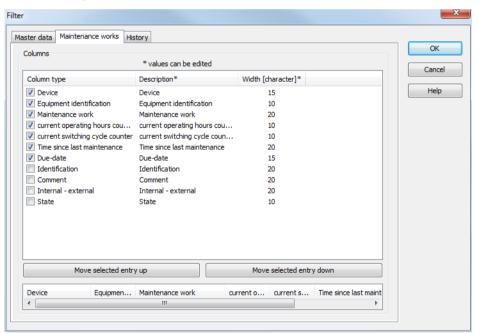



| Parameters  | Description  |
|---|--|
| Column type                                       | Definition via check box which columns should be displayed during Runtime. Label cannot be edited.   |
|   | Active: Column is displayed in the Runtime.  |
| Description                                       | Defines the header of the respective column. You can configure it as language switchable. The value can be edited.   |
| Width   | Defines the width of the column in pixels.   |
|   | You can also define the width of the column by clicking and dragging the column with the mouse in the list with the horizontal display of the column names. The value can be edited. |
| Move selected entry up                            | Moves the selected column up. You can also move the columns with drag&drop.  |
| Move selected entry down                          | Moves the selected column down. You can also move the columns with drag&drop.  |
| Field with horizontal display of the column names | Shows the columns which are active in the list. You can define the size of the columns by clicking and dragging the column borders with the mouse.                                   |


## 11.1.3 History

Configuration of the history to be displayed:

- ► Equipment identifier
- Users
- ▶ Description
- ▶ Date
- Device
- ▶ Comment
- Maintenance task



## ► Counter reading at maintenance

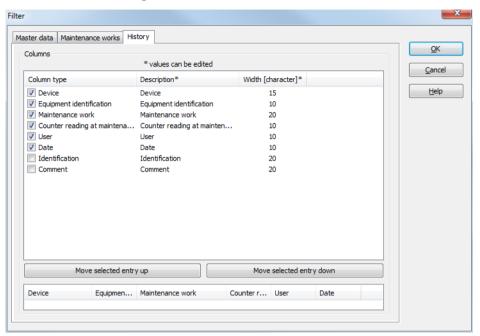

| Parameters  | Description  |
|---|--|
| Column type                                       | Definition via check box which columns should be displayed during Runtime. Label cannot be edited.   |
|   | Active: Column is displayed in the Runtime.  |
| Description                                       | Defines the header of the respective column. You can configure it as language switchable. The value can be edited.   |
| Width   | Defines the width of the column in pixels.   |
|   | You can also define the width of the column by clicking and dragging the column with the mouse in the list with the horizontal display of the column names. The value can be edited. |
| Move selected entry up                            | Moves the selected column up. You can also move the columns with drag&drop.  |
| Move selected entry down                          | Moves the selected column down. You can also move the columns with drag&drop.  |
| Field with horizontal display of the column names | Shows the columns which are active in the list. You can define the size of the columns by clicking and dragging the column borders with the mouse.                                   |



## 11.2 Determine open maintenances


Function Determine open maintenances fetches the list of all pending maintenances from the IMM for a certain period of time. These are used to determine the equipment-specific status values as configured.

When carrying out the function:

- numeric set values are written to the corresponding status variables; these set values match the total of the pending maintenances which are in the equipment and which match the allocation of equipment IDs to status variables
- the status variables engineered at the device and at the maintenances are updated

To configure the function:

- ▶ Select New function...
- ▶ open branch Application
- ▶ Select Determine open maintenance
- ▶ The dialog for configuring the function opens

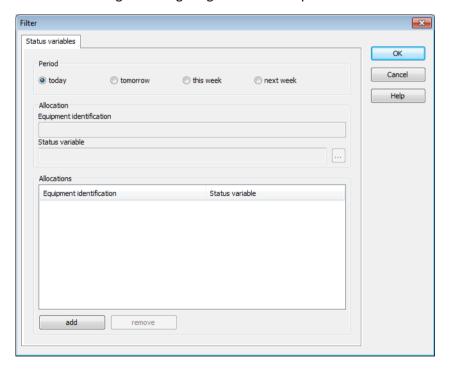



| Parameters      | Description   |
|-----------------|---|
| Period          | Period of time for which the pending maintenance was determined   |
|                 | Note: Time is saved as local time. For details see chapter Handling of date and time in chapter Runtime.  |
| Equipment label | Enter the equipment label which should be allocated to a status variable.   |
|                 | Form: Equipment label are separated by comma and entered as lists.  Equipment label may contain wildcards. (Wildcards are only allowed as prefix or suffix; e.g. *xxx or xxx*.) |
| Status variable | A numerical variable that contains the number of open maintenances of the equipment entered under Equipment identifier as a set value.  |
| Allocations     | List of allocations of equipment labels to status variables.  |
| Add             | Adds an allocation line.  |
| Delete          | Deletes the selected allocation.  |



### **Example**

2 maintenances are active in Equipment1 and 1 maintenance is active in Equipment2.

Equipment1 and Equipment2 are the only equipments in this example. The function is engineered similar to the displayed screenshot.

The status variables contain the following set values:

Maintenances\_today\_all = 3

Maintenances\_today\_all2 = 3

Maintenances\_today\_equipment1\_2 = 3

Maintenances\_today\_equipment1 = 2

Maintenances\_today\_equipment2 = 1



### Information

In network operation, the function is always executed on the server.