



COPADATA
do it your way

zenon manual

Industrial Performance Analyzer (IPA)

v.7.50





©2016 Ing. Punzenberger COPA-DATA GmbH

All rights reserved.

Distribution and/or reproduction of this document or parts thereof in any form are permitted solely with the written permission of the company COPA-DATA. Technical data is only used for product description and are not guaranteed qualities in the legal sense. Subject to change, technical or otherwise.

Table of contents

1. Welcome to COPA-DATA help	5
2. Industrial Performance Analyzer	5
3. How it works - basic principles	6
4. Engineering in the Editor.....	6
4.1 General Settings	7
4.1.1 Database.....	9
4.1.2 Pre-define time filter	10
4.1.3 Alarm causes	11
4.1.4 Equipment identification.....	12
4.1.5 Shift name from list	14
4.2 Variables.....	15
4.3 Language switch	15
4.4 Screen Industrial Performance Analyzer.....	15
4.5 Function Screen switch	18
4.6 Function: Create/print IPA document.....	18
5. Operation in the Runtime	19
5.1 Filter	20
5.1.1 Database and view	23
5.1.2 Date/time	24
5.1.3 Equipment identification.....	25
5.1.4 Alarm/Event Classes	26
5.1.5 Alarm groups	27
5.1.6 Miscellaneous.....	29
5.1.7 Shift start	32
5.1.8 Shift end	33
5.1.9 Alarm cause	34
5.1.10 Column definition.....	35
5.2 Create document	36
5.3 Diagram	37

1. Welcome to COPA-DATA help

GENERAL HELP

If you cannot find any information you require in this help chapter or can think of anything that you would like added, please send an email to documentation@copadata.com (<mailto:documentation@copadata.com>).

PROJECT SUPPORT

You can receive support for any real project you may have from our Support Team, who you can contact via email at support@copadata.com (<mailto:support@copadata.com>).

LICENSES AND MODULES

If you find that you need other modules or licenses, our staff will be happy to help you. Email sales@copadata.com (<mailto:sales@copadata.com>).

2. Industrial Performance Analyzer

The Industrial Performance Analyzer (IPA) is designed in order to display and evaluate alarm data and associated downtimes in different list views. The IPA accesses a SQL database in which alarms - if they are engineered appropriately - are stored.



License information

Must be licensed for Editor and Runtime (single-user, Server, Standby and Client).

By its different filter settings, the IPA offers maximal flexibility. So for example you can filter on individual areas of your equipment and thus only those alarms are displayed which occurred in these

areas. The IPA makes it also possible to detect and trace weak spots of your equipment. This is especially helpful during the implementation of new equipment in order to get to the root of initial difficulties and to fix them. Together with the module Production & Facility Scheduler (PFS) the IPA makes it possible to display downtimes with the break times already subtracted. It automatically subtracts the break time which it receives from the PFS from the actual downtime. There you can see the net downtime of your equipment. In addition the IPA can take shift time and shift names from the PFS. This facilitates the engineering and you save time. And you must maintain the shift times and shift names only once. Furthermore it is assured that PFS and IPA use the same data.



Information

The industrial performance analyzer is designed for running on a PC. Therefore it is operated with keyboard and mouse. The complete operability with a touch screen is not guaranteed.

3. How it works - basic principles

All alarm data that has been configured accordingly (see Variables (on page 15)) is saved in an SQL database. The IPA supports ODBC-able databases such as Oracle SQL server, Microsoft SQL server, Microsoft MSDE, MySQL server etc. These servers can either be on your local computer or somewhere in the network.

In Runtime, the corresponding alarm data is saved in a buffer and cyclically written to the given database from there. The cycle time is determined during configuration in the Editor (see General settings) (on page 7).

It is possible that several Runtime projects write to the same database.

As a result of central saving of alarm data, high security of data and a high availability of alarm data is ensured.


In the zenon Runtime the display and evaluation of the alarm data is implemented in the screen Industrial Performance Analyzer.

4. Engineering in the Editor

You must make the following settings in order to display and evaluate alarm data in Runtime with the Industrial Performance Analyzer.

4.1 General Settings

You can find the Industrial Performance Analyzer area in the project properties. Here, you define the settings for the IPA, which relate to your complete project.

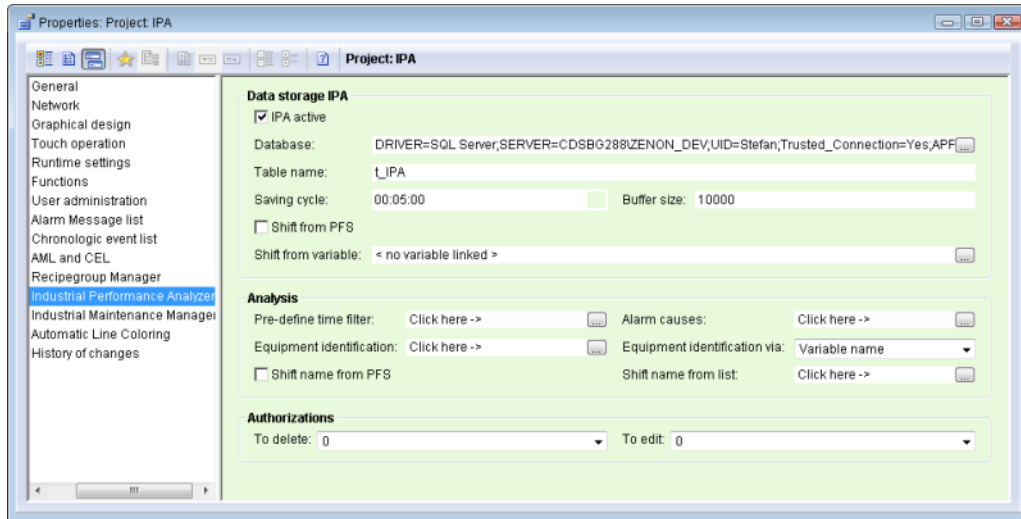


The following properties are available:

Parameters	Description
IPA active	Select this property to switch on the IPA.
Database	Define the database in which the IPA is to store the alarm data (see Database (on page 9))
Table name	Enter a free name for the table of your IPA data. A table with this name is automatically created in the database the first time the database is accessed.
Saving cycle	Define the interval in which the alarm data is to be written from the buffer to the database. Values are, in practice, between 2 and 5 minutes.
Buffer size	State how many alarms are to be saved in the buffer. The content of the buffer is saved to the database at the end of each cycle. The buffer is empty again after that. If, within a cycle, more than just the given number of alarms occurs, the oldest alarms are lost first.
Shift from PFS	Select this property in order to apply the times for the shifts from the Production & Facility Scheduler. If you activate this property, you can display downtimes with breaks already subtracted during the evaluation of the alarms.
Shift from variable	Select a variable of type INT. Together with the property shift name from list, you can assign numbers to shift names.
Pre-defined time filter	Define the different time filters that you can use in Runtime.
Alarm cause	Define the different alarm causes that you can use in Runtime.
Equipment identification	Define the different equipment identifications that you can use in Runtime.
Equipment identification via	Decide whether you want to use the start of the identification of a variable or the start of the variable name as part of the equipment identification.
Shift name from PFS	Select this property in order to apply the shift names for the defined shifts from the Production & Facility Scheduler.
Shift name from list	Define the shift names to numeric values. Using the numeric value of the variables that you have created under shift name from variable, the shift name defined here is displayed in Runtime for the respective alarm.
To delete	Via the drop-down list select the user authorization which a user must have in order to delete database entries of the Industrial Performance Analyzer.
For editing	Via the drop-down list select the user authorization which a user must have in order to edit database entries of the Industrial Performance Analyzer.

4.1.1 Database

At property **Database** you click on the button with the three dots in order to reach the dialog for selecting the file data source.

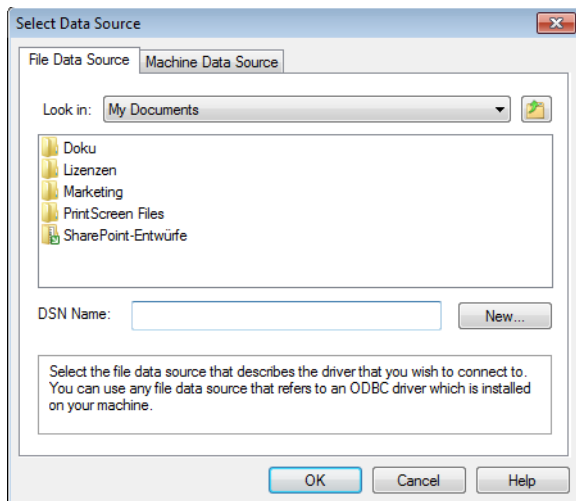

1. In order to create a DSN file you click **New...**
2. Select entry **SQL server** in the following dialog and click **Next**.
3. Enter a new for the data source and again click **Next**.
4. Click **Finish** in order to exit the dialog.
5. Select the corresponding SQL server under **Server** and click **Next**.
6. You do not have to change anything in the appearing dialog. Click on **Next**.
7. Activate check box **change standard database to:** and select the desired database. Click **Continue**.
8. Again you do not have to change anything in this dialog. Click **Finish** in order to exit the dialog.

The final dialog shows you your settings once again. You can test the data source there. Confirm this and the following dialog with **OK**.




Attention

When using **Native Client 10** and **11**, the password is not automatically carried over to the provider string. It must be entered manually

e.g.: ...,**User ID=sqlExampleUser1;Password=secretPassword;**...

4.1.2 Pre-define time filter

When you select this setting, the following dialog will be displayed.

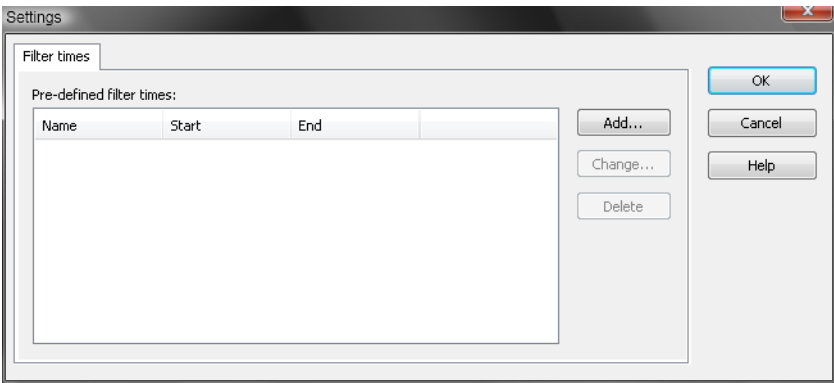


Parameters	Description
Add...	Add a new filter time. Enter a distinct name and set a start and end time in the appearing dialog.
Change...	Only active when you have selected an existing entry. You can change the name, the start time and the end time in the appearing dialog.
Delete	Only active when you have selected one or more existing entries. Deletes the selected time filters.

The time filters you define here are available in the Runtime. You can, for example, define the times of your shifts (early shift, late shift, etc.) here once and can then use these time periods in an Industrial Performance Analyzer screen when filtering.

Note: Time is saved as local time. For details see chapter Handling of date and time in chapter Runtime.

Adding a pre-defined time filter


You can add a new time filter or change an existing one using the **Definition** dialog.

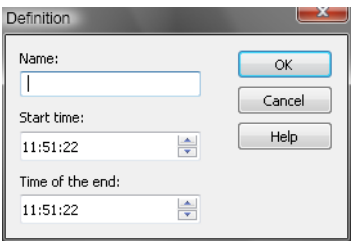

Parameters	Description
Name	Unique name of the time filter.
Time of begin	Time from which on the time filter is valid.
Time of the end	Time at which the time filter ends.

4.1.3 Alarm causes

When you select this setting, the following dialog will be displayed.

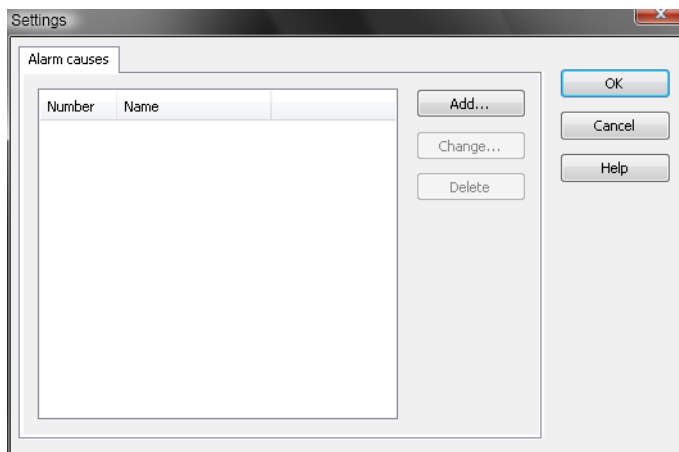


Parameters	Description
Add...	Add a new alarm reason. Assign a distinct name and number in the appearing dialog.
Change...	Only active when you have selected an existing entry. You can change the number and the name in the dialog that appears.
Delete	Only active when you have selected one or more existing entries. Deletes the selected alarm causes without requesting confirmation.

The alarm causes you define here are available in the Runtime. You can assign an alarm cause to each alarm in the Industrial Performance Analyzer screen. You select the alarm causes from a list that you administer here.

Adding alarm causes


You can add new causes or amend existing ones using the alarm causes dialog.

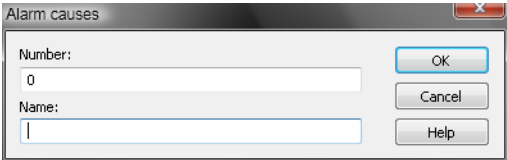

Parameters	Description
Number	Unique number of the alarm cause.
Name	Unique cause.

4.1.4 Equipment identification

When you select this setting, the following dialog will be displayed.

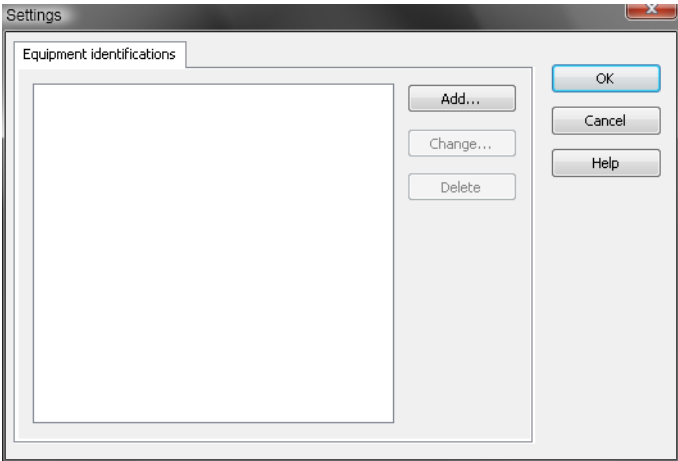

Parameters	Description
Add...	Add a new equipment identification. Enter a name for the equipment identification in the appearing dialog.
Change...	Only active when you have selected an existing entry. You can change the name of the equipment identification in the dialog that appears.
Delete	Only active when you have selected one or more existing entries. Deletes the selected equipment identification without requesting confirmation.

The equipment identifications defined here are available to you in Runtime. The equipment identification can appear as a prefix in the name of the variables or in the identification of the variables (see **Equipment identification** via property in General settings (on page 7)). The prefix is ended with the _ character. Assignment to an equipment identification is only carried out if an equipment identification created corresponds to the prefix exactly.



Example

Equipment identification:

- ▶ Anlage11

Variable name or variable identification:


- ▶ Anlage1_Variable1
- ▶ Anlage11_Variable1

Only the variable Anlage11_Variable1 is assigned the created equipment identification Anlage11.

The equipment identification helps you to filter for the desired equipment.

Adding equipment identification


You can add new equipment identifications or change existing ones using the **Equipment identification** dialog.

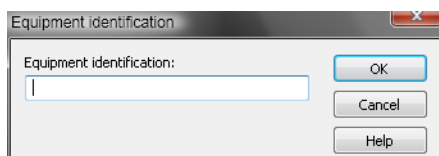

Parameters	Description
Equipment identification	Name for the equipment identification.

4.1.5 Shift name from list

The following dialog will be displayed when you select this setting.

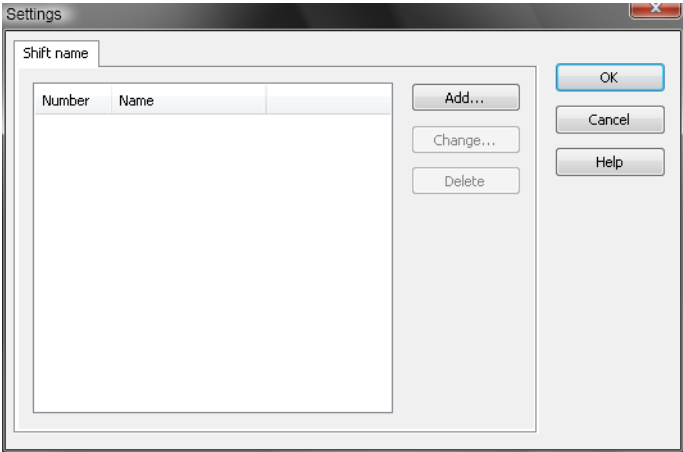


Parameters	Description
Add...	Add a new shift name. Assign a distinct name and number in the appearing dialog.
Change...	Only active when you have selected an existing entry. You can change the number and the name in the dialog that appears.
Delete	Only active when you have selected one or more existing entries. Deletes the selected shift name without requesting confirmation.

The shift name you define here are available in the Runtime. They help you when filtering, in order to only show the alarms that have occurred in the respective shift.

Add shift name from list

You add new shifts or change existing ones using the **Shift name** dialog.

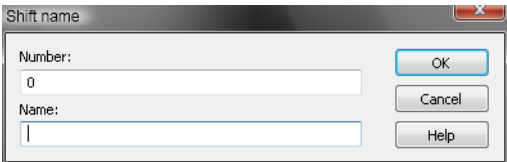

Parameters	Description
Number	Unique number of the shift.
Name	Unique name of the shift.

4.2 Variables

In order for alarms to be saved in the IPA database, you must activate the **Save in IPA database** property for each variable that comes into consideration here. Only alarms of variables for which this property has been activated are saved in the database and can be displayed and evaluated in an Industrial Performance Analyzer screen.



Attention

In the limit value text of the variables and in the variable identification, only permitted characters may occur for SQL statements.

4.3 Language switch

Language switching is available for the following areas in the Industrial Performance Analyzer:

- ▶ Alarm/event group and alarm/event classes
- ▶ Equipment identification

Note: Because the use of '@' is not permitted for variable names, language switching for equipment identification is only available if you have selected **Equipment identification via variable identification**.

- ▶ Alarm cause
- ▶ Shift name.

Note: As the character '@' is not allowed in the Production & Facility Scheduler, language switch for shift names is only available if you have engineered the respective entries for **Shift name from list**.

You must tag the terms for which language switch should be used with character '@'. In addition you must make sure that corresponding entries are available in the language file.

4.4 Screen Industrial Performance Analyzer

CREATE INDUSTRIAL PERFORMANCE ANALYZER SCREEN

The `Industrial Performance Analyzer` screen is for displaying and evaluating the alarm data that the Industrial Performance Analyzer saves in the database in Runtime.

ENGINEERING

Steps to create the screen:

1. Create a new screen:

In the tool bar or the context menu of the **Screens** node, select the **New screen** command.
An empty *Standard* screen is created.


2. Change the properties of the screen:

- a) Name the screen in the **Name** property.
- b) Select *Industrial Performance Analyzer* in the **Screen type** property.
- c) Select the desired frame in the **Frame** property.

3. Configure the content of the screen:

- a) select menu item **Control elements** from the menu bar
- b) Select *Insert template* in the drop-down list.
The dialog to select pre-defined layouts is opened. Certain control elements are inserted into the screen at predefined positions.
- c) Remove elements that are not required from the screen.
- d) If necessary, select additional elements in the **Elements** drop-down list. Place these at the desired position in the screen.

4. Create a screen switch function.

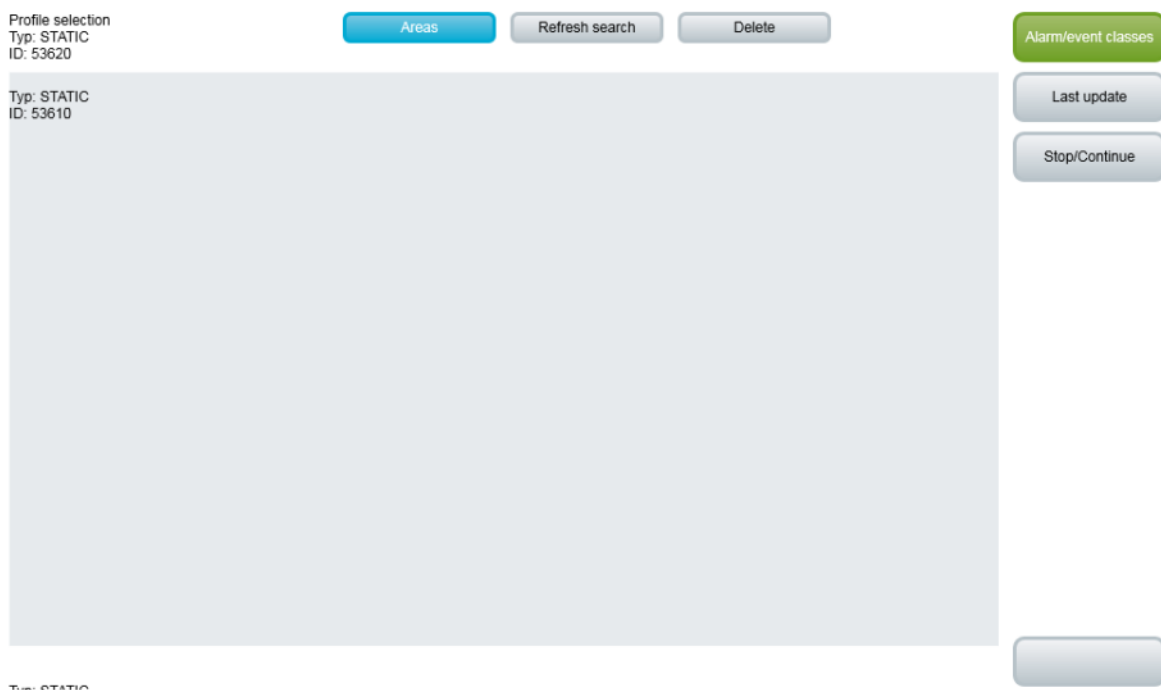

Control element	Description
Insert template	<p>Opens the dialog for selecting a template for the screen type.</p> <p>Templates are shipped together with zenon and can also be created by the user.</p> <p>Templates add pre-defined control elements to pre-defined locations in the screen. Elements that are not necessary can also be removed individually once they have been created. Additional elements are selected from the drop-down list and placed in the screen. Elements can be moved on the screen and arranged individually.</p>
Window	Control elements for windows.
List	Tabular display of the alarm data. The information is read from the table in the database and are then displayed here.
List type	Text field that displays the selected list type.
Set filter	Display of the set filter.
List functions	Control elements to control the list.
Filter...	Opens the filter dialog.
Filter back	<p>Loads the last filter setting.</p> <p>The ten last filter settings are being saved.</p>
Cancel filter	Deactivates all filter settings.
Update database	Reads again the data from the database.
Create document	Creates a document with the selected data and opens the document. The data are displayed in form of a table.
Create diagram	Displays the selected data in a diagram.
Diagram settings	Definition of the layout for the diagram; e.g. bar or pie diagram.
Filter profiles	Buttons for filter settings in Runtime.
Profile selection	Select profile from list.
Save profile	Saves current setting as a profile.
Delete profile	Deletes selected profile.
Import	Imports filter profiles from export file.
Export	Exports filter profiles in the file.

4.5 Function Screen switch


If you create a screen switching function (see Functions) for an Industrial Performance Analyzer screen, you are shown the IPA filter dialog. Here, you can set filters and change settings that are taken into account when switching to the Industrial Performance Analyzer screen.

You can find details on the settings in the filter dialog in the Filters (on page 20) chapter.

4.6 Function: Create/print IPA document

With this function, you can automatically create an IPA evaluation and save it as an HTML document or print it out on a Windows standard printer. You can find the function under the **AML and CEL** grouping.

The filter possibilities and the filter configuration correspond to the screen switching function on the Industrial Performance Analyzer screen. On the **Target document** tab, you select whether the evaluation is to be output on the Windows standard printer or to a file in the export directory.

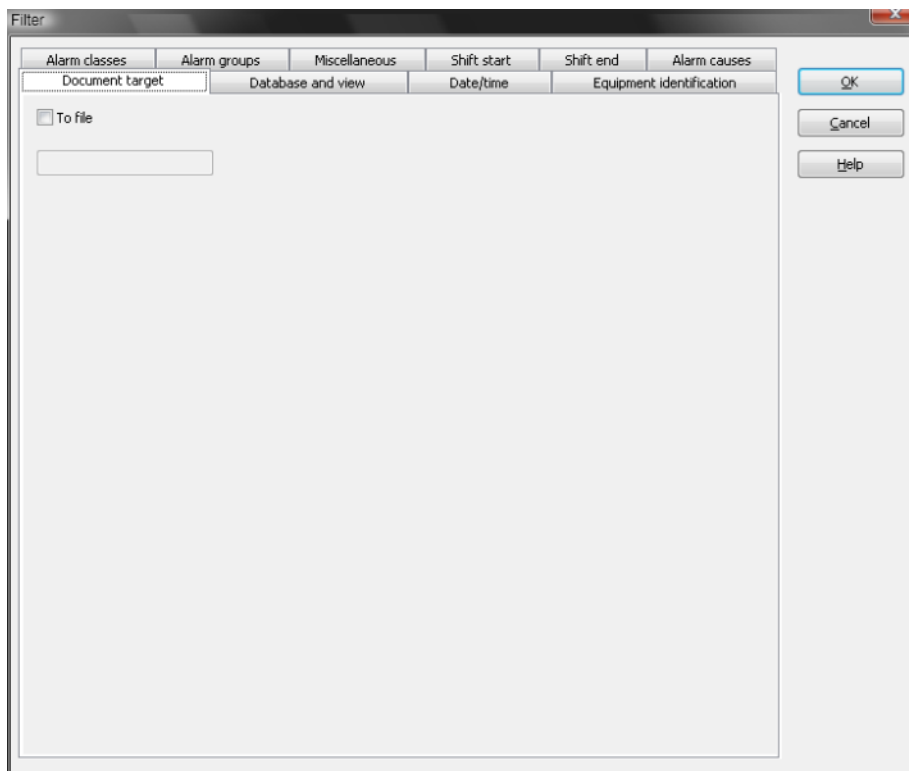

If you want to save the evaluation to a file, activate the **To file** checkbox and enter a name.



Attention

Please note that you must state the file name, including .html, so that your system recognizes the file created without problems and you can open it immediately with an appropriate program.


Example of file name:

IPA_010109.html

The evaluation is suppressed if you do not activate the checkbox.

5. Operation in the Runtime

You operate the IPA in the Runtime with the help of the screen *Industrial Performance Analyzer*. The screen is opened with the filter settings and parameters which were defined in the Editor. You will receive the display which you defined in the Editor.

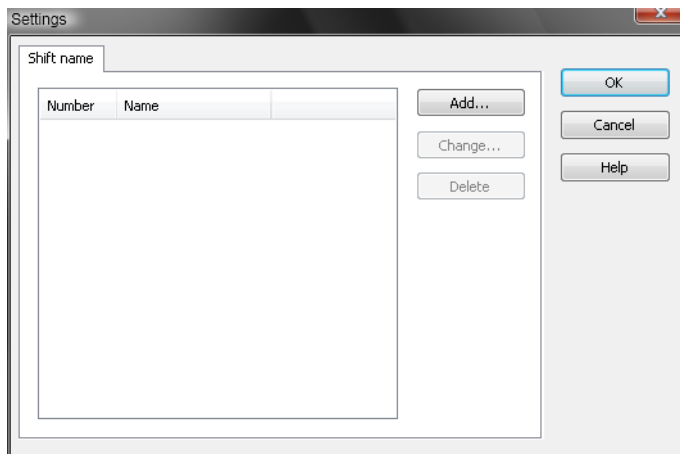

Each display has its own default sorting of the columns (see chapter Filter (on page 20)). You can also sort the display yourself using each available column. Click on the header of the desired column and the display is sorted after this column. If you want to use more than one column just press and hold **Ctrl** and then click the desired columns one after the other. Thus you receive a cascaded sorting. If you no longer use the default sorting, an arrow next to a column header indicates that the display is sorted by this column. You can sort either ascending or descending. If you left-click on a column once, the entries are sorted in descending order. Another left-click switches between the sorting directions.


For the operation of the Industrial Performance Analyzer and the display of the alarm data the control elements engineered in the Editor are available (see also Screen Industrial Performance Analyzer (on page 15)).

DELETE ENTRIES

You can only delete entries from the database using the internal Industrial Performance Analyzer. In order to delete an entry right-click the desired entry. Select menu item **delete selected line from the database** in the context menu. If you have the necessary authorization, the entry is deleted (see also General settings (on page 7)).

ALARM REASON AND COMMENTARY

If you want to add an alarm cause and/or a commentary to an alarm, you have two possibilities. Double click the desired line. In the appearing dialog you can select an alarm reason from the dropdown list **Alarm reason** and you can enter a commentary in the text field **Commentary**.

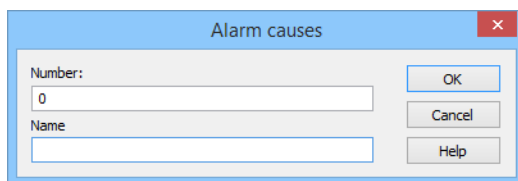

You can also reach the dialog by right-clicking the desired line and selecting menu item **Edit alarm reason** from the context menu.

5.1 Filter

With the help of the filter dialog you define the look of screen Industrial Performance Analyzer. You decide which alarms are displayed and by which criteria they are sorted.

Each list type displays determined columns and has its own default sorting. There are three list types sum lists, statistics list and single list.

SUM LIST

List name	available columns	default sorting
class related	Alarm/event class, Number, Total duration	Column: Number , starting with the largest number
Single breakdown related	Variable, Variable identification, Number, Total duration, Total duration gross, Limit value text, Alarm/event classes, Alarm/event groups, Equipment, Project	Column: Number , starting with the largest number
group related	Alarm/Event class, Number, Total duration	Column: Number , starting with the largest number
Equipment related	Equipment, Number, Total duration	Column: Number , starting with the largest number

STATISTICS LIST

List name	available columns	default sorting
Total downtime of an equipment	Equipment, Total duration	Column: Total duration , starting with the longest alarm
n shortest alarms	Status, Variable, Variable identification, Begin, Duration, Duration gross, Alarm/event class, Alarm/event group, Limit value text, Shift start, Shift end, Equipment, Project, Alarm cause, Commentary	Column: Duration , starting with the shortest alarm
n most frequent alarms	Number, Variable, Variable identification, Begin, Total duration, Total duration gross, Alarm/event class, Alarm/event group, Limit value text, Equipment, Project, Alarm cause, Commentary	Column: Number , starting with the largest number
n longest alarms	Status, Variable, Variable identification, Begin, Duration, Duration gross, Alarm/event class, Alarm/event group, Limit value text, Shift start, Shift end, Equipment, Project, Alarm cause, Commentary	Column: Duration , starting with the longest alarm
n last alarms	Status, Variable, Variable	Column: Duration , starting with the

	identification, Begin, Duration, Duration gross, Alarm/event class, Alarm/event group, Limit value text, Shift start, Shift end, Equipment, Project, Alarm cause, Commentary	oldest alarm
--	---	--------------


Enter the desired number n in the field **n=**.

SINGLE LIST

List name	available columns	default sorting
Alarm Message List	Status, Variable, Variable identification, Begin, Duration, Duration gross, Alarm/event class, Alarm/event group, Limit value text, Shift start, Shift end, Equipment, Project, Alarm cause, Commentary	Column: Duration , starting with the oldest alarm

5.1.1 Database and view

Select the desired view under **View**.

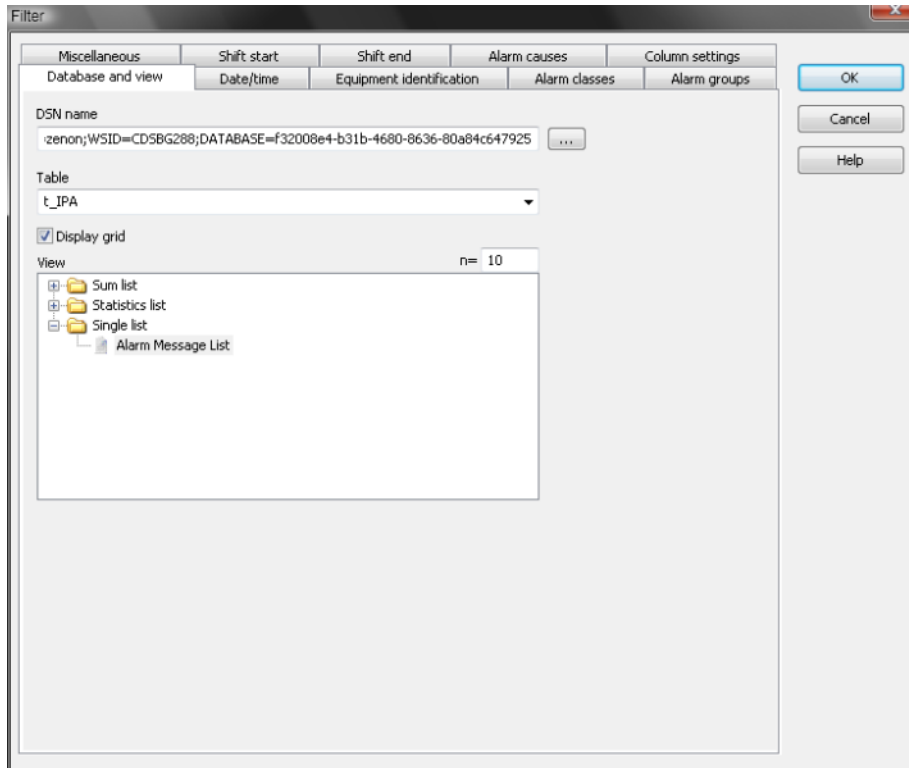


The fields DSN name and Table show the connection to the SQL server and the name of the table in which the IPA writes the alarm data. These fields are purely informative. You cannot make any changes (see also Database (on page 9)). You can make setting using these properties:

Parameter	Description
Display grid	Shows a raster when displaying the alarm data.
n=	Define how many entries the views n shortest alarms, n most frequent alarms, n longest alarms and n last alarms should contain.

5.1.2 Date/time

To use this filter, activate the checkbox **Active**. If you close the dialog via **OK**, your settings are used on the display. If you deactivate checkbox **Active**, the settings are retained. They are however not used on the display.

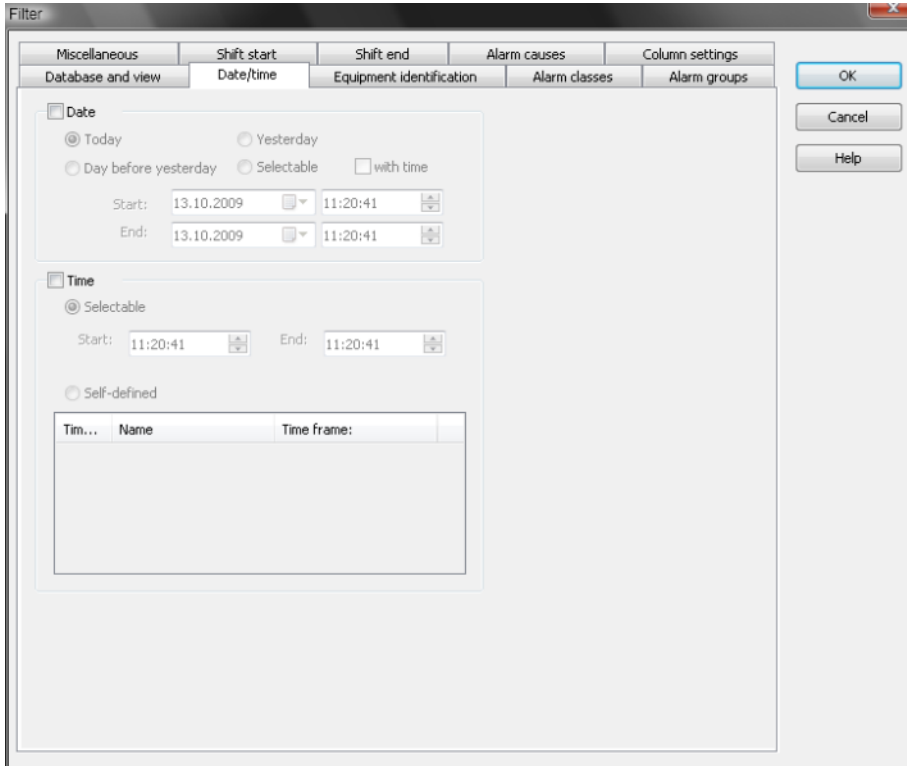

The screenshot shows the 'Filter' dialog box with the 'Date/time' tab selected. The 'Date' section is expanded, showing options for 'Today', 'Yesterday', 'Day before yesterday', and 'Selectable'. The 'Time' section is also expanded, showing 'Selectable' and 'Self-defined' options. The 'Self-defined' section includes a table with columns 'Tim...', 'Name', and 'Time frame:'.

Select **Today**, **Yesterday**, **Day before yesterday** or **Selectable** in the date filter. If you select **Selectable**, enter a freely defined date range. If you activate the **with time** option, enter the desired time for the start or end date. If you do not activate **with time**, the time range is from 0 a.m. on the start date to 12 p.m. on the end date.

Select **Selectable** or **Self-defined** in the time filter. If you select **Selectable**, enter a freely defined time range. If you select **Self-defined**, choose a time range which you have created in the Editor beforehand. See also chapter Pre-define time filter (on page 10).

Note: Time is saved as local time. For details see chapter Handling of date and time in chapter Runtime.




Information

*The time range under **Time** is valid for each day which has been selected under **Date**. If you select **Selectable** under **Date**, **01.10.2008** under **Start** and **05.10.2008** under **End**, the time range, which you have selected under **Time**, is valid for each of the five days starting October 1st and ending October 5th. October.*

5.1.3 Equipment identification

To use this filter, activate the checkbox **Active**. If you close the dialog via **OK**, your settings are used on the display. If you deactivate checkbox **Active**, the settings are retained. They are however not used on the display.

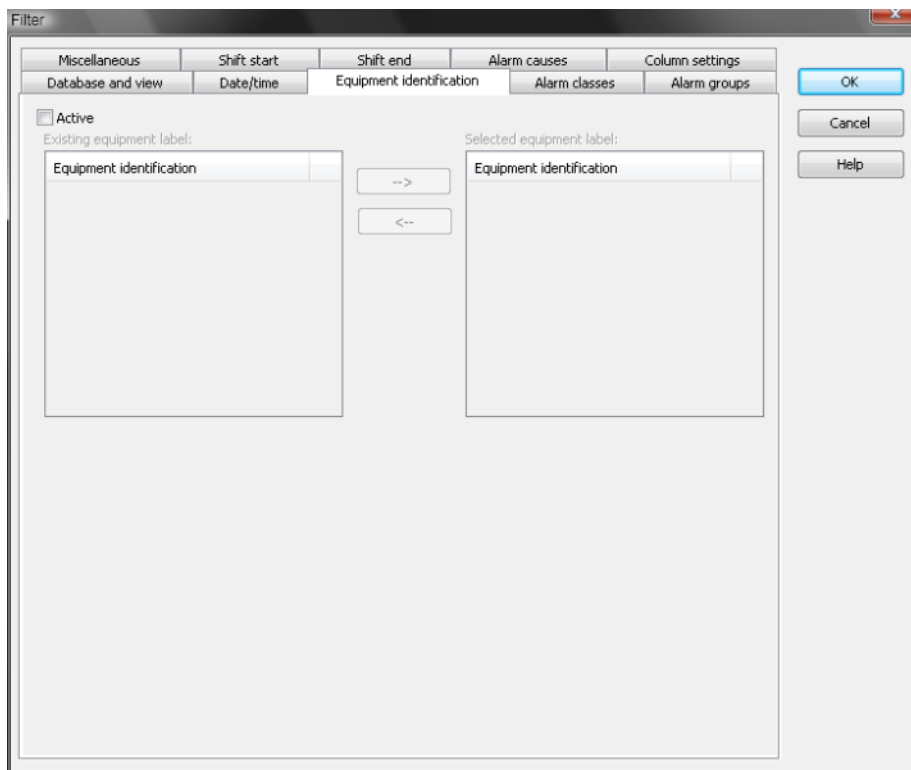

In the filter of the equipment identification one or more pieces of equipment can be activated. You can select the entries in the left list and move them to the right list with the help of the arrow key.

The alarms of the pieces of equipment of the right-hand list will be displayed.

The equipment identification is carried out using the prefix of the variable name or the variable identification depending on your project setting (see also General settings (on page 7)). You

administrate the list for the equipment identification in the Editor under Equipment identification (on page 12).




Info

*Several entries can be selected when filtering. You can select more than one entry by pressing and holding **Ctrl** or **Shift**. You can select a number of entries by pressing and holding the **Ctrl** key. By pressing and holding **Shift** you select all entries which lie between the two selected entries. By pressing and holding both **Ctrl** and **Shift** all entries which lie between the selected entries are selected. The entries which were selected beforehand remain selected.*

5.1.4 Alarm/Event Classes

To use this filter, activate the checkbox **Active**. If you close the dialog via **OK**, your settings are used on the display. If you deactivate checkbox **Active**, the settings are retained. They are however not used on the display.

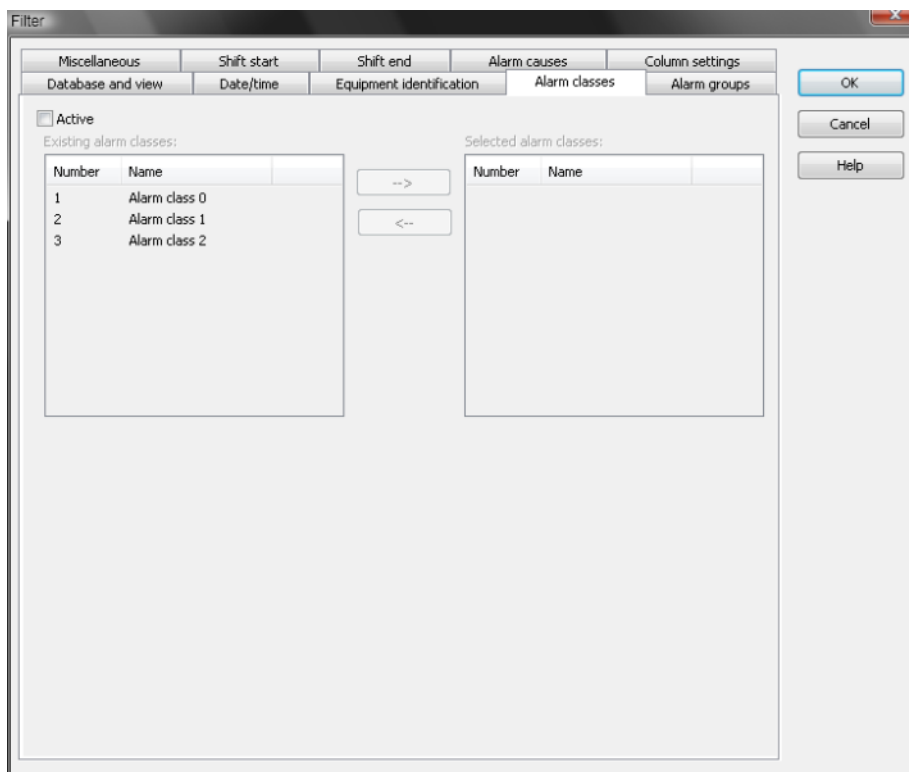

In the filter of the alarm/event classes one or more alarm/event classes can be activated. You can select the entries in the left list and move them to the right list with the help of the arrow key.

The alarms of the groups in the right list will be displayed.



Information

In the Runtime, only the name of the alarm/event class is displayed. Thus a better sorting of the entries is achieved. The number of the alarm/event class is not displayed.




Info

*Several entries can be selected when filtering. You can select more than one entry by pressing and holding **Ctrl** or **Shift**. You can select a number of entries by pressing and holding the **Ctrl** key. By pressing and holding **Shift** you select all entries which lie between the two selected entries. By pressing and holding both **Ctrl** and **Shift** all entries which lie between the selected entries are selected. The entries which were selected beforehand remain selected.*

5.1.5 Alarm groups

To use this filter, activate the checkbox **Active**. If you close the dialog via **OK**, your settings are used on the display. If you deactivate checkbox **Active**, the settings are retained. They are however not used on the display.

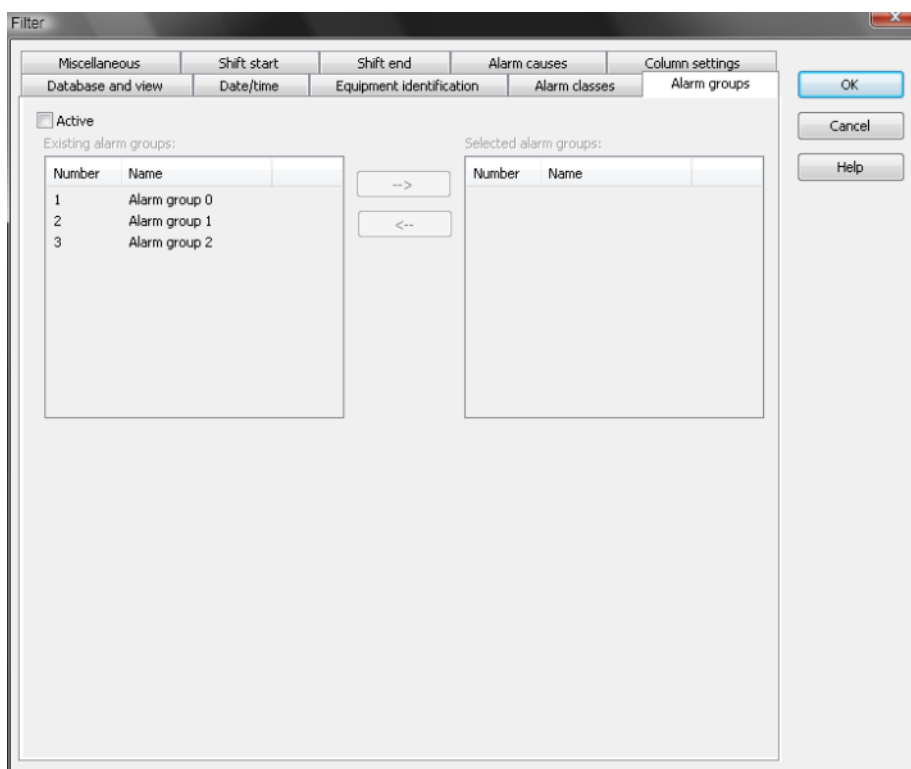

In the filter of the alarm/event group one or more alarm/event groups can be activated. You can select the entries in the left list and move them to the right list with the help of the arrow key.

The alarms of the groups in the right list will be displayed.



Information

In the Runtime only the name of the alarm/event group is displayed. Thus a better sorting of the entries is achieved. The number of the alarm/event group is not displayed. In doing so, sorting is not alphabetical, but always according to the index.




Info

Several entries can be selected when filtering. You can select more than one entry by pressing and holding `Ctrl` or `Shift`. You can select a number of entries by pressing and holding the `Ctrl` key. By pressing and holding `Shift` you select all entries which lie between the two selected entries. By pressing and holding both `Ctrl` and `Shift` all entries which lie between the selected entries are selected. The entries which were selected beforehand remain selected.

5.1.6 Miscellaneous

On this tab a few additional filter functions are available.

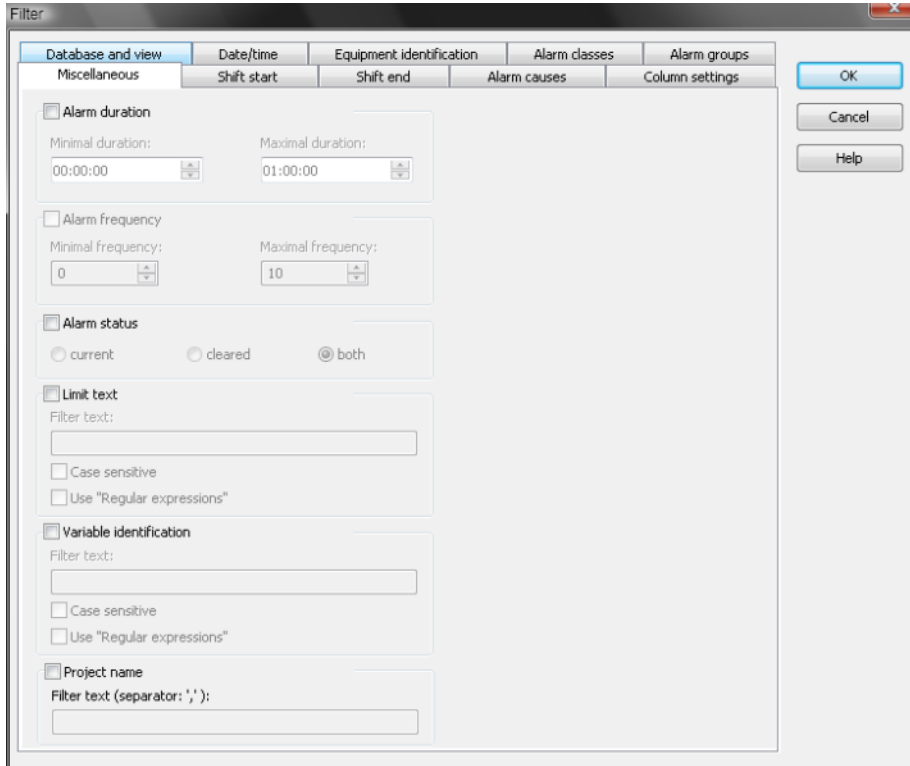

Parameter	Description
Alarm duration	Filtering on alarm duration. Only alarms whose duration is within this time frame will be considered.
Alarm frequency	Filtering alarm data on alarm frequency. Only alarms whose frequency is within this frame will be considered. This filter can only be activated if the <code>n most frequent alarms</code> has been selected in the list view.
Alarm status	Filtering by alarm status. Choose from one of these possibilities: current, cleared or both.
Limit value text filter	Filtering alarm data on the limit value text of the alarm. Either on the text – e.g. 'Test' lists all alarms with the word 'Test' in the alarm text - (case sensitive or not) or with Regular expressions (on page 30).
Variable identification text filter	Filtering alarm data on the identification text of the alarm. Either on text or with Regular expressions (on page 30).
Project filter	Filtering on the project, from which the alarm has been written to the database. When filtering on several projects, they have to be separated with the character ','.

Regular expressions

Regular expressions indicate a string pattern which consists of normal characters (e.g. letters, digits etc.) and special characters which are referred to as meta characters. When filtering or searching in texts you can define a particular character string.



Information

*Do not confuse regular expressions with wildcards - e.g. * equals any string. Regular expressions are way more efficient and make it possible to define your search very precise.*


The following list consists of all meta characters and how they are used as regular expressions:

Meta character	Description
\	Marks the next character as a special character, a literal, a backreference, or an octal escape. For example n matches the character n . \n matches a newline character. The sequence \\ matches \ and \(matches (.
^	Matches the position at the beginning of the input string.
\$	Matches the position at the end of the input string.
*	Matches the preceding character or subexpression zero or more times. For example zo* matches " z , zo , zoo etc.
+	Matches the preceding character or subexpression one or more times. For example zo+ matches zo , zoo etc. but not z .
?	Matches the preceding character or subexpression zero- or one time. For example do(es)? matches the do in do or does .
?	When this character immediately follows any of the other quantifiers (* , + , ? , {n} , {n,m}) the matching pattern is non-greedy. A non-greedy pattern matches as little of the searched string as possible, whereas the default greedy pattern matches as much of the searched string as possible. For example in the string oooo , o+? matches a single o while o+ matches all os .
.	Matches any single character except \n . To match any character including the \n use a pattern such as [\\s\\S] .
(Pattern)	A subexpression that matches pattern and captures the match. To match parentheses characters (), use \(or \) .
x y	Matches either x or y . For example z food matches z or food . (z f)ood matches zood or food .
[xyz]	A character set. Matches any one of the enclosed characters. Example: [abc] matches the a in plain .
[^xyz]	A negative character set. Matches any character not enclosed. Example: [^abc] matches the p in plain .
[a-z]	A range of characters. Matches any character in the specified range. Example: For example [a-z] matches any lowercase alphabetic character in the range a through z .
[^a-z]	A negative range of characters. Matches any character not in the specified range. Example: For example [^a-z] matches any character not in the range a through z .
\cx	Matches the control character indicated by x . For example \cM matches a Ctrl+M or a carriage return character. The value of x must be in the range of A to Z or a to z . If not, c is assumed to be a literal c -character.
\f	Matches a form-feed character. Equivalent to \x0c and \cL .
\t	Matches a tab character. Equivalent to \x09 and \cI .
\v	Matches a vertical tab character. Equivalent to \x0b and \cK .

\num	Matches num, where num is a positive integer. A reference back to captured matches. Example: For example (.)\1 matches two consecutive identical characters.

5.1.7 Shift start

To use this filter, activate the checkbox **Active**. If you close the dialog via **OK**, your settings are used on the display. If you deactivate checkbox **Active**, the settings are retained. They are however not used on the display.

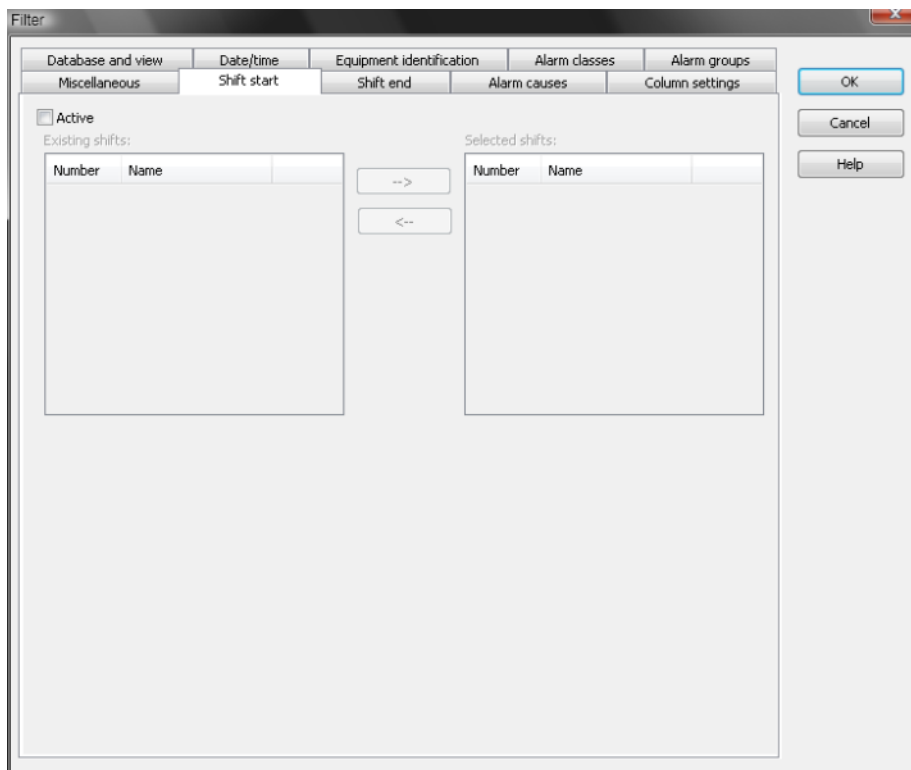

In the filter Shift begin one or more shifts can be activated. You can select the entries in the left list and move them to the right list with the help of the arrow key.

The filter Shift begin refers to the shift which has been active at the time when **Alarm received** was active. You can administrate the list with the shift names in the Editor under Shift name from list (on page 14).




Info

Several entries can be selected when filtering. You can select more than one entry by pressing and holding *Ctrl* or *Shift*. You can select a number of entries by pressing and holding the *Ctrl* key. By pressing and holding *Shift* you select all entries which lie between the two selected entries. By pressing and holding both *Ctrl* and *Shift* all entries which lie between the selected entries are selected. The entries which were selected beforehand remain selected.

5.1.8 Shift end

To use this filter, activate the checkbox **Active**. If you close the dialog via **OK**, your settings are used on the display. If you deactivate checkbox **Active**, the settings are retained. They are however not used on the display.

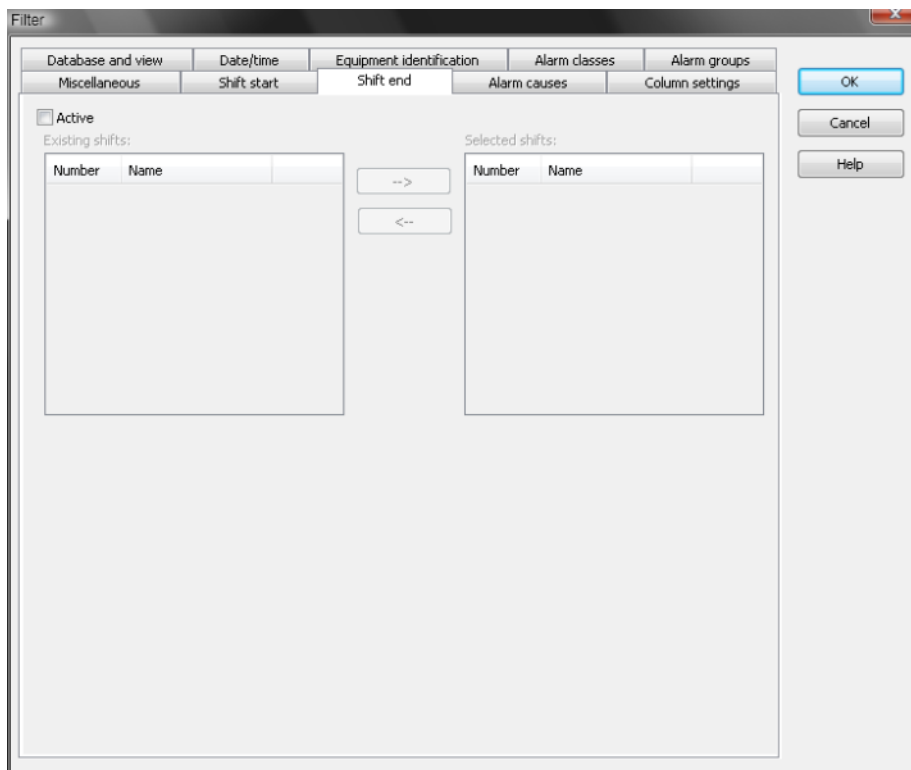

In the filter Shift end one or more shifts can be activated. You can select the entries in the left list and move them to the right list with the help of the arrow key.

The filter Shift end refers to the shift which has been being active at the time when **Alarm received** was active. The alarms and shifts of the right listbox will be displayed. You can administrate the list with the shift names in the Editor under Schift name from list (on page 14).




Info

Several entries can be selected when filtering. You can select more than one entry by pressing and holding *Ctrl* or *Shift*. You can select a number of entries by pressing and holding the *Ctrl* key. By pressing and holding *Shift* you select all entries which lie between the two selected entries. By pressing and holding both *Ctrl* and *Shift* all entries which lie between the selected entries are selected. The entries which were selected beforehand remain selected.

5.1.9 Alarm cause

To use this filter, activate the checkbox **Active**. If you close the dialog via **OK**, your settings are used on the display. If you deactivate checkbox **Active**, the settings are retained. They are however not used on the display.

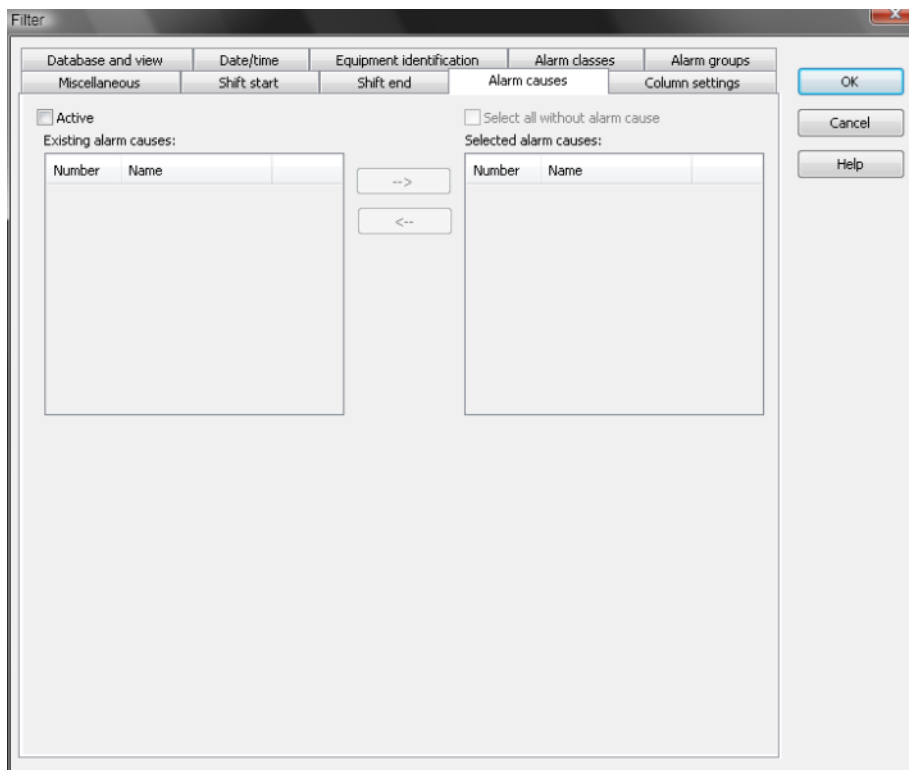


In the filter alarm reasons one or more alarm reasons can be activated. You can administrate the alarm reasons in the Editor in the area Alarm reasons (on page 11).



Info

*Several entries can be selected when filtering. You can select more than one entry by pressing and holding **Ctrl** or **Shift**. You can select a number of entries by pressing and holding the **Ctrl** key. By pressing and holding **Shift** you select all entries which lie between the two selected entries. By pressing and holding both **Ctrl** and **Shift** all entries which lie between the selected entries are selected. The entries which were selected beforehand remain selected.*

5.1.10 Column definition

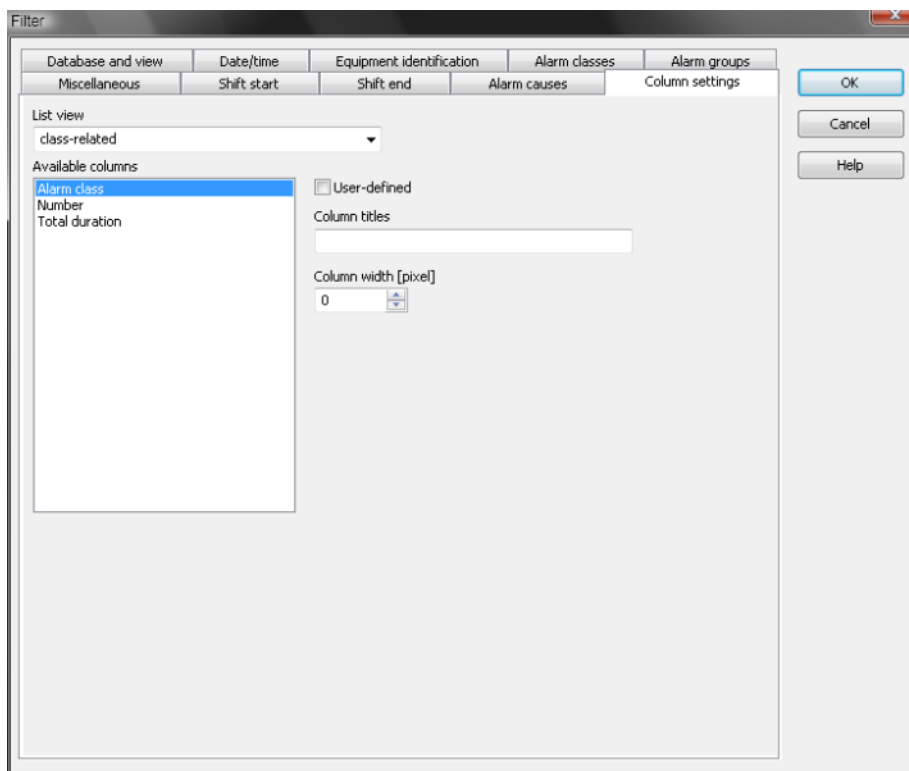

On this tab you customized the preset columns.

Parameter	Description
List view	Select the desired list from the dropdown list.
Columns	In this list all columns are displayed which are available for the selected list view.
User defined	Activate this checkbox in order to customize the preset value for column title and column width.
Column titles	Enter new title for selected column.
Column width	Define the width for the selected column in pixel. If you enter 0, the column is not displayed.

5.2 Create document

Additional to the display of the alarm data a document in HTML format can be created. These documents can be printed or saved.

After you have set all desired filters and sort options, you can generate the document by clicking **Create document**.

The layout of the document is defined with a XSL file (stylesheet). The following pre-defined files are available:

XSL file	Description
Single_list.xsl	single alarm display
Statistical_duration.xsl	statistic display of the total down time of an equipment
Statistical_frequency.xsl	statistic display of the n most frequent, n shortest, n longest, n last alarms
Sum_list_equipment.xsl	equipment related sum list
Sum_list_single_alarm.xsl	single alarm related sum list
Sum_list_group.xsl	group related sum list
Sum_list_class.xsl	class related sum list

These style sheets are located in:

C:\ProgramData\COPA-DATA\zenon7.50\IPA\

For several stylesheets, a dialog asks for the stylesheet to be used.

5.3 Diagram


For the sum lists and the statistics list **n most frequent alarms** a diagram can be created in addition to the document.

With the settings of the diagram, its layout is defined.


On the tab **Diagram general** one of the following diagrams can be selected:

Diagram type	Description
Horizontal bar chart	Bar diagram is displayed horizontally.
Vertical bar chart	Bar diagram is displayed vertically.
Pie Chart	For the pie diagram 3D or 2D can be selected.

The summed alarms are displayed based on the time or the number. In the entry **Miscellaneous** the color of the bars are defined. Additionally the display of a grid is activated here.

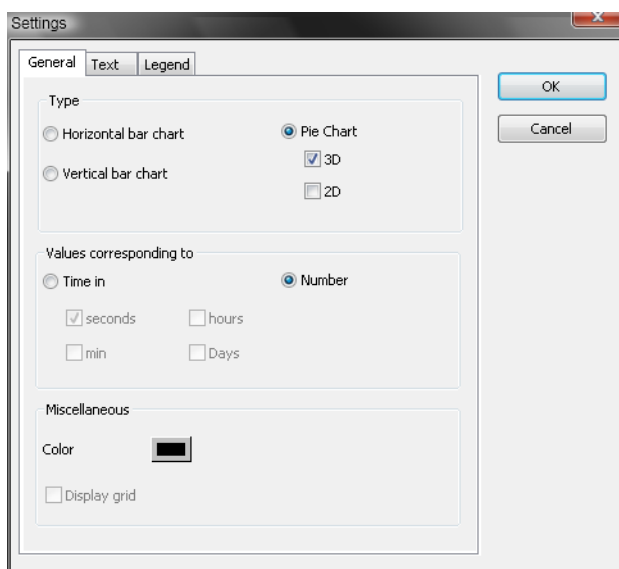

On the tab **Labeling** you select the font and the color of the diagram labeling. The **Style** defines the text to be displayed.

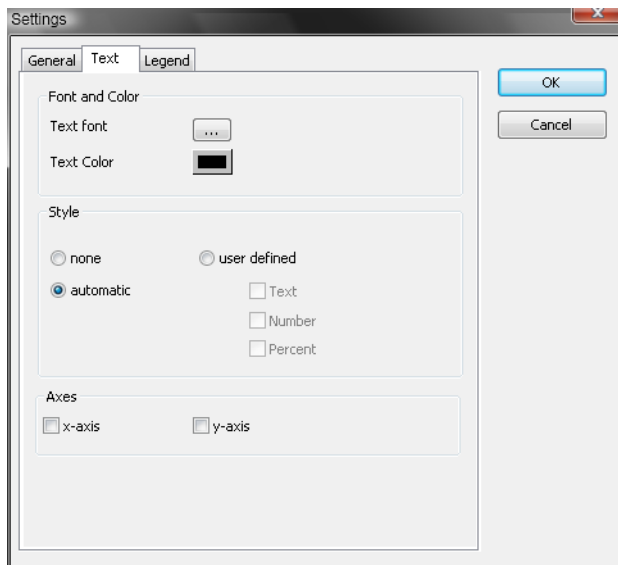

The font and font color are selected in the **Key** tab. Here you also define, how the key should be displayed and where it should appear.

