

Manuel de zenon

Command Sequencer (Séquenceur de commandes)

v. 7.60



©2017 Ing. Punzenberger COPA-DATA GmbH

Alle Rechte vorbehalten.

Die Weitergabe und Vervielfältigung dieses Dokuments ist - gleich in welcher Art und Weise - nur mit schriftlicher Genehmigung der Firma COPA-DATA gestattet. Technische Daten dienen nur der Produktbeschreibung und sind keine zugesicherten Eigenschaften im Rechtssinn. Änderungen - auch in technischer Hinsicht - vorbehalten.



Contenu

1.	Bienvenue dans l'aide de COPA-DATA5			
2.	. Command Sequencer5			5
3.	Intro	duction .		6
	3.1	Comma	nd Processing - supported action types	7
	3.2	Variable	s for command sequences	7
		3.2.1	Examples of views: Display name in the command sequence grid	9
	3.3	Display	of the action name in Runtime:	9
4.	Termi	inology .		
5.	Proce	dure		
6.	Licens	sing		13
7.	Engin	eering i	n the Editor	14
	7.1	Create a	command sequence screen	14
	7.2	zenon fu	Inctions	15
		7.2.1	Execute command sequence or mode change	15
		7.2.2	Export command sequences	19
		7.2.3	Import command sequences	22
		7.2.4	Teach command sequences	25
	7.3	Comma	nd sequence screen switching	27
	7.4	Comma	nd Processing actions in the Command Sequencer module	27
		7.4.1	Behavior of "Check response value" action type	27
		7.4.2	Setpoint input for a Command Processing action	29
		7.4.3	Skip action for identical set value and actual value	
8.	Syste	m driveı	variables for the Command Sequencer module	
9.	Proje	ct backu	p for command sequences	
10.	Funct	ion auth	norizations	
11.	Comn	nand see	quences in Runtime	



11.1	Command sequences editor	
	11.1.1 Context menu - tabs with opened command sequences	
	11.1.2 Dockable windows - list of command sequences	
	11.1.3 Command sequence grid	55
	11.1.4 Modes	60
	11.1.5 Toolbar - command sequences editor (edit mode)	62
	11.1.6 Toolbar - Command sequences editor (execution mode)	92
11.2	Create command sequence	94
11.3	Tooltips	95
11.4	Execution status	96
11.5	Symbols and Color	
11.6	Validate command sequence	
11.7	Teaching	
	11.7.1 Teaching process	
	11.7.2 Dialog when teaching is canceled	
	11.7.3 Engineering	
11.8	Configuration rules for command sequences	
11.9	CEL entries	
12. Com	mand sequences and simulation mode	111
12.1	Import command sequence(s) from simulation image	
12.2	Creating a simulation image	
13. Com	mand sequences in the zenon network	114
13.1	Particular aspects for the Command Processing screen	115
13.2	Simulation images in network projects	115
13.3	Behavior in the zenon network	116
13.4	Authorization	
14. Com	mand sequences on the web client	118
15. Auth	orization	119
16. Struc	cture of the XML file for command sequences	119
16.1	XML structure for elements - complete overview	



1. Bienvenue dans l'aide de COPA-DATA

TUTORIELS VIDÉO DE ZENON.

Des exemples concrets de configurations de projets dans zenon sont disponibles sur notre chaîne YouTube (https://www.copadata.com/tutorial_menu). Les tutoriels sont regroupés par sujet et proposent un aperçu de l'utilisation des différents modules de zenon. Les tutoriels sont disponibles en anglais.

AIDE GÉNÉRALE

Si vous ne trouvez pas certaines informations dans ce chapitre de l'aide, ou si vous souhaitez nous suggérer d'intégrer un complément d'information, veuillez nous contacter par e-mail : documentation@copadata.com (mailto:documentation@copadata.com).

ASSISTANCE PROJET

Si vous vous rendez compte que vous avez besoin de licences ou de modules supplémentaires, veuillezcontacter l'équipe commerciale par e-mail : support@copadata.com (mailto:support@copadata.com)

LICENCES ET MODULES

Si vous vous rendez compte que vous avez besoin de licences ou de modules supplémentaires, veuillezcontacter l'équipe commerciale par e-mail : E-mail sales@copadata.com (mailto:sales@copadata.com).

2. Command Sequencer

The **Command Sequencer** module allows commands from the **Command Processing** module to be compiled into processes in zenon, to visualize these and to execute user interactions if required.



3. Introduction

The **Command Sequencer** module consists of three parts:

- <u>The engineering environment in the zenon Editor:</u> Here, the data for command sequences is applied from the configuration in the **Command Processing** module.
- The command sequences editor in <u>zenon</u> Runtime: With this Editor, the command sequences are created in zenon Runtime. The engineered Command Processing is the basis for command sequences. During the process, the respective status of the Command Processing is displayed in the command sequences editor and you can make changes to the command sequence process.

PARTICULAR ASPECTS OF THE COMMAND SEQUENCER MODULE

In contrast to most other zenon modules, a large part of the project configuration, e.g. the creation of a command sequence, is done in Runtime and not in the zenon Editor. This entails special features which are dealt with in the respective chapter.

The module is designed in a way which makes it completely independent of the control. This means that the data communication take place via all available zenon energy drivers with any PLCs or even IED. They only execute the process actions. The complete editing of a command sequence is carried out in the computer in the command sequences editor. No modification to the PLC code is necessary when a change is made to a command sequence.

PRINCIPLE STRUCTURE OF THE COMMUNICATION

- Command variable: The command variable is the variable that is linked during project configuration in the Command Processing module for the respective command action.
 With this variable, set values are transferred to the PLC when a step is executed.
- Response variable: This variable is used to read back values from the PLC for evaluations.

SCHEMA

The PLC communicates with the zenon Energy driver, which in turn communicates with the Command Processing in zenon Runtime. The Command Processing forwards the values to the command sequences editor, where they are processed. Whilst executing a command sequence, the command sequences editor works synchronously to zenon Runtime in a cycle of 100 ms.



3.1 Command Processing - supported action types

In order to be able to use engineered of the **Command Processing** in the **Command Sequencer** module, at least one action must be configured in the **Command Processing** module.

The following action types of Command Processing are supported in the **Command Sequencer** module:

- Command
- Forced command
- Direct set value input
 - The set value configured in the Command Processing can be transferred to the **Command Sequencer** module.
- Direct status input
- Replace
- Revision
- Direct correction
- Block
- Release
- Check response value
- Lock

Informations

You can find further information in the Energy Edition manual in the Action types chapter.

3.2 Variables for command sequences

When compiling the Command Processing, the data model for the **Command Sequencer** module is also created.

This is created as follows:

 An item of switchgear is created for each response variable, which gets the variable name or variable identification of the response variable as a name. The response variable is assigned to the created switching device. Return TAG is used as a type. Data type is: Numerical.



The naming of the switching device can be configured in the **Séquenceur de commandes** project property in the **Afficher les noms dans la grille de la séquence de commandes** property.

- A step is created for each action that is configured in the **Command Processing** module and for which a response variable is also available. The step is given the name of the action that is displayed in the Command Processing tree.
- ► The response variable is linked to each step created as a parameter. These parameters are, for example, significant when creating transitions (à la page 70).

DISPLAY NAME IN THE COMMAND SEQUENCE GRID

The text display of a variable in Runtime is configured in the **Séquenceur de commandes** project property group in the **Afficher les noms dans la grille de la séquence de commandes** property.

Depending on the configuration, the variable is displayed in the command sequence grid accordingly when shown in Runtime.

Possible display names:

- Variable name
- Variable identification
- symbolic address

VALIDATION:

A check is carried out when compiling the Runtime files in the zenon Editor.

In doing so, a check is made to see if the naming of the created switching device is unique. If this is not unique, an error message is issued in the output window of the Editor. No objects that are available for the command sequences are created for the response variable.

ERROR MESSAGES:

'<VariablenameX>' variable ignored for the command sequence data model, because the '<VariablennameY>' variable has already created an entry '<Naming in Command Sequences>'! Possible cause: not a unique ID or symbolic address.

A check is also carried out to see whether the variable can provide an invalid object name for the command sequence object.

'<Variablename>' variable ignored for the command sequence data model because this
gives and invalid '<command sequence object name' object name!
Possible Reason: empty Identification or empty symbolic Address.</pre>




3.2.1 Examples of views: Display name in the command sequence grid

Examples of views for possible configurations of the variable names.

DISPLAY NAME IN THE COMMAND SEQUENCE GRID

VARIABLE NAME



VARIABLE IDENTIFICATION



SYMBOLIC ADDRESS

SR2!A_CTRL/Q9CSWI1/Pos/stVal[ST] Check response: A9_ST[OFF]

3.3 Display of the action name in Runtime:

The text display of a Command Processing action in the Runtime is configured in the project property group Séquenceur de commandes in the Nom d'étape dans la grille de la séquence de commandes property.

Depending on the configuration, the step is displayed in the command sequence grid accordingly when shown in Runtime.

Possible display names:

- Standard text Format: Action name: RV[DIR]
- Action name Name of the Command Processing action as configured in the Nom de l'action command processing property.



VALIDATION:

A check is carried out when compiling the Runtime files in the zenon Editor.

In doing so, a check is made to see if the naming of the action created is unique. If this is not unique and there are two actions with the same name, an error message is given in the output window of the Editor:

```
The step '%s' for the switchgear '%s' will be ignored for the command sequence model because the action name is not unique.
```

Attention

This error message means that the second step with the same name is not available in Runtime for the command sequences.

4. Terminology

The following terms are used in the **Command Sequencer** module:



Parameter	Description
Switchgear	Physically available element, for example: Switch or disconnector.
Command sequences editor	Part of the Command Sequencer module to control the process of Command Processing. The command sequences editor carries out a command sequence in execution mode. The complete process of the command sequence can be configured in the command sequence and the command sequences can be administered in the editing mode.
Command sequence	Command Processing steps are compiled and saved in command sequences. These steps are then transferred to the controller by the control system.
Begin parallel branch	Element that ensures the breakdown of the command sequence process into two or more branches.
Transition	Element of the Command Sequencer module that contains a condition. The element is used after a step to ensure a defined transition from one step to the next.
Step	Execution of an action from the Command Processing, such as: Switching command: OFF.
End parallel branch	Element that combines the separation of the command sequence process into two or more branches back into one branch.
Branch	Area of the Command Sequencer module that allows separation into two or more branches, of which only one branch can be active during the process. It is an either/or branch. A branch always starts with the Begin branch and ends with the End branch element.
Assignment of switching device	Element of the Command Sequencer module that instigates the assignment of a switching device in Runtime:
	 With this element, several (or all) response variables can be reserved (assigned) in advance. The NET_SEL status bit is set for this reservation.
	 Unlocking is also carried out using a switchgear assignment element.
	 After the command sequence process, all NET_SEL status bits are automatically deleted again.
	You can find further information on the status bit in the Status processing manual in the Select in the



	network (NET_SEL) section.
Branch	An execution area in the Command Sequencer module. Steps, transitions and jump targets can be placed on it.
End of element	Element of the Command Sequencer module. This end element is mandatory in order to conclude the configuration of a command sequence correctly.
Jump target	Element of the Command Sequencer module that allows a direct jump to a defined location of a branch.
Teaching cursor	Graphic element of the Command Sequencer module. Visualizes position in the command sequence grid in which the element to be recorded is placed during the teaching process.
Command sequence grid	The workspace in the command Sequence editor in the Command Sequencer module. Actions in Runtime can be compiled into command sequences in graphic form here. the diagram is divided into a grid shape, whereby each grid offers space for an element.
Project simulation	Runtime mode in which processes - triggered by the productive process - run as a simulation.
	In doing so, it is not just one individual driver that is switched to simulation mode, but the complete project. Depending on the settings, all Runtime data is also copied to a simulation image, so that command sequences can also be recorded and analyzed in simulation mode.
Simulation mode	In contrast to hardware mode, there is no communication with the controller. The variable values are calculated using the set simulation type (static, counting or programmed).
Simulation image	Memory area in which all values of the simulation are stored.

5. Procedure

Configuration and use of the **Command Sequencer** module takes place in three main steps:

- 1. Configuration of the command processing in the zenon Editor.
- 2. Creation of the command sequences in the command sequences editor (à la page 36) in Runtime.



3. Execution of the command sequence in Runtime.

CREATION OF A COMMAND SEQUENCE

The user creates a command sequence in zenon Runtime. The selectable steps that correspond to the actions of Command Processing serve as a basis for this configuration. To do this, the command sequence in Runtime must be in edit mode.

EXECUTION OF A COMMAND SEQUENCE

The user executes the command sequence in Runtime. To do this, they first change the command sequence mode to test mode. The command sequence is then started.

The user can no longer alter command sequences in execution mode. The command sequence must be switched to edit mode again in order to edit it.

6. Licensing

The **Command Sequencer** module offers you the possibility to create, execute and configure processes of the module Command Processing in a graphic flow chart.

The module can only be licensed in addition to the **Energy Edition**.

Informations concernant la licence

Ces fonctions ou modules doivent disposer d'une licence pour l'Éditeur et le Runtime (simple, serveur, redondant et client).

If both the Batch Control module and the **Command Sequencer** module, which both require a license, are licensed at the same time, selection of the module used is carried out by means of the project setting.

To select the preferred module in Runtime:

- Click on the node of your project in the Editor.
- Go to the Paramètres du Runtime project properties group.
- Select, for Définition licence du module en runtime of the Module préféré property, Command Sequencer(default) or Batch Control.

The selected model is then available in Runtime for further project configuration.



PROJECT SIMULATION

The Project Simulation module, which requires a license, is included with the **Command Sequencer** module.

7. Engineering in the Editor

To be able to use the **Command Sequencer** module in Runtime, you must first do the following in the zenon Editor:

- Configure Command Processing.
- Configure variables (à la page 7).
- Create a Command Sequencer screen (à la page 14).
- ▶ In the Command Sequencerscreen, add the Command sequences editor control element.
- Create a screen switch function (à la page 27) for the Command Sequencer screen

If the configuration in zenon Editor changes, this is applied by compiling the Runtime files and reloading them in zenon in the **Command Sequencer** module.

7.1 Create a command sequence screen

CREATE A COMMAND SEQUENCE SCREEN

DÉVELOPPEMENT

Étapes de création du synoptique :

1. Créez un nouveau synoptique :

Dans la barre d'outils ou le menu contextuel du nœud **Synoptiques**, sélectionnez la commande **Nouveau synoptique**.

Un synoptique vide Standard est créé.

- 2. Modifiez les propriétés du synoptique :
 - a) Nommez le synoptique dans la propriété Nom.
 - b) Select Command Sequencer in the Type de synoptique property.
 - c) Sélectionnez le cadre souhaité dans la propriété Gabarit.
- 3. Configurez le contenu du synoptique :



- a) Sélectionnez l'option de menu Éléments de contrôle dans la barre de menus
- b) Sélectionnez Insérer un modèle dans la liste déroulante.
 La boîte de dialogue de sélection de mises en forme prédéfinies s'affiche à l'écran. Certains éléments de contrôle sont insérés dans le synoptique à des positions prédéfinies.
- c) Supprimez les éléments superflus du synoptique.
- d) Si nécessaire, sélectionnez des éléments supplémentaires dans la liste déroulante **Éléments**. Placez-les aux emplacements souhaités sur le synoptique.
- 4. Créez une fonction d'appel de synoptique.

7.2 zenon functions

The following functions are available for the **Command Sequencer** module:

- Execute command sequence or mode change (à la page 15): sends control commands to Command Sequencer execution
- Export comannd sequence (à la page 19): exports command sequences as an XML file. Content of the XML files can be filtered.
- Import command sequences (à la page 22)
 This function imports command sequences from a XML file.
- Teach command sequences (à la page 25) Starts or stops teaching mode.

7.2.1 Execute command sequence or mode change

You can send control commands to the Command Sequencer execution with this function.

To create the function:

- 1. In the zenon Editor, navigate to the **Functions** node
- 2. Select New function
- 3. Go to the Command Sequencer in the function selections
- 4. select Exécuter la commande des séquences de commandes ou le basculement de mode.



5. the dialog for configuring functions is opened



ACTION

Parameter	Description
Action	Selection of the action to be executed:
	Command
	Mode
Command	Selection of the command to be executed from drop-down list:
	 Ignore Does not execute a command sequence command (Start or Cancel). Note: If automatic or semi-automatic is configured under mode, only one mode switch is executed.
	 Start command sequence Starts identified command sequence(s)
	 Cancel command sequence Cancels identified command sequence(s)
Mode	Selection of the mode in which the command sequence is to be executed: Selection of the mode from a drop-down list:
	Ignore The command sequence(s) identified by the function is executed in the existing mode of the command sequence.
	Automatic The command sequence(s) identified by the function is executed in Automatic mode.
	Semi-automatic The command sequence(s) identified by the function is executed in Semi-automatic mode.

COMMAND SEQUENCE FILTER

Parameter	Description	
Command sequence filter	Configuration of the command sequence filter. This determines the command sequences on which the function is to be applied.	
Name is case sensitive	When filtering for command sequence commands, capital letters and small letters in the command sequence name are taken into account. Default: Inactive	



Command sequence	Parameters for the selection of the command sequence. Select from drop-down list:
	 Name with wildcards: A name with placeholder can be entered into the input field. Filtering is carried out according to this name. Wildcards are: *: any desired number of any characters * can be entered at the start, at the end or and the start and end in the input field. Note: The input field is only active with this option.
	 Name from variable: The name of the command sequence is taken from a variable in Runtime. Click on button opens the dialog for selecting variables.
	 ID from variable: The ID of the command sequence is taken on by the ID from a variable. Click on the button opens the dialog for selecting variables.


FERMER BOÎTE DE DIALOGUE

Options	Description :
ок	Applique les paramètres et ferme la boîte de dialogue.
Annuler	Annule toutes les modifications et ferme la boîte de dialogue.
Aide	Ouvre l'aide en ligne.

Informations

You can find detailed information for the configuration of the function in the configuration of the command sequence filter chapter.

ERROR DIALOG

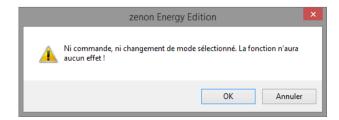



If, for Command and Mode, the Ignore property is configured for each, the function will not have an effect in Runtime. An error message is shown in this case.

7.2.2 Export command sequences

You export configured command sequences to an XML file using this function. The content of the export can be filtered.

To create the function:

- 1. In the zenon Editor, navigate to the **Functions** node.
- 2. Select New function.
- 3. Go to the **Command Sequencer** in the function selections.
- 4. Select Exporter séquences de commandes
- 5. The dialog for configuring functions is opened.

Séquenceur de commandes	×
xport XML	
File de claure de comme des	Ok
Filtre de séquence de commandes Le nom de la séquence de commandes dépend de la casse (majuscules/minuscules)	Annuler
Séquence de commande	Aide
État de la séquence de commandes	
Tout	
Fichier de sortie	
Nom de fichier v	
Vote : les fichiers sans chemin seront créés dans le dossier d'export	
Afficher boîte de dialogue dans le Runtime	



COMMAND SEQUENCE FILTER

Parameter	Description
Command sequence name is case sensitive	When selecting the command sequences to be exported, the capitalization of the command sequence name is taken into account.
Command sequence	 Name with wildcards Selection of the command sequences to be exported with the command sequence names. Entry of the search term in the input field. The following are wildcards: *: any desired number of any characters * can be entered at the start, at the end or and the start and end in the input field. Note: The input field is only active with this option. Name from variable The name of the command sequences to be exported are taken from a variable in Runtime.
	 Click on to open the dialog to select a variable. ID from variable The ID of the command sequences to be exported are taken by the ID from a variable. Click on to open the dialog to select a variable.
Status command sequence	Selection of the status of the command sequences to be exported:
	 All All command sequences are exported.
	 Edit mode Only command sequences that are currently in edit mode are exported.
	 Execution mode Only command sequences that are currently in execution mode are exported.

OUTPUT FILE

Parameter	Description
Naming	 Drop-down list to select how the output file is named: File name: Name of the target file can be freely defined. Input of the file name in the input field



	 File name from variable: Name of target file is taken from a configured variable. Click on to open the dialog to select a variable.
	 File name from command sequence name Name of the target file is named the same as the command sequence name to be exported
	 File name from command sequence ID File is named with the command sequence ID.
Overwrite existing file	Defines behavior if there is already an export file. If the checkbox is activated, the existing file is automatically overwritten (without another request for confirmation).
	Default: active
Show this dialog in the Runtime	Active : La boîte de dialogue de filtre est affichée dans le Runtime avant l'exécution de la fonction.
	Default: Inactive

FERMER BOÎTE DE DIALOGUE


Options	Description :
ок	Applique les paramètres et ferme la boîte de dialogue.
Annuler	Annule toutes les modifications et ferme la boîte de dialogue.
Aide	Ouvre l'aide en ligne.

ERROR DIALOG

A warning dialog appears in the event of an incorrect configuration of the export function:

- The search value for command sequence is empty: No command sequence for export could be found. Check the project configuration in the command sequence filter area.
- The value for the naming of the target file is empty: No command sequence for export could be found. Check the project configuration in the output file area.





Note: The screenshot shows both possible causes of errors. Only one of the errors given can be displayed depending on the error.

Parameter	Description
Yes	The dialog of the function is closed. The dialog to configure the function is also closed.
Νο	The warning dialog is closed. The dialog to configure the function remains open for configuration of the function again.
Informations	

You can get further information on the structure of the XML file in the Structure of the XML file for command sequences (à la page 119) chapter.

7.2.3 Import command sequences

You import command sequences from an XML file using the function.

To create the function:

- 1. In the zenon Editor, navigate to the **Functions** node.
- 2. Select New function.
- 3. Go to the **Command Sequencer** in the function selections.
- 4. Select Importer séquences de commandes.



5. The dialog for configuring functions is opened.

	Séquenceur de commande	s	×
Importer XML			
source d'import			Ok
Nom de fichier			Annuler
○ Variable	<aucune liée="" variable=""></aucune>		Aide
Note ; un fichier san:	chemin sera cherché dans le dossier d'export		
options d'import	fits de noms dans les séquences de commandes		
	le séquence de commandes		
O Ecraser la séquer	ce de commandes existante		
 Sauter 			
Afficher boîte de dia	logue dans le Runtime		

Informations

Existing command sequences are only overwritten on import if they are in the command sequences editor.

More precise information on import can also be visualized using the two system driver variables [command sequences] import event numerical and -[command sequences] import event string.

IMPORT SOURCE

ç

Selection of the import source for the import of a command sequence:

- ► File name
- ► From variable



Parameter	Description
File name	Selection of the XML import file. Clicking on opens the dialog to select the file.
From variable	The name of the import file is taken from the selected variable. Click on to open the dialog to select the variable.

IMPORT OPTIONS

Parameter	Description
Action for name conflicts in command	Behavior in the event of naming conflicts:
sequences	 Create new command sequence A new command sequence is created. Naming of the new command sequence: [command sequence name from XML file] + [serial number].
	 Overwrite old command sequence Existing command sequence is overwritten/replaced with content from XML import.
	 Skip No import is carried out for command sequences that already exist.
Show this dialog in the Runtime	Active: This dialog is opened in Runtime before the function is executed.
	Default: Inactive



FERMER BOÎTE DE DIALOGUE

Options	Description :
ок	Applique les paramètres et ferme la boîte de dialogue.
Annuler	Annule toutes les modifications et ferme la boîte de dialogue.
Aide	Ouvre l'aide en ligne.

ERROR DIALOG

A warning dialog appears in the event of an incorrect configuration of the import function:

 The search value for file name of the data source is empty: No command sequence for import could be found. Check the project configuration in the command sequence filter area.

	zenon Energy Edition	
4	La configuration est mauvaise : L'export ne peut pas être effectué ! - La valeur recherchée pour le nom du fichier de la source est vide Ferme le dialogue ?	
	Oui Non	

Parameter

Q

Yes

No

Description

The dialog of the function is closed. The dialog to configure the function is also closed.

The warning dialog is closed. The dialog to configure the function remains open for configuration of the function again.

Informations

You can get further information on the structure of the XML file in the Structure of the XML file for command sequences (à la page 119) chapter.

7.2.4 Teach command sequences

Start or stop the teaching process in Runtime using this button.

This function is particularly suitable for starting teaching in Runtime in a process screen, without having to switch to the command sequences editor.

To create the function:



- 1. In the zenon Editor, navigate to the **Functions** node.
- 2. Select New function.
- 3. Go to the **Command Sequencer** in the function selections.
- 4. Select Apprendre les séquences de commande
- 5. The dialog for configuring functions is opened.

Séquenceur de commandes	×
Démarrer/Arrêter l'apprentissage	
Options d'apprentissage Démarrer l'apprentissage Arrêter l'apprentissage	Ok Annuler Aide
Afficher boîte de dialogue dans le Runtime	

Parameter	Description
Start teaching	Starts a new teaching process.
	In doing so, a new command sequence with a standard name is created. The teaching cursor is initially positioned in this command sequence in the command sequence grid under the start element.
	Note: Runtime must be in simulation mode for this!
	You can find further information in the Teaching (à la page 101) chapter.
Stop teaching	Ends teaching.
Show this dialog in the Runtime	Active: This dialog is opened in Runtime before the function is executed. Start teaching or Stop teaching can be selected in Runtime.
	Default: Inactive

FERMER BOÎTE DE DIALOGUE

Options	Description :
ок	Applique les paramètres et ferme la boîte de dialogue.
Annuler	Annule toutes les modifications et ferme la boîte de dialogue.
Aide	Ouvre l'aide en ligne.



7.3 Command sequence screen switching

To use command sequences in Runtime, configure a screen switch function to a Command Sequencer screen:

- 1. Select the **New function** command in the **Functions** node.
- 2. select the Screen switching function.
- 3. Select the Command Sequencer screen.

Link the function with a button on the screen in order to be able to switch in Runtime.

Informations

The configuration of the Command processing module serves as a basis for operation in the Command Sequencer screen.

7.4 Command Processing actions in the Command Sequencer module

In this chapter, you are provided with additional information on the behavior of configured Command Processing actions in the **Command Sequencer** module.

7.4.1 Behavior of "Check response value" action type

The "Check response value" action type is used with command sequences in particular to check the value of the response variable.

To be able to use the "Check response value" action type in the **Command Sequencer** module, this action type must be configured as an action in a command group in the **Command Processing** module in the zenon Editor.



Attention

This action type is not used in principle in the Command Processing. It was specially conceived for use in the **Command Sequencer** module.

For Command Processing, it is possible to configure this query using action buttons and to receive responses in Runtime.

The Check response value action type is to check variables for the status ON or OFF.

Whilst the **Check response value** action is executed, the standard key **Cancel** is unlocked in the **Command Processing** screen.

In doing so - depending on the setting of the **runtime monitoring** - there is a wait until the value of the response variable corresponds to the value of the checking direction - **switching direction** action property. If the checking value is EIN, this is the value 1; it is the value 0 for OFF.

If no runtime monitoring has been configured (runtime monitoring= "none"), the set waiting time (~24 hours) is the maximum time that is waited. Otherwise the action is ended and the TIMEOUT status bit is set for the response variable.

If, after execution of the action in the Command Processing screen, the other actions are not available, this is for the following reasons:

- The timeout for runtime monitoring has not yet expired.
- The response variable does not yet have the expected value (the value change has not yet been received).
- The action has not yet been canceled with the **Cancel** button.

Informations

The *Check response value* action only serves to read the value of the response variable without executing an activity.

The action is intended for use in the **Command Sequencer** module.

If the response variable already has the value of the **switching direction**, the execution of the action is recognized as completed. The other buttons in the Command Processing screen are thus immediately available.

Note: If the response variable is set to OFF or Revision , the response value can nevertheless be checked.



7.4.2 Setpoint input for a Command Processing action

If a setpoint input action is configured in the **Command Processing** module, a set value of the Command Processing can be transferred in both the Command Processing module and the **Command Sequencer** module.

WRITE SET VALUE WITH INPUT

Procedure for a setpoint entry with manual entry of value in the **Command Sequencer** module:

- When processing a command sequence, the Command Processing screen is opened during the Write set value with input step: The value of the command variables element is available and filled with the current value. The Execute button is active. Action buttons are not active.
- The scroll bar is available and filled with the current value.
- The value is accepted after clicking on **Execute**.
- The execution of the switching sequences is continued with the new value.

WRITE SETPOINT VALUE WITH GIVEN VALUE

This value is configured in the Command Processing module in the **Paramètres d'action** property with the **Spécifier valeur prescrite** property. If a value is to be proposed in Runtime, the **État de la réponse/direction de commutation** property in the zenon Editor must be configured for the Command Processing action with DIR. In this case, a value is prescribed in the Editor in the **Spécifier valeur prescrite** property.

TWO-STAGE EXECUTION

- ► The value is written after successful confirmation with two-stage execution and a check of the interlockings.
- The old value is still visible in the grayed-out input field whilst there is a wait for the confirmation or unlocking.

Informations

The Command Processing action *Write set value with entry of the value* is only possible from zenon 7.50.

Informations

You can find further information in the Energy Editionmanual, in the Command Processing and Actiontype "Write set value" chapters.



7.4.3 Skip action for identical set value and actual value

If the **Ignorer l'action lorsque la valeur prescrite et la valeur réelle sont identiques** property in the zenon Editor has been activated, the values of the response variable are checked with the setpoint input during the process of the command sequence in Runtime.

The step is skipped if both values are identical. This is also shown accordingly in the tooltip (à la page 95) of the step (= skip).

8. System driver variables for the Command Sequencer module

The following system driver variables are available for this subject area:

Note: This group is only visible with a valid license for the **Command sequences** module.



Name	Data Type	Comment
[Command Sequencer] Number of pending user	DINT	Number of command sequences with pending user interaction that are currently running.
interactions		If the operation has been executed or the command sequence has been completed, the numeric value is reduced by 1.
		If several steps are waiting for an operation in a command sequence, the numeric variable is incremented for each step.
[Command Sequencer]	DINT	Number of command sequences currently running.
Number of running command sequences		The system variable is updated both at the start and end of a command sequence.
[Command Sequencer]	DINT	Result of the XML export:
Export result numeric		-1: is being executed
		• 0:
		Initialization value read successfully
		 from 1: Number of errors that occurred
[Command Sequencer]	STRING	Result of the XML export as a text.
Export result string		► No errors occurred.
		 XML export error: The export file [save location] \ [File Name] already exists and must not be overwritten. Note: Only occurs if the Overwrite existing file property is not active in the export dialog and there is already a file with the same name in the export folder.
[Command Sequencer] Export result XML	STRING	Detailed content of the XML export.
		This variable visualizes the content of the XML export. The following are displayed:
		▶ Name
		Version
		▶ Туре
		▶ ID
		Note: If the content exceeds the maximum length of the system driver variable, the result is shortened.
[Command Sequencer]	DINT	Result of the XML import:
Import result numeric		 -1: is being executed



•	0: Initialization value read successfully
•	from 1: Number of errors that occurred



[Command Sequencer]	STRING	Posult of the XML import as a text:	
Import result string		Result of the XML import as a text:	
		 The command sequence was not found. The command sequence therefore cannot be imported. 	
		 The command sequence could not be overwritten due to an incorrect status. 	
		 The command sequence cannot be imported as a new version. The versioning is not active. 	
		 The command sequence could not be imported. It does not match the selected type. 	
		 The command sequence could not be imported because the name is not permissible. 	
[Command Sequencer] Import result XML	STRING	Detailed content of the XML import.	
• • • • • •		This variable visualizes the content of the XML export. The following are displayed:	
		▶ Name	
		Version	
		▶ Туре	
		▶ ID	
		Note: If the content exceeds the maximum length of the system driver variable, the result is shortened.	
[Command Sequencer] Name of the active teached command sequence	STRING	Name of the command sequence that is currently being taught. The command sequence names are used once the teaching process has been started.	
		If a teaching process has been completed, the value of this variable switches to empty.	
[Command Sequencer] Names of the running command sequences	STRING	Names of the command sequences currently running: With several command sequences, the command sequence names are separated by a semicolon (;).	
[Command Sequencer] Names of command	STRING	Names of command sequences running with user interactions pending.	
sequences with pending user interaction		If several steps are waiting for an operation in a command sequence, the command sequence name is only entered once and is retained until all steps have been executed.	
		With several command sequences, the command sequence names are separated by a semicolon (;).	
[Command Sequencer]	DINT	Status for the teaching process. Shows whether teaching	



Teaching status	 is currently active or not active. 0 - Teaching is not active. 1 - Teaching cursor waits for positioning (this status is active until the teaching cursor in the command sequences editor has been placed) 2 - Teaching is active. This variable has the value 2 in the event of an ongoing teaching process. If a teaching process has been completed, the value of this variable switches to 0.
-----------------	--

Informations

If a computer in redundancy operation upgrades to become the server, it sets the value of the system driver variables to 0 (numerical variables) or empty string (string variables).

Informations

You can find out further information in the system driver manual.

9. Project backup for command sequences

A project backup in the zenon Editor does not take into account the command sequences configured in Runtime.

Back up the corresponding Runtime files manually.

BACKING UP THE COMMAND SEQUENCE RUNTIME FILES

To back up the Runtime files of configured command sequences:

1. Switch to the folder of the Runtime files. C:\Users\Public\Documents\zenon_Projects\[Workspacename]\[Projekt name]

Note: This folder is only available if the project has been compiled at least once in zenon .



Tip: Highlight the desired project in the zenon Editor and press the keyboard shortcut Ctrl + Alt + R to go directly to the Runtime folder.

- 2. Copy the Sequences folder.
- 3. Add the Sequences folder to the Runtime folder of the project backup again. Note: Runtime should be closed during the copy process or restarted again after copying.

10. Function authorizations

From zenon version 7.50, function authorizations are also supported by the **Command Sequencer** module.

They are configured in the **User administration** module. In doing so, a distinction is made between Editor authorizations and Runtime authorizations.

There are separate Runtime function authorizations available for the **Command Sequencer** module:

- Function authorizations for XML import and export
- Function authorizations to control the process of a command sequence

Informations

You can find further information on the configuration of function authorizations in the User administration manual.

You can find the special function authorizations for the **Command Sequencer** module in the Runtime function authorizations chapter.

Attention

Configurations of the **Command Processing** module always have priority over configured function authorizations for the **Command Sequencer** module during execution.

This ensures that there is no blockade during the course of a command sequence.

11. Command sequences in Runtime

All administration, creation and processing of command sequences is carried out in Runtime. Editing in the zenon Editor is not possible.



SAVING OF COMMAND SEQUENCES WHEN CLOSING RUNTIME

If Runtime is closed and there are still command sequences that have not been saved, you are asked if these command sequences are to be saved. In order for this query to not prevent Runtime closing, Runtime is automatically closed after 15 seconds if nothing is entered. Unsaved command sequences are then discarded.

zen	on Energy Edition	×			
The screen will be closed. Save changes? Automatic cancel after 15 seconds!					
	Yes	No			

- Clicking on the Yes button saves all changes for all command sequences open in the command sequences editor. Runtime is then closed.
- Clicking on the **No** button closes Runtime without saving changes to the command sequences.

11.1 Command sequences editor

The command sequences editor is the graphical user interface for the configuration of command sequences in Runtime.

The following are available for the command sequences editor:

- Toolbars The design of the toolbars depends on the command sequences editor mode (à la page 60).
- Tabs
- Command sequence grid (à la page 55) project configuration area



Dockable windows

4 substation_bachstreet /*smart grid FirMoun X b // ID s	Image: Constraint of the section
Image:	Filtre texte V Filtre texte </th
ED70; se2, 309; EV ED71; se2, 309; EV	Filtre texte V Filtre texte </th
Image:	2 Teaching_11 Automatique Stop Mode édition 3 Teaching_12 Automatique Stop Mode édition
Correction manuallet (ED70]_sec2_309 IED70_sec2_309_FV Bloquer: (ED70_sec2_309_FV) Commande communition: (ED70_sec2_309_FV) Commande communition: (ED70_sec2_309_FV) ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV	2 Teaching_11 Automatique Stop Mode édition 3 Teaching_12 Automatique Stop Mode édition
Correction manuallel: ED70, sec2_309 IED71, sec2_309 IED71, sec2_309 IED71, sec2_309 Commande communition: ED70, sec2_309 Commande communition: ED70, sec2_309 IED71, sec2_309	
Correction manuallet (ED70]_sec2_309 IED70_sec2_309_FV Bloquer: (ED70_sec2_309_FV) Commande communition: (ED70_sec2_309_FV) Commande communition: (ED70_sec2_309_FV) ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV ED71_sec2_309_FV	Construction Operations Ober
Correction manuallel ED701_sec2_309 IED701_sec2_309_FV Bloquer: ED701_sec2_309_FV ED701_sec2_309_FV Commande communition: ED701_sec2_309_FV(2) ED701_sec2_309_FV(2) ED701_sec2_309_FV(2) ED701_sec2_309_FV(2) ED701_sec2_309_FV(2)	5 sample_for_teaching Semi-automatique Stop Mode edition
Correction manuallel ED701_sec2_309 IED701_sec2_309_FV Bloquer: ED701_sec2_309_FV ED701_sec2_309_FV Commande communition: ED701_sec2_309_FV(2) ED701_sec2_309_FV(2) ED701_sec2_309_FV(2) ED701_sec2_309_FV(2) ED701_sec2_309_FV(2)	7 teaching_sample_2 Automatique Stop Mode test
IED70_sec2_309_EV Bloquer:IED70_sec2_309_EV Vertication:IED70_sec2_309_EV Vertication:IED70_sec2_309_EV(s) IED70_sec2_309_EV(s) IED70_sec2_309_EV(s) IED70_sec2_309_EV	11 0_docu_samples Automatique Stop Mode édition
Bloquer: IED70_sec2_309_RV IED70_sec2_309_RV Commande commutation: IED70_sec2 IED70_sec2_309_RV(0) IED70_sec2_309_RV(0) IED70_sec2_309_RV(0) IED70_sec2_309_RV IED70_sec2_309_RV	15 substation_koestendorf Automatique Stop Mode édition
Bioquer: ED70; sec2_309_RV IED70; sec2_309_RV Commande.commutation: IED70; sec2_ IED70; sec2_309_RV Etx070; sec2_309_RV IED70; sec2_309_RV IED70; sec2_309_RV IED70; sec2_309_RV IED70; sec2_309_RV IED70; sec2_309_RV	16 substation_bachstreet Automatique Stop Mode édition
IED70_sec2_309_EV Commande communication: IED70_sec2 Evroi de l'état: ED70_sec2_309_EV(a) IED70_sec2_309_EV(a) IED70_sec2_309_EV(a)	17 smart grid FirMountain Automatique Stop Mode édition
Commande commutation: IED70_sed309_sV(0) IED70_sed309_sV(0) Ervoi de l'état: IED70_sed_309_sV(0) IED70_sed_309_sV(0)	18 endless Automatique Stop Mode édition
✓ I III x 11 celules / 7 éléments l₂ - /- 100% • ⊙	

Parameter	Description	
Header of the editor	Information about:	
	 Current command sequence 	
	► Mode	
Command sequences editor	Menu bar (à la page 62) with symbols to configure a command sequence.	
Tabs with opened command sequences	Select the open command sequences by clicking on the respective tab.	
	In execution mode, the color of the tab corresponds to the color of the execution status (à la page 96) of the command sequence.	



Command sequence grid	Diagram of the project configuration.		
	Configuration by dragging & dropping the elements from the menu bar.		
	Hint: To enlarge or reduce the grid, position the mous pointer at the edge and drag it in the desired direction with the mouse button held down.		
Mode display	Status display of the selected mode:		
	Edit mode:		
	Symbol for editing mode (pencil)		
	Size of the command sequence grid		
	Number of configured elements		
	Execution mode:		
	 Symbol for execution mode: Automatic Manual 		
	 Symbol for the status (green thumb: ready to start) 		
	 Execution step: - in execution - completed 		
Cursor position	Shows line and column of the selected choice in the command sequence grid.		
Zoom bar	Setting of the zoom factor for the command sequence grid with slider.		
+	Enlarges the zoom factor by 25% per click.		
-	Reduces the zoom factor by 25% per click.		
Selection of the dockable windows	Opens drop-down list to select the dockable windows:		
	 List of command sequences (à la page 40) 		
	Selected dockable windows are shown or hidden.		

11.1.1 Context menu - tabs with opened command sequences

If several command sequences are open in the command sequences editor, these are represented with tabs. The tabs represent the command sequences that are open in the command sequences editor. The configuration of the command sequence in the command sequence grid is shown by clicking on a tab.



TAB CONTEXT MENU

Parameter	Description
Save	Saves the current command sequence
Close	Closes the current command sequence
Close all others	Closes all open tabs/command sequences with the exception of the one that is currently selected.
Group horizontally	Shows all open tabs in a new view. The view opens in a new window under the current view:
	 Move view Opens the tab in a new window.
	 Open view at the same time Opens the selected tab in a new window and leaves it in the list of tabs.
Group vertically	Shows all open tabs in a new view. The view opens in a new window next to the current view:
	 Move view Opens the tab in a new window.
	 Open view at the same time Opens the selected tab in a new window and leaves it in the list of tabs.

Command sequences can be displayed and opened in two groups next to each other or underneath each other. To open a command sequence in a new group:

- 1. Select, in the context menu of the command sequence, the **Group horizontally** or **Group vertically** command
- Select the type of display:
 - Move display
 - Open display at the same time

The control elements are always only applicable to the active command sequence of the active group.

- The active group is emphasized in color.
- The active tab is emphasized with bold font. Information on the active tab is shown in the title bar of the editor.
- Tabs can be moved and arranged by dragging & dropping, including between groups.
 Hint: Use this possibility of moving to return to the view with one group when two groups are open.



11.1.2 Dockable windows - list of command sequences

The list of command sequences lists all configured command sequences. Command sequences that have already been configured are edited and administered in the list of command sequences and new command sequences are created.

Liste des séquences de comman	des				ά×
🎦 🗁 🖃 🗈 🗙 📾	뜭 🍓 🦯 🔟 🔐				
Nom de la séquence de c	Description séquence de commandes	ň	État séquence	État d'exécution	Mode d'exécution
Filtre texte 🛛 🖓	Filtre texte	V	Filtre texte 🛛 🖓	Filtre texte 🛛	Filtre texte
test-sequence 1			Mode édition	Stop	Automatique
SI_01_mode_test			Mode édition	Stop	Automatique
SI_01_sample_semi-aut			Mode édition	Stop	Automatique
Duplication 1			Mode édition	Stop	Automatique
SI_01_sample_automati			Mode test	Stop	Automatique
TintiFax			Mode édition	Stop	Automatique
SI_01_mode_edit			Mode édition	Stop	Automatique
SI_01_sample			Mode test	Stop	Automatique
SI_01_test			Mode édition	Stop	Automatique
SI_01_mode_execute 2			Mode édition	Stop	Automatique
SI_01_sample_automati			Mode édition	Stop	Automatique
Duplication			Mode édition	Stop	Automatique
SI_01_mode_execute			Mode édition	Stop	Automatique
SI_01_sample_automatic			Mode édition	Stop	Automatique
test-sequence			Mode édition	Stop	Automatique
Duplication 2			Mode édition	Stop	Automatique
SI_01_mode_execute 1			Mode édition	Stop	Automatique
test-sequence 2			Mode édition	Stop	Automatique

LIST OF COMMAND SEQUENCES - OVERVIEW:

The following is possible in the list of command sequences:

- ▶ New command sequences can be created.
- Command sequences that have already been configured in the command sequences editor are loaded for further editing.
- Command sequences are renamed.
- Command sequences are duplicated.
- Command sequences are deleted.
- Command sequences are switched to execution mode.
- Command sequences are switched to edit mode.
- Columns are selected and formatted.

The columns of the list for command sequences can be sorted and filtered. The columns can be moved by means of drag&drop. Columns can be shown and hidden with the context menu (right mouse click).



Selection and positioning

AIDES AU POSITIONNEMENT

Lors du déplacement de fenêtres depuis l'interface d'Editor, les aides au positionnement sont affichées. Celles-ci représentent les fenêtres ou leurs bordures.



Cet élément représente la zone d'une fenêtre dans Editor.

Cet élément représente la bordure d'une fenêtre dans Editor.

POSITIONNER LA FENÊTRE

Pour positionner un élément en tant qu'élément ancré :

- 1. A l'aide de la souris, déplacez l'élément vers la zone souhaitée...
- 2. L'aide au positionnement est affichée.
- 3. Ceci représente une fenêtre et ses zones :
 - a) Centre : fenêtre entière
 - b) Haut : moitié supérieure
 - c) Bas : moitié inférieure
 - d) Droite : moitié droite
 - e) Gauche : moitié gauche

...Ou vers le bord de la fenêtre d'Editor.

- 4. Déplacez la souris vers l'aide au positionnement centrale ou vers une aide au positionnement située sur la bordure d'Editor, puis déplacez-la vers la zone souhaitée.
- 5. La zone d'Editor dans laquelle l'élément a été placé lorsque le bouton de la souris a été relâché est colorée en bleu.
- 6. Déplacez la souris dans l'aide au positionnement jusqu'à atteindre la zone souhaitée, affichée en bleu
- 7. Relâchez le bouton de la souris pour placer l'élément.



Si une fenêtre est placée sur une fenêtre existante, les deux fenêtres sont affichées au même emplacement, à l'aide d'onglets.

Toolbar - list of command sequences

🎦 🗇 ! 🗐 🗅 🗙 ! 🚓 🐻 ! 🐺 ! 🦠 🖍 ! 💷 🔐



Parameter	Description
New command sequence	Creates new empty command sequence.
Open command sequence in Editor	Opens the selected command sequence in the command sequences editor.
	Note: Not active if no command sequence is selected.
Rename command sequence	Opens dialog to create a new command sequence or rename a command sequence.
	Note: Not active if no command sequence is selected.
	Note: Not active if the selected command sequence is in execution mode.
Duplicate command sequence	Duplicates selected command sequence and opens dialog to create a new command sequence.
	Note: Not active if no command sequence is selected.
	Note: duplicated command sequence is automatically created in edit mode. When duplicating command sequences, the existing name is supplemented with the prefix "Copy of" . If the maximum length is exceeded by this, the name is shortened to the allowed length starting from the last character.
Delete command sequence	Deletes selected command sequence(s). Multiple selection is possible.
	A command sequence that is executed cannot be deleted. An information dialog opens in this case.
	Note: Not active if no command sequence is selected.
	Note: Before final deletion, an dialog appears requesting confirmation of whether the selected command sequence(s) are really to be deleted for good.
Exporter la sélection en XML	Exports selected command sequences as an XML file. Multiple selection is possible.
	Note: Not active if no command sequence is selected.
	You can find further information in the Export command sequence(s) as XML file (à la page 47) chapter.
Import XML	Imports command sequence(s) from an XML file.
	You can find further information about this in the Import command sequence(s) from XML file (à la page 49) chapter.
	Note: not active if the user does not have the corresponding function authorization.
	The Command Sequences function authorization:



	Import command sequences is applicable for both XML import and for the import of simulation images.
Import command sequence from simulation image	Imports command sequence from existing simulation images.
	You can find further information on this in the import command sequence(s) from simulation image (à la page 51) chapter.
	Note: not active if the project is running in simulation mode or if the user does not have the corresponding function authorization.
	The Command Sequences function authorization: Import command sequences is applicable for both XML import and for the import of simulation images.
Switch command sequence to execution mode	Switches selected command sequence(s) to execution mode (à la page 92). A validation of the configured command sequence is carried out automatically. Execution mode only starts if the command sequence has been configured without errors.
	Otherwise a notice dialog appears informing you that the command sequence is invalid. The command sequence cannot be started.
	Note: Not active if no command sequence is selected.
Switch command sequence to edit mode.	Switches a command sequence that is currently running in execution mode back into edit mode (à la page 62) in order to make changes.
	Note: Not active if no command sequence is selected.
Column selection	Opens a dialog (à la page 44) to select columns that are to be displayed.
Column formats	Opens dialog (à la page 47) for the configuration of text and background colors for the display of columns in the list view.

Column selection



Paramètres des colonnes Sélection colonne Colonnes disponibles : Driver Justification de la modification de valeu Longueur String Modifiable dans une recette de contrôl Modifié Nom driver Synoptique davier Type de la variable Unité Utiliser le synoptique clavier Variable valeur max. Variable valeur min.	Ajouter -> Ajouter tout -> <- Supprimer	Colonnes sélectionnées : Nom Description Type de données du tag Variable Valeur Valeur min. Valeur max. Modifiable dans recette	Ok Annuler
		Vers le haut Vers le bas	



Options	Fonction
Colonnes disponibles	Liste de colonnes pouvant être affichées dans la table.
Colonnes sélectionnées	Colonnes affichées dans la table.
Ajouter ->	Déplace la colonne sélectionnée des colonnes disponibles vers les éléments sélectionnés. Lorsque vous confirmez la boîte de dialogue en cliquant sur OK, ces colonnes sont affichées dans la vue de détail.
Ajouter toutes ->	Déplace toutes les colonnes disponibles vers les colonnes sélectionnées.
<- Supprimer	Supprime les colonnes marquées des éléments sélectionnés et les affiche dans la liste des colonnes disponibles. Lorsque vous confirmez la boîte de dialogue en cliquant sur OK, ces colonnes sont supprimées de la vue de détail.
<- Supprimer tout	Toutes les colonnes sont supprimées de la liste des colonnes sélectionnées.
Haut	Déplace l'entrée sélectionnée vers le haut. Cette fonction est uniquement disponible pour les entrées uniques ; les sélections multiples ne sont pas autorisées dans ce cas.
Bas	Déplace l'entrée sélectionnée vers le bas. Cette fonction est uniquement disponible pour les entrées uniques ; les sélections multiples ne sont pas autorisées dans ce cas.

FERMER BOÎTE DE DIALOGUE

Options	Description :	
OK Applique les paramètres et ferme la boîte de dialogue.		
Annuler Annule toutes les modifications et ferme la boîte de dia		
Aide Ouvre l'aide en ligne.		



Column format

F	Paramètres des colonnes		×
F	Paramètres des colonnes Format des colonnes Colonnes disponibles Nom Description Type de données du tag Variable Valeur Valeur max. Modifiable dans recette	Paramètres Texte Nom Largeur 29 Caractère Alignement	Ok

Parameter	Description	
Available columns	List of the available columns via Column selection . The column selected here is configured using the settings in the Parameters section.	
Parameter	Settings for selected column.	
Labeling	Name for column title. The column title is online language switchable. To do this, you must enter the @ character in front of the name.	
Width	Width of the column in characters.	
Alignment	Alignment.	
	Possible settings:	
	Left: Text is justified on the left edge of the column.	
	Centered: Text is displayed centered in the column.	
	Right: Text is justified on the right edge of the column.	
ок	Applies settings and closes the dialog.	
Cancel	Discards settings and closes the dialog.	

Exporting the command sequence(s) as an XML file

You export selected command sequences as an XML file with the **Export selected XML** button. To do this, select the desired command sequences from the list of configured command sequences (multiple selection is possible). With multiple selection, only one XML file is saved for all selected command sequences.



NOTE DIALOG: EXPORT COMMAND SEQUENCE

Before export, a check is carried out to see if there are unsaved changes in a command sequence configuration.

Conseil

Command sequences with unsaved changes are visualized in the tab of the command sequences editor with a * before the command sequence name.

Parameter	Description
[Name of the command sequence]	Name of the command sequence that still has unsaved changes.
	It is always only the current command sequence name that is displayed. After clicking on the Yes or No button, the next command sequence with unsaved changes is displayed.
Yes	The current command sequence is saved before the save process. The save dialog is then opened.
Νο	Exports the displayed command sequence with the last-saved project configuration status. The save dialog is opened directly.
Yes all	All open command sequences with unsaved changes are saved before the save process. The save dialog is then opened.
	Note: not active if only one command sequence was selected for export.
No all	Exports all selected command sequences with the last-saved project configuration status. The save dialog is opened directly.
	Note: not active if only one command sequence was selected for export.

Informations

You can get further information on the structure of the XML file in the Structure of the XML file for command sequences (à la page 119) chapter.



Import command sequence(s) from an XML file

The **Import XML** button opens the dialog to import command sequences from an XML file in the list of command sequences.

Once the corresponding XML file has been selected, the import checks whether already-configured command sequences conflict with the command sequences of the XML file. In this case, the **Import options** dialog opens.

Informations

Existing command sequences are only overwritten on import if they are in the command sequences editor.



Parameter

[Name of the command sequence]

[Action in the event of naming conflicts]

Description

Name of the command sequence to be imported, which is already present in the **List of command sequences**.

The first command sequence name is shown. After clicking on the **Skip** or **OK** button, the next command sequence is displayed with a naming conflict.

Selection of the action for the import of a command sequence in the event of already-configured command sequences in the Runtime project configuration having the same name:

- Create a new command sequence
 Creates a new command sequence in the Runtime configuration for the command sequence of the XML file.
 This imported command sequence is added when a new serial number is given:
 [command sequence name] [serial number]
- Overwrite the existing command sequence
 Overwrites the existing command sequence in Runtime with the content of the XML file.
 Note: Grayed out if the file to be overwritten in the command sequences editor is in execution mode.

Default: create a new command sequence

Carries out the import for all subsequent command sequences with naming conflicts with the action selected in [action in the event of naming conflicts].

The number in quotes states how many naming conflicts occur in the current import. There is no step-by-step display of the command sequences.

Default: Inactive

Total number of command sequences for the import.
 Note: The number gives the total number of command sequences in the XML file, not just the number of conflicts.

Skips the import for the displayed command sequence.

Switches to the next command sequence with conflicts in the event of several naming conflicts.

Note: If the Execute this action for all further conflicts property has been activated, no command sequences with naming conflicts are exported.

Number of command sequences to be imported from the XML file:

Carry out this action for all further conflicts

(number of conflicts)

Skip



Parameter	Description
ок	Carries out the import for the displayed command sequence with the action selected with [action in the event of naming conflicts].
	Switches to the next command sequence with conflicts in the event of several naming conflicts. Note: If the Execute this action for all further conflicts property has been activated, no command sequences with naming conflicts are exported.
Cancel	Cancels the import for all subsequent command sequences and closes the dialog.
Informations	

Informations

You can get further information on the structure of the XML file in the Structure of the XML file for command sequences (à la page 119) chapter.

Import command sequence(s) from simulation image

In this dialog, you arrange configured command sequences from one or more simulation images for import into zenon Runtime.

	options d'import	
Simulation de projet 01_SIMULATION_1 02_SIMULATION_EMPTY	Séquence de commandes en Séquences de commandes ex 01_For_XML_sample-1 02_For_XML_sample-1 02_For_XML_sample-2 New command sequence New command sequence New command sequence New command sequence 3 Outstation_Koestendorf Outstation_Notar-Vogl-Street Outstation_Tintifax test Test_not-saved Test_not-saved 1 Test_not-saved 2 Test_not-saved 3 Test_not-saved 3	~
	Ajouter Ecraser	
Image de simulation Filtre texte	Nom de la séquence de comm Traitement des collisio Filtre texte T Filtre texte T	
	Supprime	r
	OK Annuler	



Parameter	Description
Project simulation	List of all existing project simulation images.
	Only one simulation image can be selected at a time.
Command sequences in project simulation	List of all configured command sequences from the selected project simulation.
	Multiple selection is possible.
Existing command sequences	Pre-existing command sequences in the zenon project that is currently running.
Add	Adds selected command sequences from the Command sequences in project simulation list to the List of command sequences to be applied.
	Only active if at least one command sequence from a simulation image has been selected.
Overwrite	Adds a command sequence from the Command sequences in project simulation list to the List of command sequences to be applied. This command sequence overwrites the existing command sequence in the command sequences editor in Runtime!
	This button is only active if just one command sequence has been selected and the selected command sequence is already in the existing command sequences list. The command sequence is thus already present in the command sequences editor and is overwritten.
	With multiple selection of command sequences from a project simulation, the button is then grayed out if the selection contains a command sequence that is not yet present in the list of existing command sequences . A new command sequence is created when transferring to Runtime. This new project configuration is given a serial number in the naming.
List of the command sequences to be transferred.	Assigned command sequences that are applied in the current Runtime environment.
	 Simulation image: Name of the simulation image from which the command sequence comes.
	 Command sequence name: Name of the command sequence as saved in the simulation image.
	 Conflict handling: The type of conflict handling depends on how the respective command sequence is



	transferred to the list. Depending on the button used (Add or Overwrite), the conflict handling is prescribed and cannot be changed.
	Note: List can be sorted and filtered.
Remove	Removes highlighted command sequence from the List of command sequences to be applied.
	Multiple selection is possible. A new assignment from Command sequences in project simulation is possible.
ок	Closes the dialog and applies project configurations from the list of command sequences to be applied in the command sequences editor.
Cancel	Annule toutes les modifications et ferme la boîte de dialogue.

If the **Command Sequencer** module is operated in the zenon network, the following rules are applicable:

► If the dialog is called up, the **project simulation** list is filled with the simulation images from the server.

If a server is lost, the dialog with an empty project simulation list is called up.

• The command sequences in project simulation list is also filled with data from the server on the client. The list is empty if the server is lost.



Parameter	Description
New command sequence	Creates an empty command sequence and opens the dialog to create a new command sequence (à la page 94)
Open in command sequences editor	Opens the selected command sequence in the command sequences editor (à la page 62).
	Note: Not active if no command sequence is selected.
Rename	Opens dialog to create a new command sequence or rename a command sequence.
	Note: Not active if no command sequence is selected.
	Note: Not active if the selected command sequence is in execution mode.
Duplicate	Duplicates selected command sequence and opens dialog to create a new command sequence.
	Note: Not active if no command sequence is selected.
	Note: duplicated command sequence is automatically created in edit mode. When duplicating command sequences, the existing name is supplemented with the prefix " Copy of ". If the maximum length is exceeded by this, the name is shortened to the allowed length starting from the last character.
Delete	Deletes selected command sequence(s). Multiple selection is possible.
	Note: Not active if no command sequence is selected.
	Note: Before final deletion, an additional dialog appears requesting confirmation of whether the selected command sequence(s) are really to be deleted for good.
Exporter la sélection en XML	Exports selected command sequences as an XML file.
	Note: Not active if no command sequence is selected.
Import XML	Imports command sequence(s) from an XML file.
Import from project simulation	Imports command sequence from existing simulation images.
	You can find further information on this in the import command sequence(s) from simulation image (à la page 51) chapter.
	Note: not active if the project is currently running in simulation mode or if the user does not have the corresponding function authorization.

Toolbar - list of command sequences




Switch to execution mode	 Switches selected command sequence(s) to execution mode (à la page 92). A validation of the configured command sequence is carried out automatically. Execution mode only starts if the command sequence has been configured without errors. Otherwise a notice dialog appears informing you that the command sequence is invalid. The command sequence cannot be started. Note: Not active if no command sequence is selected.
Switch to edit mode	Switches a command sequence that is currently running in execution mode back into edit mode in order to make changes. Note: Not active if no command sequence is selected.

11.1.3 Command sequence grid

The command sequence grid is the workspace in the command sequences editor. Command sequences can be created with a graphical user interface here.

The diagram is divided into grids, with each grid offering room for one element.

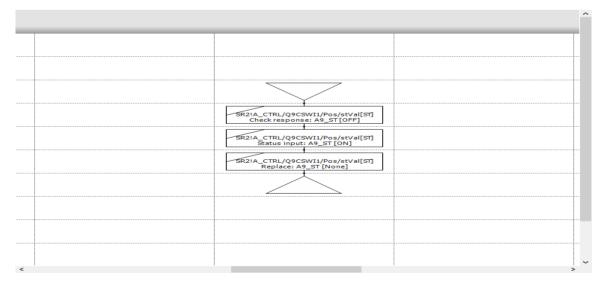



TECHNICAL DETAILS

- Sheet size:
 - Default: 11 x 11 cells
 - Minimum: 5 x 5 cells
 - Maximum: 500 x 1000 cells
- ► Cell size
 - Default: 155 x 111 pixels
- Outside edge: 100 pixel
- Grid: is displayed by default; can also be hidden
- Scroll bar: Is displayed if the document is larger than the frame.
- Scrolling with a mouse wheel: up and down or, if you press and hold Shift, left and right.
- Zooming: Ctrl + mouse wheel
- ► Selecting elements: left mouse click
- Multiple selection: Ctrl + mouse click
- Move symbol: Click element and move it over the diagram while holding the left mouse button pressed. Content can be dropped to cells with green background. If a cell turns red when you move over it, you cannot drop the content.

AMEND SIZE OF THE GRID

The size of the grid can be amended. To amend the size of the grid:

- Move the mouse pointer to the upper, lower or right-hand edge of the grid. The mouse pointer changes at the edges: <=>
- Hold down the right mouse button and move the edges: The dimensions of the grid are reduced or enlarged.

Please keep in mind:

- The minimum size of the grid is 5 x 5 cells.
- A reduction can only be carried out to a maximum of the column or line in which an element has been placed.

This guarantees that no existing project configuration is lost.

- The size of the grid is automatically enlarged during the teaching process if necessary.
- The number of new cells in the footer is visualized in the footer during the enlargement process:



Command sequence grid footer

The footer of the command sequence grid visualizes information for the configuration of the selected command sequence. The elements available are different depending on the mode.

EDITING MODE VIEW

Footer of the command sequence grid in edit mode and if teaching mode has been activated:

▪ I 🖽 11 x 11 cellules / 6 éléments	la 4/7	5/3	125% • 🕞 🕀 🕕 🚺 •
-------------------------------------	--------	-----	------------------

EXECUTION MODE VIEW

Footer of the command sequence grid in execution mode:

🚜 🛭 🧉 🕨 En cours d'exécution	k -/-	100% • 🗇 💮 🕂 🕕
------------------------------	-------	----------------



Parameter	Description
Command sequence mode	 Display of the active mode: Edit mode (symbol: pencil) Only available in edit mode.
	 Teaching mode (symbol: red square) Only available in simulation mode.
	► Execution mode:
	 Automatic mode (symbol: computer terminal)
	 Semi-automatic mode (symbol: computer terminal with hand symbol)
	You can find a graphic overview with examples of the icons in the Symbols of the footers (à la page 60) chapter.
Command sequence status of project configuration	Status of command sequence:
Configuración	 Ready to start (symbol: green hand with thumb up)
	 Warning (symbol: red hexagonal warning symbol with exclamation mark)
Process status	Graphic visualization for error-free and executable command sequence.
	 Completed (symbol: green tick)
	 Canceled (symbol: red X)
	 In progress (symbol: green triangle)
	 Idling (symbol: red minus sign)
	 Paused (symbol: two red Is)
	Note: Only visible in execution mode. You can find a graphic overview with examples of the icons in the Symbols of the footers (à la page 60) chapter.



Size of the element and number of elements	Additional information on the command sequence grid:	
Size of the element and number of elements	 Total size of the working area of the command sequence grid. [number of horizontal cells] x [number of vertical cells] Total number of positioned elements Note: Lines are not counted as an element. 	
Status of ongoing command sequence	Visualizes the current status of the command sequence in	
	progress	
	 In execution 	
	▶ Paused	
	► Aborted	
	Note: Only visible in execution mode.	
Current cursor position	Current position of the mouse pointer in the command sequence grid.	
	[cell position of horizontal cells] x [cell position of vertical cells]	
Teaching position	Current position of the teaching cursor in the command sequence grid.	
	Note: only visible if teaching is in progress.	
Number of selected elements	Visualization of the elements selected in the command sequence grid:	
	n elements selected	
	Note: Only visible in editing and teaching mode.	
Zoom level set	Drop-down list to select the zoom level for the display of the command sequence grid. Select the desired level in percent from a drop-down list.	
	Default: 100 %	
Slider for zoom	Selection of zoom level for the display of the command sequence grid.	
	The zoom level can be selected ether with the slider or with the - and + buttons.	
	The zoom levels are identical to the drop-down list of Set zoom level .	



Selection of the dockable windows	Drop-down list for List of command sequences.	
	Selection of whether the window shows the List of command sequences or is hidden.	
	If the list of command sequences is already shown, this is visualized in the drop-down list with a tick.	

Footer symbols

The footer of the command sequences grid uses the following symbols for visualization:

- 🞽 Aborted
- Executed
- 🔺 Ready for start
- In execution
- 🚇 Automatic mode
- 🖉 Edit mode
- 🐣 Semi-automatic mode
- 📕 Idle
- Paused/pause
- Teaching
- Warning

11.1.4 Modes

The command sequences editor has several modes:

- Edit mode (à la page 62)
 Command sequences are configured and edited in this mode
- Execution mode (à la page 92)
 Mode for execution of the configured command sequences.
 The execution mode has two modes:
 - Automatic mode



• Semi-automatic mode

Command sequence - execution mode

The command sequences editor executes command sequences in Runtime. You can start any number of command sequences. The execution mode is for testing a command sequence but also to execute this. In addition in the execution mode changes in the Editor can be applied directly via reloading the Runtime.

Exception: If a command sequence is currently being executed, the reloading of this command sequence is delayed. The reloading process is only carried once the command sequence has finished, been stopped or been canceled.

The following modes are available for execution in execution mode:

- Automatic mode (à la page 61) The configured command sequence is executed in automatic mode. The command sequence is only stopped in the event of pending user interaction.
- Semi-automatic mode (à la page 61)
 - There is a pause after each step in semi-automatic mode. A jump to the next step is only made after a corresponding click Configuration can thus be tested step by step.

Informations

The fundamental command sequence process cannot be changed in execution mode. You can only change values of the command tags.

Automatic mode

A configured command sequence runs in automatic mode. This mode is also used to visualize and control a configuration in Runtime.

If user interaction is necessary, the configured Command Processing screen is called up. The command sequence continues after an entry is made in the Command Processing screen.

Semi-automatic mode

The configured command sequence is executed in automatic mode. The command sequence is only stopped in the event of pending user interaction.



Only after corresponding user interaction on the **Continue command sequence at all execution positions** button or **Only continue command sequence at corresponding execution positions** does the next step become active. This mode is thus suitable for stepping through a command sequence step by step.

11.1.5 Toolbar - command sequences editor (edit mode)

In edit mode of the command sequences editor, you can easily configure a command sequence in Runtime directly by means of drag&drop.

🎦 🗟 💿 🗙 🖌 👩 🧔 🔯 ウキュティア 〇 🖌 💽 🎘



Parameter	Description		
New command sequence	Creates new command sequence.		
Save command sequence	Saves configured command sequence		
Graphical design	Calls up dialog to select the graphical design (à la page 65).		
	The following can be selected:		
	 Background color 		
	► Grid On/Off		
	► Grid color		
	 Show element IDs 		
Delete	Deletes selected element		
	Note: only active if an element was selected in the command sequence grid.		
Check command sequence for errors	Checks configuration (à la page 99) of a command sequence for logical correctness and consistency.		
	The result is displayed in a dialog.		
	 No errors during this command sequence. 		
	 Checking the command sequence resulted in the following warnings/errors: {error details} 		
Edit element	Calls up a dialog to change the element property for switchgear assignment (à la page 74) and transition (à la page 70).		
	Note: not available for step.		
Replace step	Opens the dialog (à la page 69) to select a Command Processing action. As a result of this, already-configured steps can be assigned new actions.		
	Note: only active if an element was selected in the command sequence grid.		
Edit mode	Switches the mouse cursor from adding an element to edit mode. The switch back to the edit mode can also be achieved by pressing the Esc key.		
Add step	Occupies the mouse pointer with a step. It can be added to any allowed, free location via click.		
	Opens the dialog to select a Command Processing action.		



Insert transition	Occupies the mouse pointer with a transition (à la pa 70). It can be added to any allowed, free location via		
Insert begin simultaneous sequence	Occupies the mouse cursor with a begin parallel branch (à la page 71). It can be added to any allowed, free location via click.		
Insert end simultaneous sequence	Occupies the mouse cursor with an end parallel branch (à la page 71). It can be added to any allowed, free location via click.		
Insert Begin branch	Occupies the mouse cursor with a begin branch (à la page 72). It can be added to any allowed, free location via click.		
Insert End branch	Occupies the mouse cursor with an end branch (à la page 72). It can be added to any allowed, free location via click.		
Insert switchgear allocation	Occupies the mouse pointer with a switchgear allocation (à la page 74). It can be added to any allowed, free location via click.		
Insert jump target	Occupies the mouse cursor with a jump target (à la page 77). It can be added to any allowed, free location via click.		
Start teaching	 Starts teaching mode for the currently-selected command sequences. Not active if: Teaching mode is currently running for another command sequence. Project is not running in simulation mode. 		
Stop teaching	Ends teaching mode. Not active if teaching mode is not active.		
Switch command sequence to execution mode	Switches command sequence to execution mode (à la page 92).		



Graphical design

Clicking on the symbol for the **Graphical design** in the toolbar opens the dialog for configuring the colors, grid settings and display of the element ID.

Graphical design ×
Background color
✓ Display grid
Grid color
Display element ID
OK Cancel




Parameter	Description			
Background color	Defines the background color of the command sequence grid. Click on the color in order to open the palette for selecting a color.			
Display grid	Active: Display the grid			
	Inactive: Grid is hidden.			
Grid color	Defines the line color of the grid. Click on the color in order to open the palette for selecting a color.			
Show element IDs	Shows or hides the element ID. This setting is to be made for each command sequence.			
	Inactive: No element ID is shown in the command sequence. Note: This setting is recommended for normal operation.			
	Active: The ID of the elements is displayed in the command sequence. The exception is lines. The display is in the upper left-hand corner of the element.			
	Hint: This setting is recommended for troubleshooting.			
OK	Applies all settings and closes the dialog.			
Cancel	Discards all changes and closes the dialog.			


EXAMPLES

DISPLAY IDS OF THE ELEMENTS ACTIVE



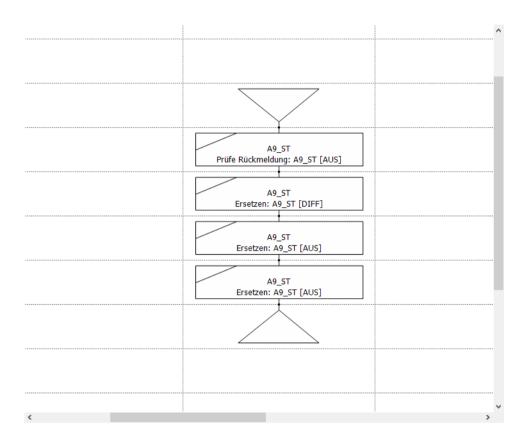



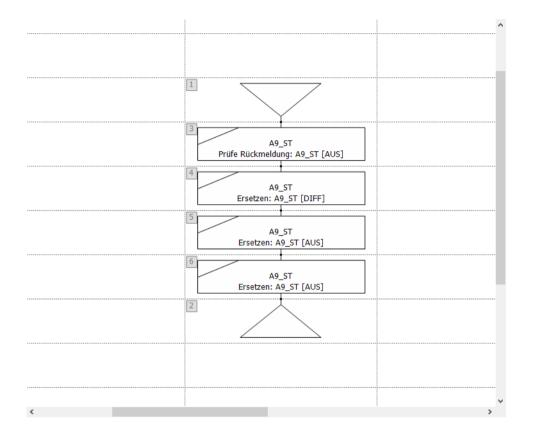

DISPLAY IDS OF THE ELEMENTS INACTIVE

Elements

The following elements can be used for the configuration of a command sequence in the command sequences editor:

- Step (à la page 69)
- ► Transition (à la page 70)
- Parallel branch (à la page 71)
- Branch (à la page 72)
- Switchgear allocation (à la page 74)
- Jump target (à la page 77)
- Lines (à la page 78)
- Teaching cursor (à la page 77)



START AND END ELEMENT

Each command sequence must have a start and end element.

These two elements are automatically created when a command sequence is created and cannot be deleted from the project configuration. Even if you have configured the complete project configuration and deleted it, the start element and the end element are not affected by this deletion.

CONFIGURATION OF AN ELEMENT:

- Set the command sequences editor to edit mode.
- Select an element in the command sequences editor with a mouse click.
- Position this element in the command sequence grid by means of drag&drop.
 Note: You can position the element several times.
- Clicking on the **Esc** button deactivates the drag&drop functionality.

Step

A step is always linked to a configured action of Command Processing in the **Command Sequencer** module. The actions are configured in the zenon Editor in the Command Processing module.



After positioning of a step in the command sequence grid, the **Action selection** dialog opens automatically. In this dialog, you select an action from the list of all actions of all command groups configured in the zenon Editor.



ACTION SELECTION

1	Sélect	ion action	
E Workspace	Switchgear $ abla$	Action	۸
2015_COMMAND_SEQU	*309* 🛛	Filtre texte	∇
	IED70_sec2_309_RV	Commande commutation: IED70_sec2_309_CO [1,1]	
	IED70_sec2_309_RV	Correction manuelle: IED70_sec2_309_RV [0]	
	IED70_sec2_309_RV	Vérification de la réponse: IED70_sec2_309_RV [1]	
	IED70_sec2_309_RV	Bloquer: IED70_sec2_309_RV	
	IED70_sec2_309_RV	Envoi de l'état: IED70_sec2_309_RV [0]	~
	IED70_sec2_309_RV	Révision: IED70_sec2_309_RV [1]	
	IED70_sec2_309_RV	Commande commutation: IED70_sec2_309_CO [0,0]	v
< >	66 total / 7 filtrés / 0 sélectionnés		
P	as de sélection	OK	Annuler

Select an action and confirm the selection with **OK**. The Command Processing action is assigned to the step as a result.

Note: The **OK** button is active if no action has been selected. Only the linking of an action is permitted for a step.


Informations

Q

You can find further information on configuration of the command processing in the Energy Edition manual in the Command Processing chapter.

Transitions - conditions

Transitions are used after steps in order to ensure a defined transition from one step to the next. Transitions display their internal status during the process and inform via a tool tip about status and process duration.





		Condition		
arameter				
⊞+¢ X01: SR	2!A_CTRL/Q0CS	NI1/Pos/stVal[ST];Schaltbefehl: A0_(Add
				Replace
				Remove
<			>	
ogical operators				Syntax
AND	NOT	OR	XOR	()
it by bit and rela	tional operators			
	&			
>	>=	<	<=	
	=	\diamond		
Condition				
(X01.REVISION	= 0) AND (X01.0	FF = 0)		~
				~
Сору	Paste			
			OK	Cancel

After positioning a transition in the command sequence grid, the **Condition** dialog opens automatically.

Select a response variable from the list of parameters. You get this list if you click on the **Add** button.

This list contains the response variables of all steps that have already been inserted into the command sequence grid.

Informations

You can find further information on conditions in the Formula editor (à la page 80) chapter in this manual.

Parallel branches

Ô

At the parallel branch an execution path parts into several execution paths which are executed in parallel during the process. For the activation of the different elements within a parallel branch you cannot define a certain order.


The project configuration always consists of a **Begin parallel branch** and an **End parallel branch**.



BEGIN PARALLEL BRANCH



END PARALLEL BRANCH



In the process the respective intermediate area of the **end parallel branch** is also colored. The color corresponds to the coloring of the command sequence.

A parallel branch is ended if the process has been completed in all execution paths. Completed means that either the following step is active or the following transition is inactive.

INSERT PARALLEL BRANCHES

To create a parallel branch:

- 1. select the symbol Insert begin parallel branch
- 2. put the branch on the desired location
- 3. connect the input connection point with a output connection point of the preceding object
- 4. connect both output connection points with the desired following objects
- 5. close a parallel branch with object Insert end parallel branch

Branch

A branch offers the possibility to execute one of several possible paths. To do this, it is necessary that the first element at the start of a procedure path is a **transition**.

Note: A Begin branch can only have one transition (à la page 70) as a subsequent object.

BEGIN BRANCH

	}		-



END BRANCH



PROCEDURE:

- ► The procedure path for which the first transition is **TRUE** is chosen.
- ► Then it is waited until all transitions have a value.
- ► If several transitions are TRUE at the same time, always the leftmost path for which the transition is TRUE is selected.

For begin and end the following is true: If there is a step in front of the element and a transition behind, the step remains active until the transition has been completed.

The objects are processed sequentially in a path. Each path processes its objects regardless of other paths.

Command sequences can select sequences and run in parallel branches (à la page 71).

branches and parallel branches consist of:

- Single or double horizontal lines
- Connection pieces (consisting of connection line and connection point)

CREATE A BRANCH

To create a branch:

- 1. Select the Insert begin branch symbol
- 2. Position the branch at the desired location.
- 3. Connect the input connection point to an output connection point of the preceding object.
- 4. Connect both output connection points with the desired following objects.
- 5. Close a branch with the Insert end branch object



Modify parallel branches and branches

MODIFY AND MOVE

Branches and parallel branches can be moved and changed in size.

MOVE

To move an object:

- 1. click on the object.
- 2. Hold down the mouse button.
- 3. Move the object to the desired position.


CHANGE SIZE

In this way object **Begin/End branch/parallel branch** can be extended and shortened. To change their size:

- 1. Move the mouse pointer over the object until it turns into a double arrow.
- 2. Hold down the left mouse button and move it in the desired direction:
 - Away from the object to extend it.
 - Into the object to shorten it.
 - The line to continue the command sequence remains unchanged each time.
- 3. at extending a new connection piece is added;
 - All fields in which lengthening is possible are colored green.
 - The process must be repeated to add several new connection pieces.
- 4. All corresponding connection pieces are deleted during shortening.

Switchgear allocation

Each item of switchgear is represented by its response variable.



The **switchgear allocation** element of the **Command Sequencer** module triggers the allocation of one or more switching devices in Runtime:



- With this element, several (or all) response variables can be reserved (assigned) in advance. The NET_SEL status bit is set for this reservation.
- Unlocking is also carried out using a switchgear assignment element.

After the command sequence process, all NET_SEL status bits are automatically deleted again.

Switchgear	Allocation	Release	
SR2!A_CTRL/Q0CSWI1/Po	os/stVal[
Action			
Action			
Outbols and all a setting			
Switchgear allocation			
O Switchgear release			

LIST OF SWITCHGEAR

Lists all available switchgear, its assignment and unlocking type. The list can be sorted - multiple selection is possible.



Parameter	Description
Switchgear	Switchgear according to configuration of the Command Processing in the zenon Editor.
Allocation	Yes, if Switchgear allocation is active. Empty if Release is active.
Release	Yes, if Switchgear release is active. In addition, the extent of the release is shown as text:
	► selective
	► global
	Empty if allocation is active.

ACTION

Parameter	Description
Switchgear allocation	If activated, the element is allocated to selected switchgear.
Switchgear release	If active, the element releases the selected switchgear.
Clearing the last allocation	If active, only the switchgear that was allocated in the last allocation is released.
	Only active if release for the switchgear is active.
Global command sequence release	If active, the switchgear that is allocated in the current allocation is released.
	Only active if release for the switchgear is active.
	Note: Allocated switchgear is automatically released again if the command sequence has been completed successfully or canceled.


CLOSE DIALOG

Option	Description	
ок	Applique les paramètres et ferme la boîte de dialogue.	
Cancel	Annule toutes les modifications et ferme la boîte de dialogue.	



Jump target

The jump target element allows a direct jump to a defined point of a branch.



Jump targets make it possible to

- To jump between procedure paths
- To jump out of branches
- engineer loops

Jump targets consist of tree inputs and one output. At this the output is always at the bottom and the inputs are located at the top and the sides. You can connect any input connection points. A path which ends in a jump target must have started with a **Begin branch**. Otherwise the end is not reached.

During the editing all connection points are visible. In the checking mode only the connection points which are connected are displayed.

Attention

Jump targets are not allowed for parallel branches.

Teaching cursor

The **teaching cursor** element visualizes each position in the command sequences grid, according to which the recorded element is placed during the teaching process.



The teaching cursor is not directly available to select as an element. It is provided by activating the teaching mode automatically.

Note: The teaching process is not started without the teaching cursor being positioned. If the recording is ended by clicking on the **Stop teaching** button, the teaching cursor is also hidden again.

POSITIONING

To position the teaching cursor in the command sequence grid:

1. Click (with simulation mode active) the **Start Teaching** button.



2. The teaching cursor is displayed and can be positioned in the command sequence grid.

NEW POSITIONING

The teaching cursor can be repositioned during an ongoing teaching process.


In the command sequence grid, move the teaching cursor with drag&drop and place the teaching cursor at the desired position in the grid. The steps applied from teaching are inserted into this new cursor position.

This repositioning can be repeated several times. As a result, different branches of a parallel branch can be configured with the teaching process.

Lines


Lines connect elements via free connection points. To connect connection points with each other:

 Activate a point with the help of the mouse: The connection point turns green. Red means that the connection point is already taken.




2. Drag a line to another connection point:

A yellow arrow shows the direction of the line.. Green fields can be crossed. Red fields may not be crossed by the line.





3. As soon as the yellow tip of the line touches the next connection point, the line is created.



LINE HANDLING

LINES:

- Are dragged with the mouse.
- Can be moved (press and hold Ctrl key)
 In doing so, all existing connections are separated and an attempt is made to reconnect the line if there are objects with connection points in the right direction at the target.
 If several lines are highlighted, the line that has a cell with mouse cursor in it is moved.
- ► Can be deleted by highlighting them and pressing the Del key.
- Are deleted when re-dragging them from the start to end.
- have a tool tip displaying its ID.

If a line reaches a connection point of an object, the connection point becomes active. If a connection is possible, it turns green otherwise red. Connections connecting two connections points of the same type - two inputs, two outputs, etc. - are not allowed. The line can be added in any case. Not allowed connections are displayed in red and trigger a corresponding error message at testing.

The connection points of the elements are always displayed in the edit mode even if the connection point in question is connected. In status "Release" no connection points are displayed.

PROPERTIES CONNECTION POINT:

- connected: highlighted red; connection is separated when the line is dragged and a new connection point can be chosen
- open: highlighted green; at dragging a new line is created

LINES CONNECT ELEMENTS

 Lines can be used as connections between all elements. It is allowed to add any number of lines after another.



Lines must not be used to connect two equal connection points. For example: Both inputs of two steps must not be connected directly with a line. In the engineering this connection is allowed. It is however displayed in red (error) and in the validation (à la page 99) an error message is displayed.

Formula editor

The formula editor is automatically opened if you need to enter or edit a formula. Above all:

Runtime:

• Editing transitions.

Note: If the step referenced in the formula is removed and a new step is added, the operands are reassigned in the case of transitions. To do this, the same step must be reinserted. Parameters from a different phase are not automatically linked.

ENTER FORMULA

The following input is accepted:

- Constant as decimal number
- ► Hexadecimal number if it is preceded by an **x**
- Dot as decimal separator; the following is true:
 - Comma is automatically converted into a dot: 23,000 to 23.000



Condition	×
Paramètre Paramètre Paramètre Paramètre Paramètre Paramètre Paramètre	Ajouter E Remplacer Supprimer
Opérations logiques AND NOT OR	x Syntaxe
Opérateurs bit à bit et de comparaison & > > > =	<=
Condition (K01.Valeur >= 3) Copier Coller	*
Aide	Ok Annuler

• Decimal places which are only zeros are removed: 23.000 to 23



Parameter	Description	
TAG list	List of the tags which can be used for the formula.	
	Each entry contains of:	
	a basis node for the label	
	a value	
	a status	
	the bits for value and status	
	A symbol at the first node displays whether it is a command or return tag.	
	The short indentifier at the beginning of the name is used for the formula.	
Add	Opens the dialog for adding a parameter (à la page 85). For this, the following applies:	
	The following can be added: numeric and binary tags and tags for time duration. Values for duration are converted to seconds	
	For conditions of a step, only the properties that were created fo be used.	
	 Tags can be added multiple times. 	
Replace	Makes it possible to replace a tag. Clicking on the button opens the dialog to add a parameter (à la page 85).	
	Selection of a new parameter replaces the highlighted parameter.	
	 Clicking on the no selection button deletes the highlighted parameter from the list. 	
	The short identifier remains the same at replacing.	
Remove	Removes the highlighted tag. For a tag to be deleted:	
	the formula must be correct	
	the selected tag must not be used in the formula	
Logical operators	Via the buttons for operators, operators are added to the formula.	
AND	logical 'AND'	
OR	logical 'OR'	
XOR	logical 'EXCLUSIVE OR'	
NOT	Negation	
Syntax	The operator buttons add the string shown on them to the formula.	



(Open parenthesis	
)	Close parenthesis	
Bit by bit and relational operators		
&	And	
1	Or	
>	greater than	
>=	greater or equal	
<	less than	
<=	Less than or equal	
=	equal	
\Leftrightarrow	less or greater	
Condition	Configuration and display of the formula.	
Сору	Copies the whole formula:	
	 All configured tags from the tag tree 	
	Formula from the field	
Coller	Pastes a formula from the clipboard. At this all already configured elements are deleted and replaced by the copied formula.	
	When copying formulas between steps, an attempt is made to resolve the operands via their names. For tags which are not found invalid entries are created in the operands list. Their point of use in the formula remain the same.	
ок	Applies formula and closes the dialog.	
	For this the formula must be correct.	
Cancel	Discards all changes and closes the dialog.	

Informations

You can link up to 99 tags in a formula. X01 to X99. The length of the formula must not exceed 4096 characters.



THE MEANING OF THE BITS:

Parameter	Description
value bits	32 value bits (from 0 -31) are available. They describe the tag value bit by bit. For binary tags only bit 0 is of importance, for SINT and USINT only the bits from $0 - 7$, etc.
State bits	Here you find the most commonly used status bits. You find the exact definition and use of the status bits in the Status Bits List (à la page 86).
value and status	 Dans les formules, toutes les valeurs (valeur des bits et bits d'état) sont traitées comme des valeurs binaires pouvant être liées de manière logique par des conditions AND et OR, etc. Les exceptions à cette règle sont la valeur totale et l'état global. Pour obtenir une expression booléenne, une condition logique ORed doit être appliquée à cette valeur totale, de bit à bit, avec une constante. Pour cela, on utilise l'opérateur &. For the result 0 (FALSE) of this logical ORing, we get the binary value 0 (FALSE), otherwise 1 (TRUE). Exemple : See the bitwise ORing example chapter.
	Exemple : See the bitwise ORing example chapter

💡 Info

The status bits NORM and N_NORM are only available in the formula editor and cannot be engineered via the status.

Informations

Les formules comportant des valeurs X binaires et des liens au niveau des bits peuvent être utilisées avec 2 valeurs binaires maximum. Si d'autres valeurs sont requises, la liaison doit être établie sans valeurs X binaires.

Exemple :

X01.Value & X02.Value -> fonctionne

X01.Value & X02.Value & X03.Value -> ne fonctionne pas

Toutefois :

X01.00 AND X02.00 AND X03.00 AND X04.00 AND X05.00 -> fonctionne



Adding parameters

Clicking on the **Add** button in the formula editor (à la page 80) opens the dialog to select parameters that are to be used for a formula.

<		Sélection - Paramètre		×
Γ	Workspace U015_COMMAND_SEQU	Disjoncteur	m	
	2015_COMMAND_SEQU	Filtre texte	\forall	
L				
L				
				^
L				v
L				
L				
	< >	0 total / 0 filtrés / 0 sélectionnés		
		as de sélection OK Annuler		
	P	as de selection		

Parameter	Description	
Project list	Display of the active project. Only parameters that have been created in the active project for the step to be configured can be selected.	
Parameter List	List of the parameters available for the selected step.	
	Multiple selection is possible. Apply by selecting and clicking on the OK button or by double clicking on a parameter.	
No selection	Deletes parameters already set. Only effective for replacement of parameters. If a parameter is highlighted in the formula editor and this dialog is opened by clicking on the Replace button, then clicking on the No selection button deletes the parameter from the list in the formula editor. The short identifier remains the same at replacing.	
ок	Inserts selected parameters into the parameter list of the formula and closes the dialog.	
Cancel	Discards selection and closes dialog.	
Help	Opens online help.	



List of status bits

Numéro de bit	Désignation abrégée	Nom long	Intitulé zenon Logic
0	M1	User status 1; for Command Processing: Type d'action "Bloquer" ; Service Tracking (Main.chm::/IEC850.chm::/117281. htm) du driver IEC 850	_VSB_ST_M1
1	M2	État utilisateur 2	_VSB_ST_M2
2	M3	État utilisateur 3	_VSB_ST_M3
3	M4	État utilisateur 4	_VSB_ST_M4
4	M5	État utilisateur 5	_VSB_ST_M5
5	M6	État utilisateur 6	_VSB_ST_M6
6	M7	État utilisateur 7	_VSB_ST_M7
7	M8	État utilisateur 8	_VSB_ST_M8
8	NET_SEL	Sélectionné dans le réseau	_VSB_SELEC
9	REVISION	Révision	_VSB_REV
10	PROGRESS	En fonctionnement	_VSB_DIREC
11	TIMEOUT	Command "Timeout exceeded" (command runtime exceeded)	_VSB_RTE
12	MAN_VAL	Valeur manuelle	_VSB_MVALUE
13	M14	État utilisateur 14	_VSB_ST_14
14	M15	État utilisateur 15	_VSB_ST_15
15	M16	État utilisateur 16	_VSB_ST_16
16	GI	Requête générale	_VSB_GR
17	SPONT	Spontané	_VSB_SPONT
18	INVALID	Invalide	_VSB_I_BIT
19	T_STD_E	External standard time (standard time) Caution: up to version 7.50, this	_VSB_SUWI
20		was the status bit T_CHG_A	
20	OFF	Désactivé	
21	T_EXTERN	Temps réel - horodatage externe	_VSB_RT_E
22	T_INTERN	Informations d'horodatage internes	_VSB_RT_I
23	N_SORTAB	Non triable	_VSB_NSORT



24	FM_TR	MD_TR;Message de défaut du transfo	_VSB_DM_TR
25	RM_TR	Message de marche du transformateur	_VSB_RM_TR
26	INFO	Informations de la variable	_VSB_INFO
27	ALT_VAL	Valeur de remplacement	_VSB_AVALUE
28	RES28	Réservé à une utilisation interne (clignotement d'alarme)	_VSB_RES28
29	N_UPDATE	Not updated (zenon network)	_VSB_ACTUAL
30	T_STD	Heure d'hiver interne	_VSB_WINTER
31	RES31	Réservé à une utilisation interne (clignotement d'alarme)	_VSB_RES31
32	СОТО	Cause de transmission bit 1	_VSB_TCB0
33	COT1	Cause de transmission bit 2	_VSB_TCB1
34	COT2	Cause de transmission bit 3	_VSB_TCB2
35	СОТ3	Cause de transmission bit 4	_VSB_TCB3
36	COT4	Cause de transmission bit 5	_VSB_TCB4
37	COT5	Cause de transmission bit 6	_VSB_TCB5
38	N_CONF	Confirmation négative de la commande par l'appareil (IEC 60870 [P/N])	_VSB_PN_BIT
39	TEST	Bit de test (IEC60870 [T])	_VSB_T_BIT
40	WR_ACK	Écriture reconnue	_VSB_WR_ACK
41	WR_SUC	Écriture réussie	_VSB_WR_SUC
42	NORM	NORM;État Normal	_VSB_NORM
43	N_NORM	État déviation normale	_VSB_ABNORM
44	BL_870	État IEC 60870 : blocked	_VSB_BL_BIT
45	SB_870	État IEC 60870 : substituted	_VSB_SP_BIT
46	NT_870	État IEC 60870:not topical	_VSB_NT_BIT
47	OV_870	État IEC 60870: overflow	_VSB_OV_BIT
48	SE_870	État IEC 60870 : select	_VSB_SE_BIT
49	T_INVAL	Horodatage externe invalide	non défini
50	CB_TRIP	Déclenchement de disjoncteur détecté	non défini
51	CB_TR_I	Détection de déclenchement de disjoncteur inactive	non défini



52	OR_DRV	Valeur non comprise dans la plage	non défini
		valide (IEC 61850)	
53	T_UNSYNC	ClockNotSynchronized (IEC 61850)	non défini
54	PR_NR	Pas enregistré dans le Process Recorder	non défini
55	RES55	réservé	non défini
56	RES56	réservé	non défini
57	RES57	réservé	non défini
58	RES58	réservé	non défini
59	RES59	réservé	non défini
60	RES60	réservé	non défini
61	RES61	réservé	non défini
62	RES62	réservé	non défini
63	RES63	réservé	non défini

Informations

Dans les formules, tous les bits d'état sont disponibles. La disponibilité peut être réduite dans le cadre d'autres utilisations.

Pour plus de détails concernant la gestion des états, reportez-vous au chapitre Gestion d'états.

Logical Operators

Liens logiques : seule la valeur logique '0' sera recherchée dans les variables ; si la valeur n'est pas égale à '0', elle sera considérée comme égale à '1'.

Contrairement aux formules bit, la portée technique peut être modifiée au moyen d'un facteur d'étirement -> (différent de '0' ou '1').

Opérateur	Signification
AND	ET logique
NOT	Négation
OR	OU logique
XOR	OU EXCLUSIF logique

Les opérateurs possèdent la priorité suivante dans le calcul de la formule :



Priorité	Opérateur
1	& (opérateur des formules bit)
2	NOT
3	AND
4	XOR/OR

Informations concernant 🤗

Jusqu'à 99 variables peuvent être liées dans une formule. X01 à X99.

Informations concernant 💡

Les bits d'état NORM et N_NORM sont uniquement disponibles dans l'éditeur de formules et ne peuvent pas être configurés par l'intermédiaire de l'état.

Bit formulas

Les formules Bit comportent uniquement un état logique haut ou bas. Contrairement aux formules logiques, la valeur brute est déjà prédéfinie (0,1).

Opérateur	Description
&	AND
	OR

Example: ORing bitwise

Vous voulez savoir si l'un des bits d'état utilisateur 1 à 8 (M1 ... M8) de la variable X01 est défini :

FORMULE CLASSIQUE :

X01.M1 OR X01.M2 OR X01.M3 OR X01.M4 OR X01.M5 OR X01.M6 OR X01.M7 OR X01.M8.

Cette requête peut être considérablement simplifiée en utilisant la condition logique OR sur l'état général.



INTERROGATION OR LOGIQUE

X01.Status & 0xFF

La constante peut être saisie au format hexadécimal, comme ci-dessus.

0xFF en décimal vaut 255, et correspond aux huit premiers bits d'état (en binaire, 1111111). Si l'un de ces bits est défini sur 1, le résultat de l'application de la condition logique ORing au niveau des bits est 1 (True) ; dans le cas contraire, le résultat est 0 (False).

Si, par exemple, tous les bits d'états utilisateur sont à tester sauf le bit M7, la formule binaire serait : 10111111. Le bit 7 est sans intérêt, et est donc défini sur 0. Ceci correspond à 0xBF en hexadécimal. L'expression de la formule est alors : **X01.Status & 0xBF**.

A la place d'une comparaison de bits avec OR à l'aide d'une constante, la valeur peut également être comparée directement à un nombre décimal. Si la comparaison est fausse, la valeur binaire sera égale à 0 (False) ; dans le cas contraire, elle prendra la valeur 1 (True).

Exemple :

Si vous voulez savoir si la valeur est égale à la constante 202 : La formule est alors :

X01.value = 202

Si la valeur est égale à la constante 202, le résultat de la formule est 1 (True) ; dans le cas contraire, le résultat est 0 (False).

Remarque : avec le caractère OR (I), la condition logique OR au niveau des bits fonctionne de la même manière que dans cet exemple.

Comparison operators

Les opérateurs de comparaison permettent de comparer directement deux valeurs numériques. Le résultat des comparaisons est une valeur binaire. "0" si la condition est fausse et "1" si la condition est vraie.


Opérateur	Description
<	Inférieur
>	supérieur
<=	Inférieur ou égal
>=	supérieur ou égal
=	Égal
<>	Différent de

À gauche et à droite de l'opérateur de comparaison doivent se trouver des valeurs complètes ou des états complets ; des bits simples ne peuvent pas être utilisés.



A droite d'un opérateur de comparaison, vous pouvez également utiliser une constante Ces constantes sont saisies sous forme de valeurs hexadécimales ou de valeurs décimales dans l'élément combiné. Hexadecimal numbers are automatically converted to decimal numbers by clicking on **OK**. For example, $0 \ge 64$ corresponds to the numerical value 100.

Remarque : The combined element is not available in the **Batch Control** module.

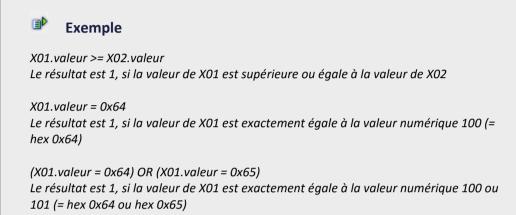

Examples for formulas

LIAISON LOGIQUE AND SIMPLE ENTRE DEUX VALEURS DE BITS

Exemple

Formule : X01.03 AND X02.03

Cette formule vaut TRUE si le bit 3 de la variable 1 et le bit 3 de la variable 2 sont tous deux égaux à 1.

COMPARAISON D'UNE VALEUR ANALOGIQUE OU DE L'ÉTAT D'UNE VARIABLE



COMPARAISON DE VALEURS ANALOGIQUES SUR UNE BASE LOGIQUE

Exemple

(X01.Value> X02.Value) AND (X01.Value = X02.Value)



COMPARAISON À L'AIDE DE BITS DE VALEUR ET DE BITS D'ÉTAT

Exemple

(X01.Value> X02.Value) AND (X01.Value = X02.Value) OR (X01.03 = X02.03)

COMPARAISON D'UNE VALEUR AVEC UNE VALEUR DÉCIMALE OU HEXADÉCIMALE

Exemple

Formule : (X01.Value = 111)

Formule : (X01.Value = 0x6F)

Si une valeur hexadécimale est utilisée, cette dernière est convertie en valeur décimale lorsque vous cliquez sur **OK**. Si une valeur décimale est saisie et confirmée, la valeur reste affichée au format décimal après la réouverture.

Informations concernant 🤗

Il n'est pas possible d'utiliser une virgule ou un point lors de la saisie d'une valeur.

11.1.6 Toolbar - Command sequences editor (execution mode)

) III 🖆 🗙 📑 🗸 🖆 💿 🖳 🥾 🎲 🔊 🖉



Parameter	Description
Start command sequence	Starts command sequence
	Note: not available during redundancy switching.
Pause command sequence	Stops current command sequence and pauses it.
Continue command sequence	Continues paused command sequence. Only active if the command sequence was previously paused with Pause command sequence .
Abort command sequence	Aborts the command sequence that is running.
User interactions	Switches to the Command Processing screen. To do this, a step must be active in the command sequence. This step must be selected by clicking on the mouse.
	The screen that was linked in the Command Processing action is called up. If no screen is linked in the Command Processing action, the linked screen of the Command Processing group is used.
	Note: Only active is the action is being executed and a user interaction is expected, for example with a two-step action or an active interlocking.
Check command sequence for errors	Checks configured command sequence for logical consistency and possible errors.
	The result is displayed in a dialog.
	 No errors during this command sequence.
	Checking the command sequence resulted in the following warnings/errors: {error details}
Edit element	Calls up a dialog with the element properties for switchgear allocation (à la page 74) and transition (à la page 70).
	No changes can be made in execution mode. Switch the editor to edit mode in order to make changes.
	Note: not available for step.
Graphical design	Calls up dialog to select the graphical design (à la page 65).
	The following can be selected:
	 Background color
	► Grid On/Off
	► Grid color



	 Show element IDs
Switch to automatic mode	Switches execution of the switching step to automatic mode (à la page 61).
Switch to semi-automatic mode	Switches execution of the switching step to semi-automatic mode (à la page 61).
Continue command sequence only at selected execution position	Continues a command sequence from the selected element only.
Continue command sequence at all execution positions	 Note: only available in semi-automatic mode. Continues a command sequence at all positions available regardless of the respective position of the mouse pointer. Note: only available in semi-automatic mode.
Switch command sequence to edit mode.	Switches to edit mode - command sequences can be edited and repositioned.

11.2 Create command sequence

Command sequences are named and renamed in the **Command sequence configuration** dialog. A descriptive text can also be configured.

You create a new command sequence in the list of command sequences (à la page 36).

Configuration séquence de commandes	×
Nom	
Nouvelle séquence de commande	
Description	
	^
<	>
ОКА	nnuler



Parameter	Description
Name	Name of the new command sequence.
	The name must not contain a question mark (?), a semicolon, an @ or an asterisk (*).
	Maximum length: 256 characters.
	Note: When duplicating command sequences, the existing name is supplemented with the prefix " Copy of ". If the maximum length is exceeded by this, the name is shortened to the allowed length starting from the last character.
Description	(Optional) text for the description of a command sequence.
	You can change the description afterwards. To change the description, select the Rename command sequence symbol.

CLOSE DIALOG

Option	Description
ок	Applique les paramètres et ferme la boîte de dialogue.
Cancel	Annule toutes les modifications et ferme la boîte de dialogue.

11.3 Tooltips

Tool tips in the command sequence editor visualize the respective status of a step and provide further information via the respective status (à la page 96).

DISPLAY OF THE TOOL TIP:

To have a tool tip displayed, go to the respective step in the command sequence grid. The tool tip appears automatically when the mouse is positioned over the step.


STRUCTURE:

The tool tip consists of:

- Command Processing command (action of a Command group)
 - Internal ID



- Allocated switchgear
- General
 - Step status
 - Internal state
 - Number of executions
- Overall duration (duration)
 - Date and time stamp for start and end
- Chronological sequence in detail (overall duration)
 - Switchgear allocation Date and time stamp for start and end
 - Duration of execution Date and time stamp for start and end
 - Wait for subsequent condition Date and time stamp for start and end



11.4 Execution status

The following states are possible:



Status	Description	
Idle	The command sequence is in idle state.	
In execution	When starting a command sequence, it changes to running status.	
Skipped	A step was skipped due to the project configuration (à la page 30).	
Executed	As soon as the execution is finished, the command sequences switches to Finished status. In this status execution is not possible.	
Pausing	The command sequence switches to paused status.	
Paused	Within the command sequence, the process stops at:	
	 Waiting for Finished 	
	Waiting for Allocation	
	Waiting for interlocking condition	
	 Waiting for Phase finished 	
	Check for parallel execution	
Aborting	Aborts the process and changes to Aborted.	
Aborted	Command sequence process was aborted.	
	If a command sequence cannot be started when the process is repeated, its status automatically changes to aborted.	
Newly-occurred	Command sequence is stopped. Aborting the command sequence is now possible.	
interlocking	This status occurs in the following scenario:	
	 An interlocking condition (one-step or two-step) waits for confirmation. 	
	 Whilst a confirmation is waited for, the active interlocking has changed again. 	

ACTIVE ELEMENT AND JUMP TARGETS

Status	Description
Continue	If an object is paused and an active element is located after it, continue has the same effect as Next step. This also includes jumps.
	For a step command, the command only affects the jump in the same branch.
Break	Has now effects for jump targets. Already defined targets remain.
Others	Always causes the deletion of the jumps.
	For a step command, only the jump in the area of the command sequence is deleted.



11.5 Symbols and Color

The states during the process of a command sequence are displayed using different symbols. Some symbols are also used for transitions and end parallel branch.

Symbol	Meaning	
8	Command sequence starts	
••	The connection is established.	
0	Wait for switchgear allocation. The switchgear of the step is already used in a different command sequence or is already assigned the NET_SEL status bit.	
D	During the execution of a step and the waiting for Reaction finished.	
	With transitions: Whilst running and waiting for transition condition.	
	With end parallel branch: Waiting for all branches combined.	
\checkmark	Step has finished	
	With transitions: Waiting for transition condition met.	
	With end parallel branch: Waiting for all parallel branches finished and waiting for following condition.	
٢	Values are written.	
(†	User interaction required. Calls up configured Command Processing screen.	
•	Command sequence is in semi-automatic mode and waits for the next step. To do this, click on the " Continue command sequence at all execution positions " button. It calls up the Command Processing screen (à la page 115).	
	Multiple executions.	
	Occurs with an attempt to execute the exact same of steps at the same time.	

SYMBOLS AND WHAT THEY MEAN:

If an error occurs during a step, the step is marked as faulty until it is restarted.

If a command sequence is paused, the current status is shown as a symbol.

STATUS

The execution status (à la page 96) of steps, transitions and End parallel branch is visualized in color:



Status	Color
Idle:	White
In execution:	green
Skipped:	petrol
Finished:	blue
Pausing:	Two colors:
	▶ orange
	 Original color
Paused:	orange
Aborting:	Two colors:
	▶ red
	Original color
Aborted:	red
Restarting:	Two colors:
	▶ green
	Original color
Timeout:	red border
Newly-occurred interlocking	red border

BEHAVIOR FOR THE STOP COMMAND

After a Stop command, the steps, transitions and end parallel branch immediately go to Stopped status, even if other elements are still waiting for a condition for stopping. Further subsequent commands such as Cancel are ignored. The Stopped status remains displayed.

11.6 Validate command sequence

Command sequences can be checked for errors during configuration.

- ► Validation is only possible in edit mode.
- ► Validation takes place automatically when switching from edit mode to execution mode.

To validate a command sequence, click on the corresponding symbol in the toolbar of the command sequences editor in Runtime (green tick - **Check command sequence for errors**). The command




sequence thus is checked for functionality according to internal rules; the following in particular is checked:

- Syntax (all lines connected, processable from begin to end, etc.) ►
- Variables
- Data Types ►

The result of the check is displayed as a dialog in plain text. Found errors are also saved in the log file which can be analyzed with the Diagnosis Viewer.


Rules that must be adhered to during configuration can be found in the Project configuration rules for recipes chapter.



DIALOG: VALIDATION OK



DIALOG: VALIDATION WITH ERRORS

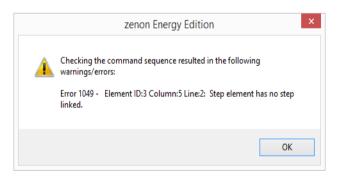

If errors occur during checking, they are displayed in this dialog.

This error information includes:

- Error number
- Element ID ►
- Position in the command sequence grid ►



Error text

11.7 Teaching

Configured Command Processing processes can be recorded in the zenon Runtime simulation with the help of teaching. As a result of this process, corresponding command sequences are configured in the simulation image in Runtime during the teaching process.

The command sequence configuration created this way can still be changed manually and imported in real time by importing the simulation image created as a result.

All steps are carried out in zenon Runtime. Additional configuration in for teaching in the zenon Editor is not necessary.

Informations

The teaching process for the **Command Sequencer** module is also available if Runtime is running in **Process Recorder**'s playback mode.

11.7.1 Teaching process

Command Processing actions are processed in a project simulation during an active teaching process and applied in the command sequence selected for teaching. The Command Processing action is incorporated as a step element in the command sequence grid. Elements can also be inserted manually in the command sequence grid during teaching. The teaching process is not interrupted as a result.

In order to be able to execute Command Processing actions from different process images, the teaching process also remains active when the command sequences editor is closed.

During this process, it is possible to switch between Command Processing screens and desired zenon screens in Runtime. It is thus also possible to apply Command Processing actions from different zenon screens in the command sequence. A requirement for this is that there is at least one Command Processing action included in the respective zenon screen.

Teaching is always carried out in the project simulation. As a result, it is ensured that ongoing real-time operation is not affected or that damage is caused by incorrect project configurations. The command sequence can also be edited and changed after the teaching process. An element can still be added manually and processes can be rearranged.

For a command sequence, the teaching process can be repeatedly started and stopped in the simulated Runtime environment.



The command sequences edited in this way can then be imported into the **list of command sequences** (à la page 42) in real-time operation with the **Import command sequence from simulation image** (à la page 51) button.

TEACHING IN THE COMMAND SEQUENCE GRID

The teaching cursor can be positioned in any free cell in the command sequence grid by means of drag&drop. Repositioning of the teaching cursor is possible at any time. For example, for parallel branches, the individual branches can be taught consecutively.

During the teaching process, for each Command Processing action executed, the corresponding step is inserted into the cell of the command sequence grid on which the teaching cursor is currently located. Once a step has been inserted, the teaching cursor is moved down one cell.

If the new teaching cursor position is already occupied by an existing command sequence project configuration, all elements below this in the grid are moved down one line. If existing lines are separated as a result, these are automatically connected again. As a result, it is ensured that a valid command sequence that already exists remains free of errors through the teaching process.

Expansion of the grid is possible up to a total of 1,000 lines. The teaching is canceled after this limit has been reached. The user is informed of this with a dialog.

11.7.2 Dialog when teaching is canceled

Certain events in zenon Runtime lead to an ongoing teaching process being canceled. This cancellation of the teaching process is visualized with warning dialogs. In addition, CEL entries and LOG entries are created for the respective events.

The teaching process is canceled:

- When the project simulation is stopped in Runtime.
- When the **Stop teaching** button is clicked on.
- When the mode of the taught command sequence is switched from edit mode into execution mode.
- During an XML export of the taught command sequence.
 Note: Caution, no warning dialog appears here. The teaching is stopped automatically. The previously-taught elements are retained however.
- With XML import, if the taught command sequence is already present in the XML import file and Overwrite existing command sequence is selected for the import options. The previously-taught elements are lost!
- In the event of changes to the taught command sequence:



- Save
- Delete
- Rename

In doing so, no distinction is made on how the command sequence is changes: for example, by means of keyboard shortcut, clicking on a corresponding symbol, selection from a context menu, etc.

DIALOGS DURING TEACHING

When the teaching process is canceled, the user is notified of this with warning dialogs. Different dialogs are shown depending on the cause of cancellation.

CLOSING ZENON RUNTIME

If Runtime is closed during an active teaching process, the user is notified of this with a dialog:

zenon Energy Edition 🛛 🗙	
Le runtime va être arrêté. Voulez-vous enregistrer les modifications dans la séquence de commandes apprise ? Annulation automatique après 15 secondes !	
Oui Non	
Parameter	Description
Yes	The changes are saved in the current command sequence to be taught. Runtime is closed.
No	The Runtime will be closed. The new elements of the command sequence are not saved.

If no button is clicked on, Runtime is automatically closed once 15 seconds have elapsed. The current command sequence is not saved.




NO AVAILABLE LINE IN THE COMMAND SEQUENCE GRID

The command sequence grid is expanded by one line during the teaching process if necessary. If the maximum number of 1,000 lines has been reached, the teaching process is canceled and the following dialog is displayed:

zenon Energy Edition	×
Une erreur est survenue ! L'enregistrement de la séquence de commandes 'Test_not-saved_02 1' va être annulée ! Voulez-vous enregistrer les modifications ?	
Oui Non	
-	
Parameter	Description
Parameter Yes	DescriptionEnds the active teaching process and saves the project configuration of the command sequence.

RENAMING THE COMMAND SEQUENCE

If a command sequence is renamed during an active teaching process, the teaching is canceled. The following dialog appears:

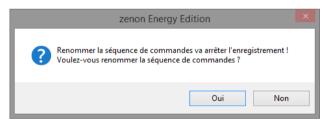



Parameter	Description
Yes	Ends the active teaching process. The command sequence is saved with the current content for the command sequence. A new teaching process is possible.
No	The command sequence is not renamed.
	The current teaching process is continued. Changes that have previously been made are not saved.

DELETING THE COMMAND SEQUENCE

If a command sequence is deleted during an active teaching process, the following dialog is displayed before deletion:

Supprimer la séquence de commandes				
Supprimer la séquence de commandes				
Voulez-vous vraiment supprimer la séquence de comm				
SI_01_sample_automatic 1				
? La séquence de commandes associée à l'enregistrement actif sera supprimée !				
Oui Non	Oui (tous) Non (tous)			



Parameter	Description
[Name of the command sequence]	Name of the command sequence that is to be deleted.
	It is always only the current command sequence name that is displayed. The next command sequence to be deleted is shown after the Yes or No button is clicked on.
Yes	Ends the active teaching process. The command sequence is saved with the current content.
	A new teaching process is possible.
No	The command sequence is not renamed.
	The current teaching process is continued. Changes that have previously been made are not saved.
Yes all	Deletes all selected command sequences without requesting confirmation.
	Note: Not active if only one command sequence has been selected for deletion.
No all	Does not delete any of the selected command sequences. The teaching process for the command sequence to be taught continues to be active.
	Note: Not active if only one command sequence has been selected for deletion.

11.7.3 Engineering

In order to be able to use teaching in zenon Runtime, process screens with a corresponding (Command Processing) engineering in the zenon Editor are required.

In addition, carry out the following steps:

ENGINEERING IN THE EDITOR

- ► Create a screen of type Command Sequencer
- ► Insert the Command sequence editor control element template into the screen.
- Create a screen switching function for the configured screen.
- Create an activate/deactivate project simulation function.
- Link the created functions in the project.



RUNTIME

- 1. Start the zenon Runtime.
- 2. Start the project simulation.
- 3. Change to the Command Sequencer screen
 - a) Create a new command sequence or select an existing command sequence for editing.
 - b) Click on the **Start teaching** button in the command sequence editor.
 - c) Position the teaching cursor element in the command sequence grid.
- 4. Switch to any desired process screen.
- Carry out the Command Processing actions.
 The corresponding step to the command sequence is added in the command sequence grid. This also happens if the command sequence image is not displayed in Runtime.
- 6. If necessary, edit the command sequence configuration. To do this, switch to the command sequencer screen:
 - a) Taught steps can be repositioned in the command sequence grid by means of drag&drop.
 - b) The teaching cursor can be repositioned in the command sequence grid for another teaching process by means of drag&drop.
 - c) To do this, continue the teaching process with step 4.
- 7. End the teaching process by clicking on the **Stop teaching** button.
- Correct the end element at the end of the command sequence configuration.
 Note: An empty line always remains before the end element by ending the teaching process.
 Move the end element up one position or drag a line through the empty cell that has been created in order to complete the command sequence configuration correctly.
- 9. Check your command sequence configuration by clicking on the **Check command sequence for errors** button.
- 10. End the Runtime simulation.
- 11. Switch to the command sequences editor
- 12. In the List of command sequences window, click on the Import command sequence from simulation image (à la page 51) symbol.
- 13. Select, in the **import options** dialog, the desired command sequence and accept this by clicking on the **OK** button in the **list of command sequences**.

11.8 Configuration rules for command sequences

The following important principles are applicable for configuration:



GENERAL

- For all elements all connection points must be connected.
 Exception: Jump targets. Only two of the three input connection points need to be linked there.
- The begin element is always present only once with a command sequence and marks the beginning of the process.
 Note: The begin element cannot be deleted.
- The end element is always present only once with a command sequence and marks the end of the process.
 Note: The end element cannot be deleted.
- Steps can be inserted anywhere. Several steps can also be placed in succession.
- There should be at least one active step in a command sequence.

TRANSITIONS

• Two transitions may not lie one after the other.

BRANCHES

- The first element after a **Begin branch** must be a transition.
- The individual branches which start at **Begin branch** must all end in an **End branch** never in an **End parallel branch**. Any element can be placed between begin and end of a branch even parallel branches as long as they are closed before the **End branch** element. An end branch can be replaced with jump targets at any point, including within a parallel branch.
- It is not necessary to have an End branch for each Begin branch. You can, for example, have two
 Begin branch elements ending in one End branch, or the other way round.
- It is not necessary to have an End branch for a Begin branch. It can simply end in a line. If for example you have a Begin branch element with two paths and one of the paths ends in a jump target, it does not make sense to have an End branch.

PARALLEL BRANCHES

- Each parallel branch must contain at least one step.
- The first element after a **Begin parallel branch** must not be a transition.
- The individual branches that start at a Begin parallel branch must all end in one End parallel branch, but must never end in an End branch. You may use any elements between Begin parallel branch and End parallel branch even branches as long as they are closed before the End parallel branch.
- Not all branches which were started in a Begin parallel branch must end in an End parallel branch. It is enough when all branches converge over an End parallel objects. Equally branches from different Begin parallel branch objects may converge in a single End parallel branch.



parallel branches allows embedding of additional parallel branches.
 In doing so: each embedded parallel branch must recombine with the superordinate parallel branch

LINES IN THE COMMAND SEQUENCE GRID

- Lines may be used as connections between any objects. It is allowed to add any number of lines after another.
- Lines must not be used to connect two equal connection points. For example: Both inputs of two steps must not be connected directly with a line. In the engineering this connection is allowed. It is however displayed in red (error) and in the validation (à la page 99) an error message is displayed.

JUMP TARGETS

- > Jump targets correspond to an end branch. They are intended to
 - jump between branches,
 - jump out of branches,
 - engineer loops

For this, the following applies: A path which ends in a jump target must have started with a **Begin branch**. Otherwise the end is not reached.

- ► Jump targets consist of tree inputs and one output. At least two inputs and the output must always be connected. At this it makes no difference which input connection point is connected.
- Jump targets can be switched consecutively if at least two input connection points are allocated.
- Jumps are prohibited:
 - between parallel branches
 - to jump out of a parallel branch
 - to jump in a parallel branch.

11.9 CEL entries

Processes in zenon Runtime are supported and visualized by entries in the Chronological Event List.

The following entries are written to the CEL:

 Command sequence created: Command sequence [command sequence name] created



- Command sequence duplicated: Command sequence duplicated. New: [command sequence name] source: [command sequence name]
- Command sequence renamed: Command sequence renamed. New: [command sequence name] old: [command sequence name]
- Command sequence completed: Command sequence [command sequence name] completed
- Command sequence canceled: Command sequence [command sequence name] canceled
- Manual step executed:

```
Manual script executed. Command sequence [command sequence name]; previous
element ID: [Element ID] (column [column number in the command sequence grid]
- line [line number in the command sequence grid])
```

Manual jump carried out:

```
Manual jump carried out. Command sequence [command sequence name]; start:
Subsequent element ID: [Element ID] (column [column number in the command
sequence grid] - line [line number in the command sequence grid]) - target:
Previous element ID: [Element ID] (column [column number in the command
sequence grid] - line [line number in the command sequence grid])
```

Skip step:

The action [step name] was skipped.

Informations

You can find further information on CEL in the Chronological Event List manual.



12. Command sequences and simulation mode

12.1 Import command sequence(s) from simulation image

In this dialog, you arrange configured command sequences from one or more simulation images for import into zenon Runtime.

options d'import		
Simulation de projet 01_SIMULATION_1 02_SIMULATION_EMPTY	Séquence de commandes en	Séquences de commandes ex 01_For_XML_sample-1 02_For_XML_Sample-2 New command sequence 1 New command sequence 1 New command sequence 2 New command sequence 3 Outstation_Koestendorf Outstation_Notar-Vogl-Street Outstation_Thtifax test Test_not-saved Test_not-saved 1 Test_not-saved 1 Test_not-saved 2 Test_not-saved 3 Y
	Ajouter Ecraser	
Image de simulation	Nom de la séquence de comm Traitement de	
Filtre texte 🛛 🖓	Filtre texte 🛛 🖓 Filtre tex	xte 🛛
		Supprimer



Parameter	Description
Project simulation	List of all existing project simulation images.
	Only one simulation image can be selected at a time.
Command sequences in project simulation	List of all configured command sequences from the selected project simulation.
	Multiple selection is possible.
Existing command sequences	Pre-existing command sequences in the zenon project that is currently running.
Add	Adds selected command sequences from the Command sequences in project simulation list to the List of command sequences to be applied.
	Only active if at least one command sequence from a simulation image has been selected.
Overwrite	Adds a command sequence from the Command sequences in project simulation list to the List of command sequences to be applied. This command sequence overwrites the existing command sequence in the command sequences editor in Runtime!
	This button is only active if just one command sequence has been selected and the selected command sequence is already in the existing command sequences list. The command sequence is thus already present in the command sequences editor and is overwritten.
	With multiple selection of command sequences from a project simulation, the button is then grayed out if the selection contains a command sequence that is not yet present in the list of existing command sequences . A new command sequence is created when transferring to Runtime. This new project configuration is given a serial number in the naming.
List of the command sequences to be transferred.	Assigned command sequences that are applied in the current Runtime environment.
	 Simulation image: Name of the simulation image from which the command sequence comes.
	 Command sequence name: Name of the command sequence as saved in the simulation image.
	 Conflict handling: The type of conflict handling depends on how the respective command sequence is



	transferred to the list. Depending on the button used (Add or Overwrite), the conflict handling is prescribed and cannot be changed. Note: List can be sorted and filtered.
	Note. List call be solled and intered.
Remove	Removes highlighted command sequence from the List of command sequences to be applied.
	Multiple selection is possible. A new assignment from Command sequences in project simulation is possible.
ок	Closes the dialog and applies project configurations from the list of command sequences to be applied in the command sequences editor.
Cancel	Annule toutes les modifications et ferme la boîte de dialogue.

If the **Command Sequencer** module is operated in the zenon network, the following rules are applicable:

► If the dialog is called up, the **project simulation** list is filled with the simulation images from the server.

If a server is lost, the dialog with an empty project simulation list is called up.

► The command sequences in project simulation list is also filled with data from the server on the client. The list is empty if the server is lost.

12.2 Creating a simulation image

In order to be able to create a simulation image in zenon Runtime, carry out the following steps in the zenon Editor:

1. Create a new function:

In the toolbar or in the context menu of the **Functions** node, select the **New function** command. The dialog to select a function is opened.

2. Select, in the dialog from the **Applications** group, the **Activate/deactivate project simulation** function.

The dialog to configure the project simulation is opened.

- 3. Name the function.
- 4. Link the function to a button.



OPERATION IN RUNTIME

If the dialog is not offered in Runtime, please note that each restart of a simulation overwrites the previous simulation image!

Informations

You can find more information in the project simulation manual.

The current status is read with the system driver variable **[system information]** Runtime status (simulation)

13. Command sequences in the zenon network

The **Command Sequencer** module is also available in the zenon network. Command sequences are always executed on the Server in the process. Each client can execute and administer command sequences.

If a computer works as a Client in the network, all changes to the command sequence(s) are transferred to/from the **Primary Server**. If there is a **Standby Server** in the current network topology, all command sequences are synchronized by the **Primary Server**. The **Standby Server** synchronizes itself automatically.

DISPLAY OF DIALOGS

If a command sequence is started by means of a function or button in the command sequences editor, dialogs are always called up on the computer on which the command sequence was started.

These are:

- Command Processing screens
- Error message

REDUNDANCY

The **Command Sequencer** module supports, from zenon version 7.50, the redundant zenon network.

The following redundancy types are supported:

- Rated network
- Non-dominant network
- Dominant network



ZENON NETWORK

You can find further information on the configuration of redundancy in the Network manual.

- ► Types of redundancy
 - Redundancy in a rated network
 - Redundancy in a non-dominant network
- Authorization in the network
- Functions in the network

13.1 Particular aspects for the Command Processing screen

If user interaction has been configured in the Command Processing, the following is applicable:

- the Command Processing screen is automatically called up on the computer on which the command sequence was started.
- On all other computers, the Command Processing screen can be called up by clicking on the User interaction button.
- When executing a two-step step, a Command Processing screen is called up once there are no more active interlockings. The Command Processing screen is either that of an action or - if no screen has been configured there - the Command Processing screen of the command group.

13.2 Simulation images in network projects

If the **Command Sequencer** module is operated in the zenon network, the following rules are applicable:

► If the dialog is called up, the **project simulation** list is filled with the simulation images from the server.

If a server is lost, the dialog with an empty project simulation list is called up.

► The command sequences in project simulation list is also filled with data from the server on the client. The list is empty if the server is lost.



13.3 Behavior in the zenon network

The network concept of the **Command Sequencer module** works according to the following principle:

- ► The command sequences can be configured on the client, as well as the Server or on the Standby Server.
- The configured command sequences are administered on the **Primary Server** and distributed to the clients.
- The command sequences can be operated on both the client and the Server.
- The command sequences are always executed on the **Primary Server**.
- With redundancy switching, the command sequences are canceled. These can be restarted manually on the new Primary Server.

ROLE SWITCH BETWEEN SERVER 1 AND SERVER 2

- ▶ Redundancy switching is delayed until all active command sequences have been completed.
- ► The start of command sequences is blocked during a redundancy switching. The buttons on the client are grayed out in this time.
 - This redundancy switching can be planned in a **Rated network**.
 - In a dominant network or a non-dominant network, redundancy switching is carried out when the Primary Server fails.
- It is possible to start command sequences again once the switch has been carried out or if the switch has been completed.
 An entry is written to the CEL in this case.
- CEL messages are written for the following events:
 - Start of a command sequence on the server is blocked.
 - If a command sequence in the dominant network is to be started on the Serveur 2.
 - The command sequence cannot be started because there is currently a redundancy switch pending.
 - **Note:** No CEL message is generated if an incorrect command sequence is started.



LOG ENTRY

Entry	Level	Description
The sequence (mrid: <id1>, crid:<id2>)<name> could not be started, because a redundancy switch is pending.</name></id2></id1>	ERRO RS	The command sequence cannot be started because there is a redundancy switch pending.

SPECIAL CASE: TWO SERVERS IN THE NETWORK

In the event that, when switching the **Primary Server**, there are still command sequences running on the "new" **Standby Server**, these are canceled on the Standby. This can only occur if both servers in the network were no longer connected (due to a network failure for example) and are now connected again. In this case, the change to the command sequence is not transferred to the Primary Server.

This means that, if there is a connection and command sequences that are now canceled on the Standby have already been opened on the Primary Server, these continue to be considered as running. It can only be restarted again once this command sequence has been closed on **Serveur 1** and **Serveur 2**.

NO CONNECTION TO SERVER AND STANDBY


If the command sequence screen is opened on the Client when neither **Serveur 1** nor **Serveur 2** are contactable, the command sequences editor on the Client is not available. The command sequence editor remains empty. An error text is displayed in zenon Runtime instead of the command sequence image.





ERROR DIALOG

If a command sequence cannot be started, the following error dialog is shown:

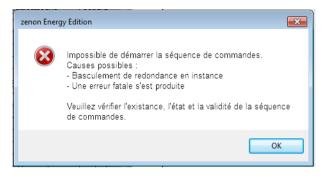

13.4 Authorization

The following rules are applicable for the **Command Sequencer** module with operating authorization:

- Operating authorization via Equipment model
 - In principle, all interactions are permitted in the command sequencer editor.
 - When a command sequence is started manually, a check is made to see whether there are operating authorizations for all variables of the command sequence (response variable). The command sequence is executed if this authorization is present.
 - In order to be able to execute a pending user interaction, the same user authorization as for the start of the command sequence is necessary.
 - All other interactions such as stopping, renaming, etc. do not need operating authorizations for the equipment model.
- Global operating authorization
 - Each start of a command sequence and each interaction needs the corresponding operating authorization.
 - No action is executed without a valid token.

14. Command sequences on the web client

If a zenon web server with the standard license is used:

> The settings for grid and color can be changed on the zenon Web Client



- No command sequences can be created or edited on the zenon Web Client
- > The size of the editing area cannot be changed on the zenon Web Client
- In the toolbar, all symbols that are not permitted on the zenon Web Client are deactivated; it is thus not possible to select the corresponding objects.

If zenon Web Server Pro is used, these restrictions do not exist.

15. Authorization

The following is applicable for operating authorizations for the **Command Sequencer** Command Sequencer module:

- Global operating authorizations
 The executing computer must have the corresponding operating authorization. No interactions
 are permitted without the corresponding authorization.

 This authorization is applicable in general for all interactions. No distinction is made for
 individual content.
- Operating authorization via Equipment model.
 - The start of a command sequence requires corresponding authorization for all response variables used in the command sequence.
 - A pending user interaction requires the same user authorization as for the start of the command sequence.
 - All other interactions such as stopping, renaming, etc. do not need operating authorizations.

Informations

You can find further information on authorizations in the Network manual in the Operating authorizations in the network chapter.

16. Structure of the XML file for command sequences

Please keep in mind:



- Changes to the XML file are for experts only and are not generally recommended.
- An invalid XML file can lead to problems during XML import. The import can fail as a result.
- Due to the fact that both the Command Sequencer module and the Batch Control module use a common XML structure, content and illustrations are the same as the terminology of the Batch Control module. If these entries are missing in the XML file, the content is also invalid for command sequences.

Informations

This documentation of the XML file describes the elements "from top to bottom" according to how they occur in the file. Substructures contained therein are each described in detail in their own areas.

Main nodes

The first level of the XML structure:

Parameter	Description
xml	XML declaration with XML version and character coding:
	version="1.0" encoding="utf-16"
Subject	Please note the detailed description for the content of this node.

SUBJECT

The **Subject** node contains general information on the XML file.

Parameter	Description
ShortName	(prescribed value) zenOn(R) exported project
MainVersion	Version of zenon from which the XML export was carried out.
	(prescribed value)
	7500
Apartment	Please note the detailed description for the content of this node.

APARTMENT

The Apartment node represents content for exported command sequence project configurations.



Parameter	Description
ShortName	(prescribed value)
	zenOn(R) command sequencer
Version	Version of zenon from which the XML export was carried out.
	(prescribed value)
	7500
CommandSequence	Node for project configuration content of a command sequence. Each individual exported command sequence configuration is represented with its own CommandSequence node. Please note the detailed description for the content of this node.

COMMANDSEQUENCE

The node contains general information on the configuration of a command sequence.



Parameter	Description
MrId	ID of the command sequence. This ID must be unique for each command sequence and must not be issued twice.
MrName	Name of the command sequence.
	Corresponds to the Name input field in the Command sequence configuration dialog.
MrDescription	Description of the command sequence. Corresponds to the Description input field in the Command sequence configuration dialog.
MrVersion	Version of command sequence. 1
	(prescribed value) Default setting that cannot be changed.
MrSourceVersion	Original version of the command sequence.
	0
	(prescribed value)
	Default setting that cannot be changed.
MrStatus	Status/mode of the command sequence.
	▶ 0
	Not used
	I Edit mode
	Not used
	▶ 3
	Execution mode
RecipeType	Type of command sequence.
	Pfc
	(prescribed value)
	Default setting that cannot be changed.
ApprovalTime	Time stamp for approved command sequences.
	No entry
	Is not used for the Command Sequencer module.
ApprovalUserName	Name of the user who approved the command sequence.
	No entry Is not used for the Command Sequencer module.
ApprovalUserID	ID of the user who approved the command sequence.
	No entry



	Is not used for the Command Sequencer module.
OutdatedTime	Obsolete time for the command sequence.
	No entry Is not used for the Command Sequencer module.
OutdatedUserName	Name of the user who set the command sequence to obsolete.
	No entry Is not used for the Command Sequencer module.
OutdatedUserID	ID of the user who set the command sequence to obsolete.
	No entry Is not used for the Command Sequencer module.
Structure	Please note the detailed description for the content of this node.

Structure node

Each configured command sequence is represented in the XML file with the **Structure_[serial number]** node.

Parameter	Description
NODE	Given text: zenOn(R) embedded object
LastObjId	Last-used ID of the command sequence.
ColCount	Total number of columns in the command sequence grid.
RowCount	Total number of rows in the command sequence grid.
CenterColOffset	Start coordinates of the cell with the first element of a command sequence configuration in the command sequence grid.
	0
	(prescribed value)
CenterRowOffset	Start coordinates of the row with the first element of a command sequence configuration in the command sequence grid.
	0
	(prescribed value)
ChartObject	Please note the detailed description for the content of this node.

ChartObject node

Each individual element of the command sequence grid is represented in the XML file with the **ChartObject_[serial number]** node.



Parameter	Description	
NODE	Given text: zenOn(R) embedded object	
Туре	Type of element.	
	<pre>1 Start element</pre>	
	<pre>2 End element</pre>	
	> 3 Step	
	4 Transition	
	5 Begin branch	
	<pre>6 End branch</pre>	
	7 Begin parallel branch	
	8 End parallel branch	
	9 Switchgear allocation	
	10 Not used for command sequences	
	<pre>11 Line</pre>	
	<pre>12 Jump target</pre>	

The respective XML elements differ depending on the element.

16.1 XML structure for elements - complete overview

This description offers a complete overview of all possible elements.

You can find a detailed description according to elements



START ELEMENT

Parameter	Description
NODE	Given text: zenOn(R) embedded object
ТУРЕ	Type of element.
	Always 1 for start element
ChartId	ID of the element in the sequence.
ChartCol	Coordinates of the column of the element in the command sequence grid.
	The number relates to the free columns next to the element. This means: ChartCol 3 = the element is positioned in Column 4.
ChartRow	Coordinates of the line of the element in the command sequence grid.
	The number relates to the free lines above the element. This means: ChartRow 3 = the element is positioned in row 4.

END ELEMENT


Parameter	Description
NODE	Given text: zenOn(R) embedded object
ТҮРЕ	Type of element.
	Always 2 for end element
ChartId	ID of the element in the sequence.
ChartCol	Coordinates of the column of the element in the command sequence grid.
	The number relates to the free columns next to the element. This means: ChartCol 3 = the element is positioned in Column 4.
ChartRow	Coordinates of the line of the element in the command sequence grid.
	The number relates to the free lines above the element. This means: ChartRow 3 = the element is positioned in row 4.



Parameter	Description
NODE	Given text: zenOn(R) embedded object
ТҮРЕ	Type of element.
	Always 11 for line element
ChartId	ID of the element in the sequence.
ChartCol	Coordinates of the column of the element in the command sequence grid.
	The number relates to the free columns next to the element. This means: ChartCol 3 = the element is positioned in Column 4.
ChartRow	Coordinates of the line of the element in the command sequence grid.
	The number relates to the free lines above the element. This means: ChartRow 3 = the element is positioned in row 4.



FirstCol	Coordinates of the column in which the line starts.	
FirstRow	Coordinates of the row in which the line starts.	
SecondCol	Coordinates of the column in which the line ends.	
	The number relates to the free columns next to the element. This means: ChartCol 3 = the element is positioned in Column 4.	
SecondRow	Coordinates of the row in which the line ends.	
	The number relates to the free lines above the element. This means: ChartRow 3 = the element is positioned in row 4.	
LineSegments	Column, row, type coordinates of the cells, separated by # where the complete line runs.	
	Type of line:	
	O: Straight line from top to bottom	
	▶ 1: 90° from the top to the right	
	▶ 2: 90° from the top to the left	
	3: Straight line from left to right	
	▶ 4: 90° from the right to the bottom	
	► 5: 90° from the left to the bottom	



Example:

1|3|0#1|2|5#0|1|0#0|2|1